

# Capital Regional District

## Core Area Wastewater Treatment Program Effluent Reuse and Heat Recovery for the University of Victoria and Surrounding Area



This report was prepared by Stantec Consulting Ltd. for the Capital Regional District. The material in it reflects our best judgment in light of the information available to us at the time of preparation. Any use which a third party makes of this report, or any release of or decisions made based on it, are the responsibilities of such third parties. Stantec Consulting Ltd. accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions taken based on this report.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

# Executive Summary

The proposed wastewater treatment facilities for the Core Area present potential opportunities for recovery of resources from wastewater. There are a number of factors which must be considered when assessing these opportunities. In order to further examine this matter, a more detailed feasibility study on the recovery of heat and effluent reuse for the University of Victoria and surrounding areas was carried out.

## Part A – Reuse of Reclaimed Water

In order to maximize the water reuse potential of the Saanich East- North Oak Bay (SENOB) plant, it is proposed to construct a tertiary membrane filtration plant for the majority of the plant flow to treat up to 1.75 times the projected 2065 average daily flow of 17.2 ML/day. The infrastructure generally needed to reuse reclaimed water includes: (1) filtration of effluent to produce high quality water, (2) disinfection using chlorine, (3) equalization storage, (4) high lift pumping, (5) “purple pipe” distribution system, (6) connection to the customers, and (7) modification of existing building plumbing and irrigation systems to accept reclaimed water.

### Regulatory Framework

The use of reclaimed water in British Columbia is governed by the Municipal Sewage Regulation issued under the Waste Management Act. This document regulates the treatment standards and the allowable uses for reclaimed water. In addition, the Province has developed a *Code of Practice for the Use of Reclaimed Water*. The BC Ministry of the Environment intends to revise the Municipal Sewage Regulation. In November 2009, the Province released a *Policy Intentions Paper for Consultation* to this effect.

The Health and Safety criteria in the current Regulation indicate that no contact with reclaimed water must occur when using reclaimed water on parks, playground and school grounds, that irrigation with reclaimed water must not occur within 60 m of areas where food is handled or consumed and that direct public contact with reclaimed water must be minimized. The Policy Paper proposes to remove the 60 m setback from areas where food is handled or consumed. The no contact requirements will be retained and are generally considered good practice when dealing with reclaimed water.

The Municipal Sewage Regulation indicates that a minimum of 20 days of emergency storage must be provided at the wastewater treatment facility to allow the effluent flow to be diverted to storage in case the water does not meet the standards required. However, if the treatment plant is built with multiple units capable of meeting the reclaimed water standard with one unit out of operation, emergency storage may be reduced to a minimum of 2 days. The Policy Paper proposes to replace the storage requirements with a requirement that treatment processes must

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

be built with multiple units capable of meeting reclaimed water standard with one unit not in operation.

The Municipal Sewage Regulation indicates that treatment requirements for areas with unrestricted public access are as follows:

- Secondary treatment followed by chemical addition and filtration:
  - BOD  $\leq$  10 mg/L
  - Turbidity  $\leq$  2 NTU
  - pH = 6 - 9
  - Fecal coliform  $\leq$  2.2/100 mL
  - Minimum total residual chlorine of 0.5 mg/L at point of use

The Policy Intentions Paper proposed the following treatment requirements for areas with the highest exposure potential such as parks, golf courses, playground and landscaping around buildings :

- Treatment requirement is virus removal via chemical addition and filtration:
  - BOD: 10 mg/L maximum
  - Turbidity: 2 NTU average and 5 NTU maximum
  - pH = 6 - 9
  - Fecal coliform: 2.2/100 mL median and 14/100 mL maximum
  - Chlorine residual to be maintained

### Proposed SENOB Treatment Plant

The proposed SENOB treatment plant can meet the treatment requirements of the current MSR and of the Policy Intentions Paper through the use of membrane bioreactor ultrafiltration which can produce an effluent with low BOD and turbidity and by the provision of chemical addition and coagulation in the primary clarifiers upstream of the biological and filtration processes.

During the dry weather months, the proposed SENOB treatment plant can meet the alternative storage requirements of having multiple units capable of meeting reclaimed water standard with one unit out of operation and an alternative method of disposing or reclaimed water. From May to October, the plant can meet the reclaimed water standards with one unit out of operation. However, during the winter months, the secondary biological treatment process may not be capable of meeting effluent requirements with one unit out of operation when wet weather flows are exceeding 1.15 x ADWF. This would preclude the use of reclaimed water during the winter months unless the number or aeration basins are increased from two to three. However it is noted that reclaimed water for irrigation purposes would not be required during the winter months. Similarly the number of primary clarifiers would have to be increased from two to three. However as discussed later, the demand for reclaimed water in the months is minimal.

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### Demand for Reclaimed Water

#### a) Golf Courses Irrigation

The maximum daily demand reported by each of the three golf courses in the area ranges from 1.3 ML/d and 2.0 ML/d. However, the Cedar Hill golf course reported obtaining approximately two thirds of their irrigation water from wells located on site and the balance from the municipal water system.

#### b) University of Victoria Irrigation

At the University of Victoria, about two thirds of the irrigated landscaped areas are located near buildings and pathways. Because of the pedestrian nature of the campus and the variety of usage, the risk that people would get into direct contact with reclaimed water is very high in many parts of the campus. However, the northwest and west portions of the campus include large lawn areas and several sport fields which have controlled public access at night. In order to reduce risks of direct contact between the public and reclaimed water, it is proposed to use reclaimed water irrigation in the sport fields and the landscaped areas on the perimeter of the campus. With these restrictions, the irrigation water demand using reclaimed water is estimated at 1.21 ML/d.

#### c) Other Potential Irrigation Water Users

There are a number of small municipal parks in the area around the University of Victoria and these are usually associated with adjacent schools. The irrigable area in these areas is approximately 13 ha and the peak demand is estimated at 0.43 ML/d .

#### d) Toilet Flushing

The University has indicated that the building floor area on campus could increase by 10% to 15% over the next 15 to 20 years. Based on a 12.5% increase in floor area and one third of water being used for toilet flushing, the future demand for reclaimed water is estimated at 57m<sup>3</sup>/day (0.057 ML/d). This demand is negligible compared with irrigation demand. It would be impractical to retrofit existing buildings with a separate reclaimed water piping system to be used for toilet flushing only.

### Options for Reclaimed Water Systems

The following four options were examined for a potential reclaimed water system:

- Option 1 – University of Victoria and surrounding schools and institutions. Daily irrigation demand of 1.62 ML/d.
- Option 2 – University of Victoria and one major golf course. Daily irrigation demand of 3.0 ML/d.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

- Option 3 – University of Victoria and two major golf courses with Cedar Hill golf course obtaining two third of irrigation water from wells. Daily irrigation demand of 3.4 ML/d.
- Option 4 – University of Victoria and two major golf courses with no well supply at Cedar Hill golf course. Daily irrigation demand of 4.3 ML/d.

The irrigation demand occurs mainly in at night in between 10:00 PM and 6:00 AM when the golf courses, playground and the sports fields are not in use and to minimize direct contact with reclaimed water. However the irrigation demand occurs at night when sewage flows are low. In order to provide enough reclaimed water at night to meet the irrigation demand, equalization storage is required if one or more golf courses are irrigated in addition to irrigation at the University of Victoria. To ensure the microbial water quality is met for fecal coliform, adequate contact time is required and a chlorine contact chamber is needed. The daily demand for the various options and the sizing of the main components of a reclaimed water system are summarized in Tables E.1 and E.2.

**Table E.1 – Daily Demand for Reclaimed Water (ML/d)**

	Option 1 – UVic Only	Option 2 – UVic & One Major Golf Course	Option 3 – UVic & Two Major Golf Courses – Partial well supply	Option 4 – UVic & Two Major Golf Courses – No well water
UVic Irrigation Demand	1.21	1.21	1.21	1.21
UVic Reclaimed Water Demand	0.06	0.06	0.06	0.06
Major Golf Course Water Demand		1.30	1.74	2.60
Schools, parks and other institutions	0.35	0.43	0.43	0.43
Total Daily Demand	1.62	3.0	3.44	4.3

**Table E.2 – Summary of Reclaimed Water System Components**

	Option 1 –	Option 2	Option 3	Option 4
Chlorine Contact Chamber (m <sup>3</sup> )	310	570	650	865
Equalization Storage (m <sup>3</sup> )	0	340	575	1160
Pump motor size (HP)	120	200	250	250
Distribution system	2.0 km long 300 mm pipe	4.3 km long 250 - 350 mm pipe	6.5 km long 150 - 400 mm pipe	6.5 km long 250 -400 mm pipe

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

Capital and operating and maintenance (O&M) costs were developed for all four options. The projected gross annual revenues are based on an incentive pricing of \$0.72/ m<sup>3</sup>. The CRD sells treated water to the local area municipalities at a rate of \$0.5433/m<sup>3</sup>. In turn, the District of Saanich sells potable water at a rate of \$1.05/m<sup>3</sup>. The District of Oak Bay sells water to golf courses at a bulk rate of \$0.55/m<sup>3</sup>. The sale of reclaimed water will result in a corresponding reduction in the sale of treated water.

Table E.3 summarizes the capital and O&M costs for the four options. When taking into account the annual O&M cost and the loss in revenues from the sale of treated water, the CRD will incur an operating loss from the sale of reclaimed water at a rate of \$0.72/m<sup>3</sup>.

**Table E.3 – Summary of Estimated Cost & Operating Loss**

	<b>Option 1 – UVic and Surrounding Schools</b>	<b>Option 2 – UVic &amp; One Major Golf Course</b>	<b>Option 3 – UVic &amp; Two Major Golf Courses – One course with wells</b>	<b>Option 4 – UVic &amp; Two Major Golf Courses – No well water</b>
Total Capital Costs	\$3,877,000	\$7,820,000	\$10,288,000	\$11,840,000
Annual O & M Costs	\$70,500	\$102,400	\$128,400	\$141,500
Projected Gross Annual Revenues (based on \$0.72/m <sup>3</sup> )	\$103,000	\$167,000	\$194,400	\$226,800
Lost Revenues from Sale of Treated Water	\$77,700	\$126,000	\$146,600	\$147,800
Loss	-\$45,200	-\$61,400	-\$80,600	-\$85,700

In order to increase the revenues and avoid an operating loss, the price of reclaimed water would have to be increased to \$1.05 m<sup>3</sup> which is similar to the price of potable water. Policy changes would be necessary to provide an incentive for users to use reclaimed water.

The above capital cost estimates are based on locating the SENOB plant at or near a site owned by the CRD on Arbutus Road. The capital cost of the reclaimed water system would be reduced by \$1.5 million if the SENOB plant was built at the UVic Field Site located on the north side of McKenzie Avenue near Gordon Head Road. However the cost of the SENOB plant would be approximately \$25 to \$30 million higher as a result of the need to build a large pumping station and 1.5 km long forcemain to pump all the sewage from the trunk line on Haro Woods to the UVic Field Site and also to extend the outfall pipe by the same distance.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### Triple Bottom Line Assessment

A value-based triple bottom line evaluation has been completed for the four options. Equal total weighting has provided a value for social, environmental and economic categories.. The results of the TBL indicate the following relative scores.

**Table E.4 – Summary of Triple Bottom Line**

	<b>Option 1</b>	<b>Option 2</b>	<b>Option 3</b>	<b>Option 4</b>
<b>Economic</b>	<b>83</b>	<b>55</b>	<b>45</b>	<b>40</b>
<b>Environmental</b>	<b>74</b>	<b>66</b>	<b>51</b>	<b>51</b>
<b>Social</b>	<b>92</b>	<b>72</b>	<b>32</b>	<b>28</b>
<b>Total</b>	<b>249</b>	<b>193</b>	<b>128</b>	<b>119</b>

### Conclusions – Reuse of Reclaimed Water

All four options provide for varying volumes of reuse of reclaimed water mainly by the use of spray irrigation in urban areas. The use of reclaimed water for toilet flushing has also been investigated. Toilet flushing could be implemented on new construction but conversion of existing plumbing systems would be very costly in existing building and is not feasible.

Public acceptability of irrigation using reclaimed water needs to be established and starting with Option 1, which provides for irrigation on the University of Victoria campus, could be seen as a phased demonstration project to provide the opportunity for public education. As the reuse of reclaimed water becomes more acceptable, the system could be extended to service adjacent large users such as golf courses.

As the reclaimed water system is expanded, the chlorine contact chamber will have to be enlarged and pumping equalization storage will be required. However there are opportunities to share the equalization storage needed for irrigation with the equalization storage required to deal with heat extraction. This is further discussed in Part B of the report.

A reclaimed water system would provide social and environmental benefits such as promoting public awareness of water conservation and reducing the effluent discharge into the ocean during the summer months. There are no financial benefits since the annual revenues will only cover the annual O&M and the corresponding loss of revenues from the sale of treated water. This assumes that reclaimed water is sold at the same price as potable water. If reclaimed water is sold at a lower price, there would be an annual operating loss. None of the capital cost of the water reclamation system would be recovered by the revenues.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### Part B – Heat Recovery

The existing 2009 average daily sewage flow at the proposed Saanich East/North Oak Bay SENOB sewage treatment plant is 9.6 ML/d. The sewage flows are projected to increase substantially to 16.6 ML/day for 2030 and 17.2 ML/day for 2065. The estimated saleable heat and the heat demand at the University of Victoria is shown in Table E.5

**Table E.5 – Estimated Saleable Heat from SENOB STP (GJ/yr)**

Year	Estimated Saleable Heat	Heat Demand
2009	94,250	211,762
2030	162,970	243,500*
2065	168,800	280,000*

When this demand is compared with the estimated saleable heat as shown in Table E.4, it can be seen that based on current sewage flows, the saleable heat is less than 50% of the annual demand. At the estimated 2030 sewage flow, the available heat is approximately 67% of the demand. Because of the limited supply of heat, long conveyance distances, high capital cost and proportionally small demand, it is proposed not to consider the heat demand of adjacent schools and institutions.

The UVic Campus is currently served by a high temperature ( 230F) natural gas fired District Heating System (DHS). Unfortunately this system has been designed to operate at much higher temperatures than are available from effluent heat pumps. In addition, hourly variations in available heat from treated effluent must be considered.

Figure E.1 shows the hourly variations in heat demand of the DHS for the entire campus of the University of Victoria assuming a 12<sup>0</sup>C winter wastewater temperature. The heating systems go into set-back mode between the hours of 8pm - 5am. This is when demand is at its lowest. At approximately 5 – 6 am, there is a sharp spike in demand as the boilers ramp-up to heat the buildings for the students and staff arriving between 7 am and 9 am. The system reaches a daytime equilibrium and then drops in the evening. Unfortunately, the morning peak heating demand occurs while the sewage flows are still low thus limiting the supply of heat at peak demand time.


In order to provide additional heat early in the morning, it is proposed to install a 1540 m<sup>3</sup> storage tank to make up for low sewage flows. Otherwise the amount of available heat as compared to the heat demand is extremely low. Also, since most boilers are not designed for frequent start and stop, the existing boilers cannot be used to supplement available heat for a few hours only.



## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

### Saanich (UVic)

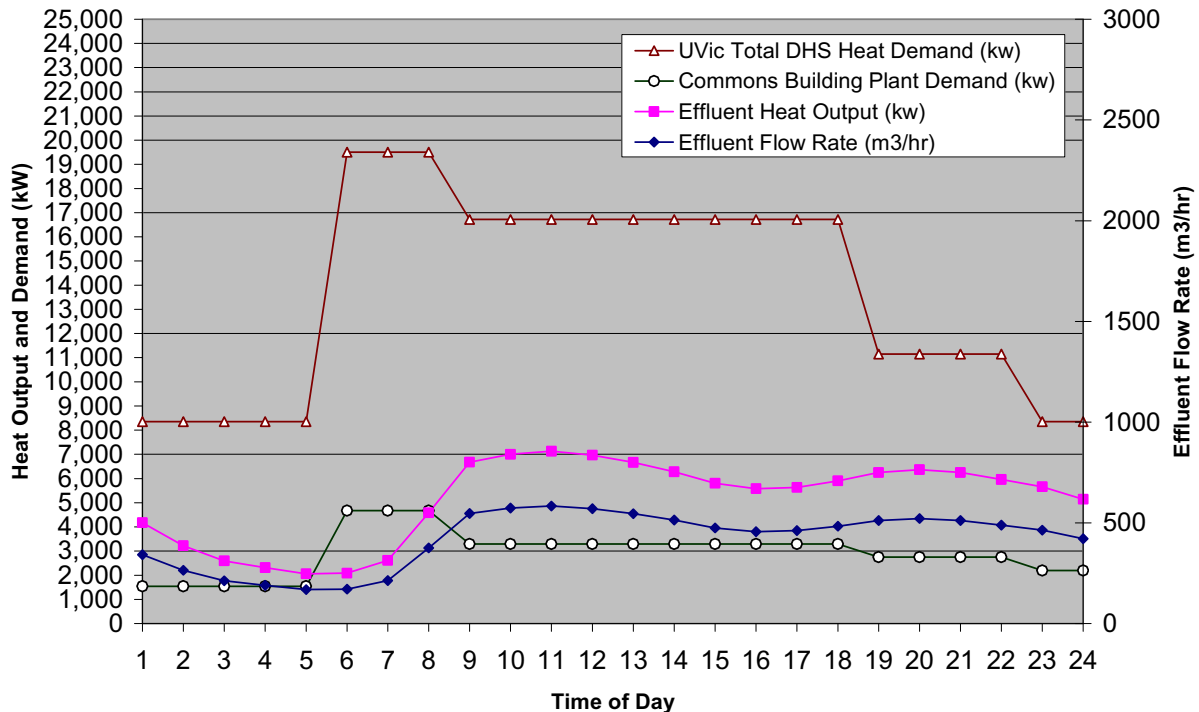

**Figure E.1 – Hourly Variations in Heat Demand and Heat Available from Effluent**

In order to deal with the limited heat supply, it is proposed to service only a portion of the campus with the effluent heat extraction system. The heat demand for space heating and domestic hot water for the entire campus is normally provided by 4 boilers in a central heating plant located in the Engineering Laboratory building (No. 4 boiler room). All the buildings on campus except smaller residential buildings are connected to a district heating system. There are three older boiler rooms on campus. One of these boiler plants, the Commons Building, is fired during the coldest period of the year to supplement the newer No. 4 boiler room.

It is proposed to supply heat extracted from effluent to the portion of the central heating system that can be valved off and supplied from the No. 2 boiler room located in the Commons Building. This would include the following buildings: The Commons, Student Union Building, Craigdarroch residences (David Thompson, Emily Carr, Margaret Newton, Arthur Currie) and the Lansdowne residences. The Commons plant is connected to the remainder of the University's district heating system by an 8 inch diameter pipe loop. In the summer, when space heating demand is low, the available heat from effluent could instead be used to provide domestic hot water heating. It appears there is enough heat available from wastewater to serve both DHW and heat for the swimming pool in the McKinnon building. This would permit the

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

University to shut down the 4000 KW natural gas fired boiler in the main boiler plant that they currently run all summer to serve the domestic hot water and McKinnon pool demand.

The highest hot water temperature that can be supplied from heat pump devices is 80 C (176 F) without major reductions in the coefficient of performance (COP). This could have a major impact on the amount of heat that may be delivered from the existing heating equipment in these older buildings. The Campus boilers currently run at 230 F.

The amount of heat at a lower temperature of 80 C would be sufficient for most of the shoulder season and domestic hot water heating. During the coldest winter days, the boilers may need to be fired to meet the demand from the 7 residence buildings. Further testing of the system will be required to confirm both the effects of the lower temperature water on heat supply to the buildings and to see how much of the shoulder heating season the wastewater heat extraction can cover.

Three alternatives of systems to provide heat extracted from the effluent to the University were evaluated:

Option 1: Ambient temperature distribution system (up to 20 °C)

Option 2: Moderate temperature distribution system (80 °C)

Option 3: Low temperature distribution system (35 °C)

The district heating system would generally consist of the following components:

1. Heat exchangers – to transfer heat from the treated effluent to a clean liquid in a district heating loop;
2. Water pumping – a first set of pumps to flow effluent through the heat exchangers and then a second set of pumps to flow the clean fluid through the district heating loop;
3. Heat pumps – the temperature of the clean liquid has to be “lifted” to the requirements of the building heating system in order to be useful for the end customer;
4. Distribution piping – to distribute the clean heating liquid from the wastewater treatment plant to the end users;
5. Various treatment, expansion and buffer tanks, and
6. Direct Digital Control (DDC) System.

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
 Effluent Reuse and Heat Recovery for the  
 University of Victoria and Surrounding Area

The system components are summarized in Table E.6

**Table E.6 – Summary of Options for District Energy System**

<b>Components</b>	<b>Option 1 – Ambient Temp. Distribution System (up to 20C)</b>	<b>Option 2 – Moderate Temp. Distribution System (80 C)</b>	<b>Option 3 – Low Temp. Distribution System (35 C)</b>
Heat exchangers	At sewage treatment plant and end user's facility	At sewage treatment plant and end user's facility	At sewage treatment plant and end user's facility
Water pumps	At sewage treatment plant	At sewage treatment plant	At sewage treatment plant
Heat pumps	At end user's facility	At sewage treatment plant	First lift heat pump at STP and second heat pump at point of use
Distribution piping	Non insulated pipe - PVC or HDPE	Insulated welded steel pipe	Insulated PVC or HDPE

The capital cost the O&M cost and the estimated revenues for the three options are summarized in Table E.7. This table also shows the value of the carbon credit resulting from the reduction in use of natural gas at the University of Victoria

**Table E.7 - Summary of Costs and Revenues**

	<b>Option 1 – Ambient Temp. Distribution System (up to 20 C)</b>	<b>Option 2 – Moderate Temp. Distribution System (80 C)</b>	<b>Option 3 – Low Temp. Distribution System (35 C)</b>
Capital Cost	\$13,125,000	\$12,083,000	\$12,797,000
O&M Cost	\$1,056,000	\$1,006,000	\$1,035,000
Annual Revenues Based on Available Heat (Current Sewage Flows)	\$1,110,000	\$1,021,200	\$1,065,600
Estimated Value of Carbon Credit (\$25/tonne CO <sub>2</sub> )	\$119,525	\$108,625	\$114,200
Estimated Value of Carbon Credit (\$50/tonne CO <sub>2</sub> )	\$239,050	\$217,250	\$228,400

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

The difference in capital and in O&M costs between the three options under consideration is not significant. The capital cost of Option 2 is lower mainly because of the economies of scale resulting from having all equipment and the heat pumps at one location. Another factor is the lower cost of the transmission line from the sewage treatment plant to the campus since hotter water requires a smaller pipe and the added cost of insulation does not offset the larger pipe size. However, Option 2 has a lower environmental score because of the heat losses in the transmission main. These heat loss estimated at 4% will result is a corresponding reduction in the amount of saleable heat and a higher energy consumption. The main drawback of Options 1 and 3 is the need to construct a new building on campus in order to house the heat pumps and other equipment at the point of use. The need to construct facilities on private property could result in significant disruption as well as the loss of land. This could also affect the marketability of the heat recovery system.

### Conclusions – Heat Recovery and Reclaimed Water

The use of reclaimed water and recovered heat must be analyzed for every specific situation as conditions at different sites can vary dramatically and what is feasible or works in one location may not necessarily work at another location. This report has investigated the feasibility of effluent reuse and heat recovery for the specific conditions at the campus of the University of Victoria and surrounding area. The capital costs for the recovery of heat and reclaimed water at the proposed SENOB wastewater treatment plant for reuse on the campus of the University of Victoria are significant and are summarized as follows:

- Capital cost of reclaimed water system (Option 1)                      \$3,877,000
- Capital cost of heat recovery system (Option 2)                      \$12,083,000
- Total capital cost    \$15,960,000

The operating and maintenance costs and the revenues generated by the recovery of heat and reclaimed water are summarized in the following table:

	Reuse of Reclaimed Water	Heat Recovery
O&M cost	\$70,500	\$1,006,000
Revenues	\$103,000	\$1,021,000
Lost revenues from the sale of potable water	- \$77,700	0
Net revenues/loss	- \$45,200	\$15,000
Carbon credit	0	\$108,000

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

Based on current available heat, a sales price for heat of \$10/GJ and a carbon credit of \$25/tonne, the payback period is 98 years for a heat recovery system.

There are several reasons why the capital costs are high for both the reclaimed water and the heat recovery systems:

- The length of the transmissions mains, 2 km for reclaimed water and 3.2 km for heat (dual pipe system 1.6 km each) from the WWTP to the point of use on the campus is a factor in the cost. However there would be a major increase in the cost of the wastewater treatment plant, estimated at \$25 million, if the SENOB plant was moved from its proposed location on Arbutus Road to a location on the Campus;
- The MSR and public health restrictions on the use of reclaimed water for spray irrigation have reduced the irrigable campus area by two-thirds so only one third of the campus can be considered for irrigation and this significantly reduces the water demand and potential revenues. The proposed changes to the MSR will eliminate some but not all the restrictions on using reclaimed water in areas with public access. Most notable, is the requirement to avoid direct public contacts for parks, playgrounds and schools and in other areas to minimize direct public contact with reclaimed water. There is a real potential for students to come in contact with non-potable reclaimed water so irrigation areas at UVic must be selected carefully ;
- The cost of irrigation using municipal water is much lower than reclaimed water and there are no public health limitations placed on use of this water;
- The heat extracted from the effluent is low grade heat which has a temperature of 12 C during the winter heating season. Following heat exchange between the effluent and clean water, the water temperature has to be boosted twice with heat pumps in order to achieve the minimum useful temperature of 80 C. The power consumption of the heat pumps is significant and this increases operating costs substantially;
- Even at 80 C, this is lower than the operating temperature the campus district heating system which is in the range of 105-115C. As a result, the use of extracted heat is limited to supplying domestic hot water in summer and space heating in the shoulder seasons. During the colder winter months, boilers will have to be fired up in order to meet the demand for space heating;
- The peak demand for heat occurs early in the morning and this corresponds to the lowest flow rate of the day. In order to supplement the low available heat, equalization storage is proposed since the life expectancy of boilers will be severely reduced by frequent stop and start cycles. (Boilers are designed to stay on for extended periods of times and not daily off-on cycles);

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

- Even with equalization storage, the amount of available heat from treated effluent represents only 25% of the morning peak demand for the campus based on existing sewage flows of 10 ML/d;
- The reclaimed water and the heated water must be pumped in separate pipelines over a 30 m difference in elevation.
- The existing sewage flow at the proposed SENOB plant averages 10 ML/d. This is significantly lower than the 2030 design flow of 16.6 ML/d. The amount of available heat is proportionally reduced.

The Climate Action Plan by the Province of British Columbia may result in an increased carbon tax and a carbon trading system. These initiatives could place a higher value on carbon and increase the benefit of heat extraction.

The proposed SENOB plant should be designed in such a manner that the footprint and piping connections required for the infrastructure needed for resource recovery are provided. This would allow the implementation of resource recovery either now or in the future. Heat recovery for the new buildings at the SENOB WWTP could be considered as it is likely this system could be implemented economically.

## Table of Contents

<b>EXECUTIVE SUMMARY .....</b>	<b>E.1</b>
<b>Section 1 Introduction.....</b>	<b>1</b>
1.1 Introduction .....	1
1.2 Challenges and Opportunities .....	2
1.3 Report Organization.....	3
 <b><u>PART A</u></b>	
<b>Section 2 Regulatory Framework for Water Reuse .....</b>	<b>4</b>
2.1 Examples of Reuse of Reclaimed Water .....	4
2.2 BC Municipal Sewage Regulation .....	4
2.3 MSR Policy Intentions Paper .....	6
2.4 California Regulations Related to Recycle Water .....	6
2.5 Proposed Wastewater Treatment Plant .....	7
2.6 Reclaimed Water Storage .....	9
2.7 Health and Safety Criteria for the Use of Reclaimed Water .....	10
2.8 Analysis .....	11
<b>Section 3 Reclaimed Water Demand.....</b>	<b>14</b>
3.1 Irrigation Water Demand .....	14
3.2 Other Potential Uses of Reclaimed Water .....	16
3.3 Reclaimed Water Demand .....	17
3.4 Availability of Reclaimed Water .....	19
<b>Section 4 Effluent Reuse System Configuration .....</b>	<b>21</b>
4.1 General.....	21
4.2 Major Components of Reclaimed Water System .....	21
<b>Section 5 Opinion of Probable Costs for Effluent Reuse .....</b>	<b>26</b>
5.1 Capital Cost .....	26
5.2 Operating and Maintenance Cost .....	28
5.3 Projected Revenues .....	28
5.4 Business Case and Market Considerations .....	29
<b>Section 6 Triple Bottom Line Analysis for Effluent Reclamation.....</b>	<b>30</b>
6.1 Methodology .....	30
6.2 Placing Value on Factors .....	32
6.2.1 Economic Impacts .....	32
6.2.2 Environmental Impacts .....	33
6.2.3 Social Impacts .....	35

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

<b>Section 7</b>	<b>Discussions and Recommendations .....</b>	<b>39</b>
<b>7.1</b>	<b>Summary of Reclaimed Water Options .....</b>	<b>39</b>
<b>7.2</b>	<b>Conclusions .....</b>	<b>41</b>
 <b><u>PART B</u></b>		
<b>Section 8</b>	<b>Examples of Heat Recovery System.....</b>	<b>43</b>
<b>Section 9</b>	<b>Heat Analysis .....</b>	<b>47</b>
<b>9.1</b>	<b>District Heating Using Effluent .....</b>	<b>47</b>
<b>9.2</b>	<b>Available Heat &amp; Heat Demand at University of Victoria .....</b>	<b>47</b>
<b>9.3</b>	<b>Proposed Arrangement for the University of Victoria .....</b>	<b>50</b>
<b>9.4</b>	<b>Cooling Demand.....</b>	<b>54</b>
<b>Section 10</b>	<b>Alternative for Heat Extraction Methods.....</b>	<b>55</b>
<b>10.1</b>	<b>In-pipe Heat Exchanger (Rabtherm Product) .....</b>	<b>55</b>
<b>10.2</b>	<b>Direct Heat Exchangers .....</b>	<b>56</b>
10.2.1	Brazed Plate Heat Exchangers .....	56
10.2.2	Plate and Frame Heat Exchangers .....	57
10.2.3	Tube in Tube Heat Exchangers.....	57
10.2.4	Shell and Tube Heat Exchangers:.....	58
10.2.5	Spiral Heat Exchangers:.....	59
10.2.6	Heat Exchanger Cleaning Options .....	60
<b>Section 11</b>	<b>Alternatives for Heat Supply System.....</b>	<b>62</b>
<b>11.1</b>	<b>General.....</b>	<b>62</b>
<b>11.2</b>	<b>Option 1 – Ambient Temperature System (Up to 25°C) .....</b>	<b>63</b>
<b>11.3</b>	<b>Option 2 – Moderate Temperature System (80°C).....</b>	<b>66</b>
<b>11.4</b>	<b>Option 3 “Low” Temperature System (35°C).....</b>	<b>67</b>
<b>Section 12</b>	<b>Opinion of Probable Cost .....</b>	<b>73</b>
<b>12.1</b>	<b>Cost Basis.....</b>	<b>73</b>
<b>12.2</b>	<b>Capital Cost .....</b>	<b>74</b>
<b>12.3</b>	<b>Operations and Maintenance Cost .....</b>	<b>75</b>
<b>12.4</b>	<b>Projected Revenues.....</b>	<b>75</b>
<b>Section 13</b>	<b>Triple Bottom Line Analysis for Heat Recovery.....</b>	<b>76</b>
<b>13.1</b>	<b>Carbon Footprint Analysis .....</b>	<b>76</b>
<b>13.2</b>	<b>Triple Bottom Line Methodology .....</b>	<b>77</b>
13.2.1	Economic Factor .....	78
13.2.2	Environmental Factors .....	79
13.2.3	Social Impacts .....	82
<b>13.3</b>	<b>Results .....</b>	<b>83</b>



**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

**Section 14 Analysis of Results and Conclusions..... 86**  
**14.1 Market Considerations .....86**  
**14.2 Triple Bottom Line Assessment .....87**  
**14.3 Conclusions.....87**

**Appendix A University of Victoria – Campus Heating**

# Section 1 Introduction

## 1.1 Introduction

The Capital Regional District is planning the construction of a wastewater treatment facility in the Saanich East-North Oak Bay (SENOB) area. One potential location for this plant is on a parcel owned by the CRD on Arbutus Road. This site is known as the Finnerty Arbutus site. Two other potential sites for this facility are owned by the University of Victoria. The proximity of the proposed SENOB plant to the University of Victoria campus provides an opportunity for the recovery of heat and effluent reuse on the University grounds, and the surrounding area.

In order to maximize the water reuse potential of the SENOB plant, it is proposed to construct a tertiary membrane filtration plant for the majority of the plant flow to treat up to 1.75 times the project 2065 average daily flow of 17.2 ML/day. The *Core Area Wastewater Treatment Program Assessment Options 1A, 1B and 1C* report prepared by Stantec Consulting Ltd. and dated September 16, 2009 indicated that this would provide high quality reclaimed water for uses not only on campus but also for other users in the surrounding area such as golf courses. One of the objectives of this study is to carry out a more detailed assessment of the local water reuse market and to develop a draft water reuse plan. A separate “purple pipe” effluent distribution system would be required to implement such a system.

The recovery of heat from raw sewage or from treated effluent to supply heat to large users is also a major focus of resources that can be recovered from wastewater. A preliminary assessment has indicated that all of the heat generated from the wastewater could be utilized by the University of Victoria to meet some of their needs for space heating and domestic hot water.

Heat recovery requires infrastructure to: (1) transfer the heat from the effluent to a clean liquid through heat exchangers, (2) lift the temperature of the clean liquid to a level that is usable by boiler systems through the use of heat pumps, (3) pumping of heated liquid, (4) distribution of the heated liquid through a network of pipe, and (5) connection to the customers.

The infrastructure needed to use reclaimed water include: (1) filtration of effluent to produce high quality water, (2) disinfection using chlorine, (3) equalization storage, (4) high lift pumping, (5) “purple pipe” distribution system, and (6) connection to the customers.

This report examines various options and requirements for the various components of the infrastructure needed to deliver heat and reclaimed water to potential users, including the vicinity of the SENOB wastewater treatment facility.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### 1.2 Challenges and Opportunities

Perceptions of treated effluent as a waste material can affect the willingness of clients, public, potential customers and regulators to embrace the idea that treated effluent is a resource that can be utilized for irrigation and as a source of heat or cooling. Open loop geo-exchange systems often rely on water from aquifers in the earth that is usually pumped from wells at approximately 12°C, the very same expected lowest temperature of treated effluent water! Treated effluent represents an excellent source of water for operating heat pumps and when the effluent is between 12°C and 20 ° C, heat pumps operate even more efficiently than with 12° C source water.

Before options for a treated effluent utility are described in detail, the technical, regulatory and perception challenges of heat exchange from wastewater must be addressed. Previous effluent heat recovery projects and studies have identified the following challenges.

The lowest treated effluent flows occur at night and in the early hours of the morning when heating demands are generally the highest. Buildings typically experience a demand spike in the morning to heat up the building for user comfort. Effluent flow, and therefore heat supply typically lag demand by a few hours in the early morning. Treated effluent flows can also vary from season to seasons and even during certain weather conditions if groundwater infiltration into the sanitary sewer system is an issue. Therefore, the careful selection of design constraints that consider peak and lowest treated effluent flows is essential to a successful system.

Total required heating power demand (KW) far exceeds the heat supply. This shortfall would have to be compensated by either reducing demand (e.g. reducing number of buildings connected) or increasing supply by employing an “energy source mix” from, for example, sea water, backup boiler possibly fired with bio-methane or natural gas, solar thermal and/or geothermal.

Treated effluent can be corrosive and any metal components can corrode if proper materials are not specified. Entrained air is present in large quantities in treated effluent, thus making the design of high capacity air venting systems essential for any closed loop or circulating pipelines. The presence of available entrained air, corrosive sewage and thus oxygen accelerates the corrosion of any metal components in the pipeline system.

Secondary treated wastewater contains small amounts of suspended solids, thus the fouling of any heat transfer or heat exchange surface can be an ongoing concern. Treatments for this condition include online heat exchanger cleaning systems, spiral “tube in tube” heat exchangers similar to those used in the pulp and paper industry, and heat exchangers with a high internal scouring velocity in order to prevent fouling. At the SENOB plant high quality MBR effluent should assist in minimizing fouling potential.

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

Pipelines for conveyance of the treated effluent are costly and must have proper clearance from watermains in order to avoid cross contamination with domestic water utilities and satisfy regulatory requirements.

Ministry of Environment standards dictate the quality and temperature of discharged effluent, as well as the requirement to not contaminate the discharged effluent in any way. Usually, any treated effluent heat exchangers must be of the double wall type, adding cost and complexity to whatever heat recovery system is installed.

### **1.3 Report Organization**

This report is divided as follows:

- Part A – Reclaimed Water Reuse for the University of Victoria and the surrounding area. This portion of the report includes Sections 2 to 7.
- Part B – Heat Recovery System for the University of Victoria. This portion of the report includes Sections 8 to 14.

Separate analyses and recommendations were carried out for the water reuse and the heat recovery portions of this report.

## **PART A – Reclaimed Water**

# **Section 2            Regulatory Framework for Water Reuse**

## **2.1      Examples of Reuse of Reclaimed Water**

Several communities in British Columbia use reclaimed water from treated effluent. These include the BC Interior communities of Vernon, Osoyoos, Oliver, Armstrong and Penticton, as well as Cranbrook and Kamloops. Vernon reclaims a large proportion of its treated municipal wastewater for irrigation of 2,500 acres of agriculture, forestry and recreational lands. In Kamloops, 300 acres of agricultural land producing hay and silage is irrigated with effluent.

Spray irrigation of golf course also takes place in several locations including Parksville at the Morningstar Golf Course, Vernon at the Predator Ridge Golf course and Osoyoos

## **2.2      BC Municipal Sewage Regulation**

The use of reclaimed water in British Columbia is governed by the Municipal Sewage Regulation issued under the Waste Management Act. This document regulates the treatment standards and the allowable uses for reclaimed water. In addition, the Province has developed a *Code of Practice for the Use of Reclaimed Water*. These two documents are titled:

*Municipal Sewage Regulation* under the Waste Management Act; BC Regulation 129/99.

*Code of Practice for the Use of Reclaimed Water* – A Companion Document to the Municipal Sewage Regulation; Issued May 2001; BC Ministry of the Environment.

Schedule 2 of the Municipal Sewage Regulation prescribes treatment standards and requirements for two types of uses for reclaimed water:

Category 1 - Unrestricted public access. In this category, water is of high enough standard that it can be used in areas with public access.

Category 2 - Restricted public access. Category 2 reclaimed water is at a level more stringent than discharge to water and marine environment; though the resulting water quality still requires that the public be restricted from contact with it.

In an urban environment, the higher Category 1 treatment standard that is applicable for unrestricted public access should be provided. The permitted uses for areas with unrestricted public access include:

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

Parks	Playgrounds
Cemeteries	Golf courses
Road rights-of-way	School grounds
Residential lawns	Greenbelts
Vehicle and driveway washing	Landscaping around buildings
Toilet flushing	Outside landscape fountains
Outside fire protection	Street cleaning

The treatment and effluent quality requirements for Category 1 effluent for unrestricted public access, as indicated in the Municipal Sewage Regulation, are as follows:

- Secondary treatment followed by chemical addition and filtration:
  - BOD  $\leq$  10 mg/L
  - Turbidity  $\leq$  2 NTU
  - pH = 6 - 9
- Disinfection
  - Fecal coliform  $\leq$  2.2/100 mL
  - Minimum total residual chlorine of 0.5 mg/L at point of use
- Storage requirements
  - 20 days minimum storage
  - Can be reduced to 2 days if treatment plant has multiple units

The monitoring requirements are as follows:

- |              |            |
|--------------|------------|
| • BOD and pH | Weekly     |
| • Coliform   | Daily      |
| • Turbidity  | Continuous |

Other requirements of the Municipal Sewage Regulation include:

- An environmental impact study (EIS) must be carried out by a qualified professional. At a minimum, the EIS must consider the other uses of the groundwater, determine maximum application rates to ensure there is no surface runoff generated by irrigation and establish a monitoring program with locations, sampling frequencies and parameters, and
- Approval is required from the Ministry of the Environment and the Vancouver Island Health Authority. Some of the health and safety criteria included in the Regulation and that are applicable to this project are as follows:
  - For use of reclaimed water on parks, playground and school grounds, the reclaimed water provider must ensure that no direct contact between the reclaimed water and any person occurs while the irrigation is occurring.
  - Irrigation with reclaimed water must not occur within 60 m of areas where food is handled or consumed.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### 2.3 MSR Policy Intentions Paper

The BC Ministry of the Environment intends to review and revise the Municipal Sewage Regulation in three stages. The first stage will focus on reclaimed water, the second stage will harmonize the Regulation with the Municipal Wastewater Effluent Strategy of the Canadian Council of Ministers of the Environment and the third stage will deal with design and operation issues. In November 2009, the Province released a *Policy Intentions Paper for Consultation* for the first stage of the amendments. The proposed changes that could affect the proposed use of reclaimed water in the study area are summarized as follows:

- The designation of permitted uses in the “*Unrestricted Public Access*” is to be replaced with permitted use in areas with “*Highest Exposure Potential*”. The allowed uses in urban areas under these two designations are similar.
- The permitted uses and standard for reclaimed water as indicated in Schedule 2 of the MSR would be revised. For the use of reclaimed water where there is the highest exposure potential of public contact with reclaimed water, the treatment requirement is as follows:
  - Virus removal via coagulation and filtration
  - Turbidity of 2 NTU average and a maximum of 5 NTU
- The storage requirements are replaced with a requirement that the treatment plant is built with multiple units capable of meeting the reclaimed water standard with one unit not in operation and an alternate method of disposing of reclaimed water be provided.
- The health and safety criteria for a 60 m setback from areas where food is prepared is to be deleted.

### 2.4 California Regulations Related to Recycle Water

California has been practicing water reuse for a number of years and have developed water reuse regulations which are often quoted and used by many jurisdictions in the US. The California Department of Public Health issued regulations related to recycled water in January 2009. These regulations define the following types of reclaimed water:

- *Disinfected secondary-2.2 recycled water* – recycled water that has been oxidized and disinfected such that the concentration of total coliform does not exceed 2.2/100 ml;
- *Disinfected secondary-23 recycled water*– recycled water that has been oxidized and disinfected such that the concentration of total coliform does not exceed 23/100 ml;

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

- *Disinfected tertiary recycled water* – a chlorine disinfection process that provides a CT value of not less than 450 milligram-minutes with a minimum contact time of 90 minutes based on peak dry weather flow. As an alternative to coagulation and filtration, filtered wastewater can be water that has passed through microfiltration, ultrafiltration, nanofiltration or reverse osmosis membrane such that the turbidity does not exceed 0.2 NTU more than 5% of the time and never exceeds 0.5 NTU. The median concentration of total coliform bacteria measured in the disinfected effluent shall not exceed 2.2/100 ml.

Disinfected tertiary recycled water can be used for irrigation of the following areas:

- Food crops;
- Parks and playgrounds;
- School yards;
- Residential landscaping; and
- Unrestricted public access golf courses.

Any use of recycled water shall comply with the following:

- No irrigation within 50 metres of a domestic water supply;
- Irrigation runoff shall be confined to the recycled water use areas;
- Spray, mist, or runoff shall not enter dwellings, designated outdoor eating areas, or food handling facilities;
- Drinking water fountains shall be protected against contact with recycled water spray, and
- All use areas where recycled water is used shall be posted with signs.

## 2.5 Proposed Wastewater Treatment Plant

It is proposed to construct a membrane bioreactor (MBR) plant to service the Saanich East-North Oak Bay area. This type of treatment plant uses membrane bioreactor ultrafiltration, which is a vacuum-driven membrane with pore sizes of 0.05 to 0.1 micron depending on the supplier. This provides a barrier to suspended solids, bacteria and many viruses to produce effluent water with very high quality and low turbidity. These types of plants typically will achieve the following effluent water quality before disinfection:



## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

**Table 2.1 – Typical Effluent Quality of MBR Plant**

BOD	≤ 2 mg/L
TSS	≤ 2 mg/L
Turbidity	≤ 1 NTU
Fecal Coliform	≤ 10 CFU/ 100 mL

The proposed SENOB MBR plant meets the stringent requirements to produce disinfected tertiary recycled water as per the California regulations, which require a concentration of total suspended solids less than 2 mg/L and turbidity less than 0.2 NTU. It also meets the BC MSR requirements for reclaimed water unrestricted public access, which requires a BOD of less than 10 mg/L a turbidity of less than 2 NTU. In order to consistently meet the fecal coliform requirements of 2.2/100 mL for both regulations and maintain a chlorine residual, disinfection using chlorine is required.

### Sizing of Tertiary Plant

As indicated in the September 16, 2008 report titled *Core Area Wastewater Treatment Assessment of Wastewater Treatment Options 1A, 1B and 1C*, it is proposed to size the SENOB plant as follows:

- Sizing of primary clarifiers based on 2065 flow (4 x ADWF) 68.8 ML/d
- Number of primary clarifiers 2
- Capacity of each primary clarifier 34.4 ML/d
- Secondary and tertiary/filtration treatment for 2065 flow (1.75 x ADWF) 30.1 ML/d <sup>(1)</sup>
- Membrane plant sizing for 2030 flow (1.75 x ADWF) 29.0 ML/d <sup>(2)</sup>
- Number of process trains for membranes 4
- Capacity of each membrane process train 7.25 ML/d

#### Notes:

(1) Portion of flow in excess of 30.1 ML/d to bypass secondary and tertiary treatment and to receive primary treatment only followed by ocean discharge.

(2) Additional membrane units to be installed in the future to meet the 2065 projected flow of 30.1 ML/d

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

## 2.6 Reclaimed Water Storage

### BC Municipal Sewage Regulation

The Municipal Sewage Regulation indicates that a minimum of 20 days of emergency storage must be provided at the sewage treatment facility to allow the effluent flow to be diverted to storage in case the water does not meet the standards required - see Clause 10 (1) (c). However, if the treatment plant is built with multiple units capable of meeting the reclaimed water standard with one unit out of operation, emergency storage may be reduced to a minimum of 2 days. The Code of Practice indicates that storage of reclaimed water is required for the following uses:

- Irrigation purpose – for times when the method of application is not continuous; storage is required for the non-growing season;
- Normal balancing (seasonal) storage;
- Emergency storage – for times when reclaimed water usage is unexpectedly interrupted, or the reclaimed water does not meet the quality standards; and
- Storage for treatment (in lieu of providing filtration).

The Code of Practice further indicates that if emergency disposal is not available, emergency storage must be available to retain 75% of the normal reclaimed water production for a period of at least 20 days. In the SENOB case emergency disposal via the Finnerty Cove outfall is available.

At the Saanich East / North Oak Bay sewage treatment plant, an ocean outfall at Finnerty will be provided for the discharge of the water that is not reclaimed for other uses. The ocean outfall will be sized for the entire peak flow into the plant. Based on the analysis of potential use of reclaimed water in the area, as discussed later in this report, the maximum potential irrigation demand is approximately 50% of the current plant flow and 30% of the plant design flow for the year 2030. There will always be a significant portion of the treated effluent that will be discharged to the ocean. During the winter months when there is no irrigation demand, it is anticipated that most, if not all, of the plant effluent will be discharged to the outfall. Since the plant will have a properly sized ocean outfall, it is proposed not to provide storage at the plant except for process requirements and equalization.

As discussed in Section 4, the estimated irrigation demand varies between 1,600 m<sup>3</sup>/day and 4,300 m<sup>3</sup>/day depending on the extent of the irrigated areas. Based on these flows, the storage requirements indicated in the MSR would be as follows:

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

	2-day Storage (m <sup>3</sup> )	20-day Storage (m <sup>3</sup> )
Volume	3,200 to 8,600 m <sup>3</sup>	64,000 to 172,000 m <sup>3</sup>
Storage Dimensions based on 6 m depth	<ul style="list-style-type: none"><li>• 24 m x 24 m</li><li>• 39 m x 39 m</li></ul>	<ul style="list-style-type: none"><li>• 105 m x 105 m</li><li>• 171 m x 171 m</li></ul>

The cost of providing 20 days of storage is major expenditure and would likely result in effluent irrigation not being feasible. The cost of providing two days of storage would range from \$1.2 million to \$3.0 million.

### MSR Policy Intentions Paper

In the Policy Intentions Paper for Discussions, it is proposed to replace the storage requirements with: (1) a requirement the wastewater treatment plant must be built with multiple units capable of meeting the reclaimed water standard with one unit out of operation, and (2) an alternate method of disposing the effluent is provided. How this proposed requirement can be met is discussed in Section 2.8.

### California Public Health Regulation

The California regulation for disinfected tertiary recycled water requires storage to provide sufficient contact time after the addition of chlorine. The minimum size of the tank is to provide 90 minutes of contact time. These regulations also require that multiple treatment units be provided such that the effluent water quality can be achieved with one unit out of service.

## **2.7 Health and Safety Criteria for the Use of Reclaimed Water**

The Municipal Sewage Regulation (Appendix 3 to Schedule 7) and the Code of Practice specifies the following construction and operating requirements:

### Construction Requirements:

- All piping, valves, meters and irrigation equipment must be marked to differentiate reclaimed water from domestic water (purple pipe);
- Hose and hose bibs on reclaimed water irrigation system are not permitted;
- There must be 3 metre horizontal and 0.3 metre vertical separation between reclaimed water pipes and other water pipes;
- No irrigation with reclaimed water within 30 m of any water well;

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

- Any water impoundment with reclaimed water must have warning signs, and
- At all areas irrigated with reclaimed water, warning signs must be posted in sufficient numbers to advise the public that reclaimed water is being used and is not safe for drinking.

### Operating Criteria:

- In parks, playgrounds and school grounds, there shall be no contact between the reclaimed water and any person while irrigation is occurring;
- Golf score cards and signage must be posted to indicate that reclaimed water is used;
- Irrigation with reclaimed water must not occur within 60 m of areas where food is handled or consumed;
- Precaution must be taken that reclaimed water will not drift outside of property or on passing vehicles, buildings, water facilities and food handling facilities;
- Irrigation must be controlled to prevent ponding and run-off from reclaimed water;
- Direct public contact with reclaimed water must be minimized;
- Irrigation systems using reclaimed water in a residential area can operate only between 10:00 PM and 6:00 AM, and
- Use only pop-up heads or drip irrigation systems.

As indicated in the MSR Policy Intentions Paper it is proposed to remove the 60 m setback distance related to food. However the requirements of not contact between reclaimed water and any person for parks, playgrounds and school grounds and minimizing direct public contact with reclaimed water will be maintained. Golf courses are closed to the public during the evening and at night, and they usually irrigate between 10 pm and 6 am. As a result, the health and safety criteria can be met for irrigation using reclaimed water. A more detailed discussion on how these criteria will affect the use of reclaimed water on the campus of the University of Victoria is included in Section 4.

## **2.8 Analysis**

This section describes how the requirements outlined in the Policy Intentions Paper for amending the MSR can be met with the proposed SENOB plant and if modifications to the proposed design of the plant are required in order to meet these proposed amendments. The two main issues are (1) provision for coagulation and filtration and (2) provision for multiple units to meet reclaimed water standards.

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### Coagulation and Filtration

The main difference between MBR plants and conventional processes is that very low level of turbidity is obtained without the use of chemical coagulation.

With conventional sewage treatment processes such as activated sludge, biological treatment must be followed by coagulation and filtration in order to achieve turbidity lower than 2 NTU as required for high quality reclaimed water suitable for unrestricted public access in the BC MSR. This is typically done with sand filtration preceded by chemical addition for coagulation. Because of the small pore size, the ultrafiltration membrane process (MBR) on its own will achieve equivalent or better water quality and will produce water with turbidity of less than 1 NTU. Furthermore, the membrane filtration process does not require chemical addition to achieve this low turbidity. An ultrafiltration MBR plant, in conjunction with chlorine disinfection followed by adequate contact time of 90 minutes or more, would meet the requirement of the fecal coliform requirements of the proposed MSR regulation.

However both the Municipal Sewage Regulation and the Intentions Paper require chemical addition and coagulation prior to filtration. It appears that the current MSR requirements were developed prior to MBR development and were aimed at conventional filtration processes which often require a coagulant chemical to provide good filter performance. In order to deal with this regulatory requirement, there are two options:

#### Option 1 – Provide evidence of acceptable microbial water quality

Section 10 (9) of the MSR states: “Methods of treatment for reclaimed water other than those included in this regulation and their reliability features, may be accepted by the Director if the discharger demonstrates to the satisfaction of the Director that the method of treatment and their reliability features will assure an equal degree of treatment, public health protection and treatment reliability.”

In order to eliminate the chemical addition component of the treatment train, a submission to the Minister must present evidence that the membrane bioreactor without chemical addition will meet this test. Evidence to this effect could be obtained from numerous operating MBR plants in North America. The CRD also has a membrane bioreactor plant at the Ganges sewage treatment facility and effluent water quality data could be obtained from this plant as well.

#### Option 2 – Chemical addition

A coagulant such as alum could be added to the wastewater following preliminary treatment. The primary sedimentation tank would act as both a coagulation tank and a settling tank. The coagulation and sedimentation phase in the primary clarifiers would be followed by biological treatment and membrane filtration. The addition of coagulant would be required on a year-long basis if reclaimed water is to be used for toilet flushing.

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

If reclaimed water is used only for irrigation, then coagulation would be required from mid-April to mid-October during the irrigation season.

It is proposed to meet with treatment requirements of the MSR Policy Intentions Paper by chemical addition and coagulation. The cost of the equipment for the addition of chemicals following preliminary treatment is already included in the preliminary cost estimate for the project and no modification to the proposed design would be necessary.

### Multiple Units

The proposed plant is designed to deal with high flows resulting from inflow and infiltration. These high flows occur during the winter months when the groundwater table rises as a result of increased precipitation. During the summer months, when irrigation using reclaimed water is practiced, the peak flow is significantly less than the wet weather peak flow which occurs during the winter months. Based on current flow record the peak dry weather flow is 1.15 times the average dry weather flow (1.15 x ADWF)

Primary treatment at the SENOB plant is sized for four times the average dry weather flow, a condition that occurs only in the winter. Each of the two primary clarifiers can handle two times the average dry weather flow which is higher than the peak dry weather flow (1.15 x ADWF). The primary clarifiers are followed by two aeration tanks for biological treatment and four tanks with membrane cassettes. The maximum allowable organic loading on the aeration tank is 1.3 times the design flow of 1.75 x ADWF for a total organic loading of 2.3 x ADWF. Each aeration tank could handle the peak dry weather flow of 1.15 x ADWF. The membrane portion of the SENOB plant will have 4 process trains, each designed for a flow of 7.25 ML/d which corresponds to 0.44 x ADWF. With one of the four membrane tanks out of service, the filtration membranes will have the capacity to treat 1.32 x ADWF. This exceeds the peak dry weather flow of 1.15 x ADWF.

In summary, the proposed SENOB plant will be capable of meeting the treatment requirements for reclaimed water to be used in unrestricted public access areas during the dry weather months. The dry weather months correspond to the irrigation season. However during the winter months, the treatment plant is not designed to meet the stringent effluent requirements for water reclamation with one unit of our service if the unit is out of service during flows exceeding 1.15 x ADWF.

## Section 3 Reclaimed Water Demand

### 3.1 Irrigation Water Demand

In this section, potential uses for reclaimed water are examined. These include irrigation and toilet flushing. The two largest potential users of reclaimed water are golf courses and the University of Victoria. Information gathering meetings were held with potential users in order to determine how much of the current and future water demand could be met with reclaimed water.

#### Golf Courses

The potential irrigation water demand in the vicinity of the SENOB plant was estimated based on actual irrigation volumes obtained from local golf courses. Irrigation at the local golf courses takes place every day between 10:00 PM and 6:00 AM. The maximum daily demand reported by each of the three golf courses in the area varies ranges from 1.3 ML/d and 2.0 ML/d. However, the Cedar Hill golf course reported obtaining approximately two third of their irrigation water from wells located on site and the balance from the municipal water system. At this golf course, both the well water and the municipal water are discharged into a holding pond. Water is then pumped from the pond into the irrigation system. The other two local golf courses do not use well water for irrigation because of an inadequate aquifer.

Assuming that the two major and the small golf courses located within 4 km of the proposed SENOB plant were to be irrigated with reclaimed water and that the use of wells at the Cedar Hill golf course would be discontinued, the total demand for reclaimed water would be approximately 2.7 ML/d. If a third major golf course located 6 km from the SENOB plant was added, the total demand for reclaimed water would increase to 4.7 ML/d. However, considering that an additional 4 km long pipeline would be needed, this option was not retained for further analysis.

A detailed review of the existing golf course irrigation system would be required to ensure that adjacent residential areas are not affected by wind drift during irrigation. It was assumed that the current irrigation system met these requirements.

#### University of Victoria

The total annual water demand at the University of Victoria is 740 ML/y. Approximately 185 ML/y or 25% of the annual demand is for irrigation. The irrigation demand can be further divided as follows:

- Playing fields 58 ML/y
- Landscaped areas 127 ML/y

Almost all of the irrigation is done with pop-ups spray heads but a very small amount totaling approximately 5,000 litres per day, is done using drip irrigation. There are 10 drip irrigation systems on the campus.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

About two thirds of the irrigated landscaped areas are located near buildings and pathways. The northeast quadrant of the campus consists mainly of residences. The central portion of the campus has several facilities that are open late in the evening including libraries, sports facilities, a cinema, a pub, a book store and a major transit exchange. The University of Victoria is a pedestrian oriented campus. It is likely there would be pedestrian traffic late in the evening and early in the morning in the central and eastern portions of the campus when irrigation would take place. Because of the pedestrian nature of the campus and the variety of usage, the risk that people would get into direct contact with reclaimed water is very high in many parts of the campus

However, the northwest and west portions of the campus include large lawn areas and several sport fields which have controlled public access at night. This portion of the campus located along McKenzie Avenue east of Finnerty Road, is isolated from the rest of the campus and has significant pedestrian traffic. Other potential areas that could be irrigated with reclaimed water include the ornamental public gardens that are closed during the evenings and isolated lawn areas in the south portion of the campus near Cedar Hill Cross Road. In order to reduce risks of direct contact between the public and reclaimed water, it is proposed to use reclaimed water irrigation in the sport fields and the landscaped areas on the perimeter of the campus.

Approximately one third of the landscaped and lawn area could be irrigated with reclaimed water as well as most of the playing fields. With these restrictions, the irrigation water demand using reclaimed water is estimated as follows:

- |  |                  |
|--|------------------|
| • Playing fields   | 0.65 ML/d        |
| • Landscaped areas away from buildings and drip irrigation | 0.45 ML/d        |
| • Allowance for future expansion                           | <u>0.10 ML/d</u> |
| • Total irrigation demand at UVic                          | 1.20 ML/d        |

### Municipal Parks, Playgrounds and Other Institutions

There are a number of small municipal parks in the area around the University of Victoria and these are usually associated with adjacent schools. The larger Mount Tolmie Park and Uplands Park are not irrigated as they contain significant areas with Gary Oak natural habitat which should not be irrigated in the summer. The small municipal parks, schools and other institutions which could potentially be irrigated with reclaimed water include:

- Queen Alexandra Children's Hospital
- Mount Douglas High School
- Campus View School
- Henderson Park and Uplands School
- Arbutus Middle School



## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

The irrigable area in these institutions totals approximately 13 ha and the peak demand is estimated at 0.4 ML/d

### Summary of Irrigation Demand

The potential total demand for reclaimed water for irrigation for the University of Victoria and for the golf courses within 4 km of the SENOB plant is as follows.

- |   |                 |
|---|-----------------|
| • University of Victoria                  | 1.2 ML/d        |
| • Golf courses within 4 km of SENOB plant | 2.7 ML/d        |
| • Parks, schools and other institutions   | <u>0.4 ML/d</u> |
| • Estimated Total Irrigation Demand       | 4.3 ML/d        |

### 3.2 Other Potential Uses of Reclaimed Water

The following potential uses for reclaimed water were also investigated: (1) toilet flushing in future buildings at the University of Victoria and, (2) outside water features at the University of Victoria. Existing buildings were not considered for toilet flushing because plumbing modifications would be very costly and disruptive.

The total water consumption at the University of Victoria for the one year period ending in September 2009 is 737,400 m<sup>3</sup>. Approximately 25% of the water consumption is made up of irrigation demand with the balance for other uses throughout the campus. This includes domestic water usage in residences, hot water and toilet flushing in faculty buildings, and other uses. Dual plumbing systems with purple pipes for reclaimed water to be used for toilet flushing could be included in future buildings. The University has indicated that the building floor area on campus could increase by 10% to 15% over the next 15 to 20 years. Based on a 12.5% increase in floor area and one third of water being used for toilet flushing, the future demand for reclaimed water is estimated as follows:

- |  |                                  |
|--|----------------------------------|
| • Current non-irrigation water demand                          | 555 ML/y                         |
| • Estimated non-irrigation water demand of future developments | 63 ML/y                          |
| • Portion of non-irrigation water demand for toilet flushing   | 30%                              |
| • Estimated water additional demand for toilet flushing        | 20.7 ML/y (57 m <sup>3</sup> /d) |

All existing water features on the campus function as a component of storm water management. The addition of external reclaimed water would deter the water features from their main functions.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### 3.3 Reclaimed Water Demand

Four options are examined for the reclaimed water distribution system:

- Option 1 – University of Victoria and surrounding parks and institutions
- Option 2 – University of Victoria, surrounding parks and one major golf course
- Option 3 – University of Victoria, surrounding parks and two major golf courses with Cedar Hill golf course obtaining two third of irrigation water from wells
- Option 4 – University of Victoria and two major golf courses with no well supply

Peak demands were estimated for each of these four options and are detailed in Table 3.1. The peak demand is used to size the reclaimed water system including the chlorination system, the chlorine contact chamber, the high lift pumps and the distribution piping. The irrigation on golf courses takes place between 10:00 am and 6:00 pm. On the campus, it is also proposed to irrigate with reclaimed water at night in order to minimize risks to the public and because the sports fields are used during the day and the evening. The peak demand rates for options 2, 3 and 4 exceed the available effluent flow at night and equalization storage will be required. Equalization storage would be in addition to the 90 minute chlorine contact tank.

Table 3.2 shows the daily demand for reclaimed water. The maximum daily demand is for Option 4 at 4.300 ML/d. Table 3.3 lists the estimated total annual demand for reclaimed water. The annual demand is used in estimating the potential revenues for the sale of reclaimed water as discussed further in Section 5. The total annual demand from the golf courses is based on their current water consumption records.

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
 Effluent Reuse and Heat Recovery for the  
 University of Victoria and Surrounding Area

---

**Table 3.1 – Peak Demand for Reclaimed Water (L/s)**

	<b>Option 1 – UVic Only</b>	<b>Option 2 – UVic &amp; One Major Golf Course</b>	<b>Option 3 – UVic &amp; Two Major Golf Courses – One course with wells</b>	<b>Option 4 – UVic &amp; Two Major Golf Courses – No well water</b>
UVic Irrigation Demand	42	42	42	42
UVic Toilet Flushing Water Demand	3	3	3	3
Golf Course Water Demand	0	45	60	90
Schools, parks and other institutions	12	15	15	15
<b>Total Peak Demand</b>	<b>57</b>	<b>105</b>	<b>120</b>	<b>150</b>

**Table 3.2 – Daily Demand for Reclaimed Water (ML/d)**

	<b>Option 1 – UVic Only</b>	<b>Option 2 – UVic &amp; One Major Golf Course</b>	<b>Option 3 – UVic &amp; Two Major Golf Courses – One course with wells</b>	<b>Option 4 – UVic &amp; Two Major Golf Courses – No well water</b>
UVic Irrigation Demand	1.21	1.21	1.21	1.21
UVic Reclaimed Water Demand	0.06	0.06	0.06	0.06
Major Golf Course Water Demand		1.30	1.74	2.60
Schools, parks and other institutions	0.35	0.43	0.43	0.43
<b>Total Daily Demand</b>	<b>1.62</b>	<b>3.0</b>	<b>3.44</b>	<b>4.3</b>

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

**Table 3.3 –Annual Demand for Reclaimed Water (ML/y)**

	<b>Option 1 – UVic Only</b>	<b>Option 2 – UVic &amp; One Major Golf Course</b>	<b>Option 3 – UVic &amp; Two Major Golf Courses – One course with wells</b>	<b>Option 4 – UVic &amp; Two Major Golf Courses – No well water</b>
UVic Irrigation Demand	100.3	100.3	100.3	100.3
UVic Reclaimed Water Demand	20.7	20.7	20.7	20.7
Golf Courses Water Demand		83.3	121.1	166.6
Schools, parks and other institutions	22.2	27.7	27.7	27.7
Total Annual Demand	143.2	232	269.8	315.3

### 3.4 Availability of Reclaimed Water

The proposed SENOB tertiary sewage treatment plant will provide treatment for up to 1.75 times the average daily flow of 16.6 ML/d for the year 2030 and 17.2 ML/d for the year 2065.

However the current average annual flows in the SENOB drainage area average 9.5 ML/d.

Average monthly plant flows during the irrigation months of June to September are as follows:

June 2008	9,135 m <sup>3</sup> /day
July 2008	8,934 m <sup>3</sup> /day
August 2008	8,950 m <sup>3</sup> /day
September 2008	9,677 m <sup>3</sup> /day

As indicated in Table 3.2, the maximum daily irrigation demand varies from 1,600 to 4,300 m<sup>3</sup>/day. There is enough water to meet the demand.

However, all golf courses are irrigating at night between 10:00 pm and 6:00 am. The sports fields and lawn areas at the University of Victoria will also be irrigated at night because the sports fields are used in the evening and to minimize direct contact between the public and reclaimed water. The peak irrigation demand will therefore occur at night which is the time when the sewage flow is low. As indicated in Table 3.4, there is not enough sewage flow a night to meet the irrigation peak demand which occurs at the same time. Therefore, storage will be required. The storage volume required for the projected flows in 2012 and 2030 is shown in Table 3.5.

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
 Effluent Reuse and Heat Recovery for the  
 University of Victoria and Surrounding Area

---

**Table 3.4 – Hourly Sewage Flow Variations at Proposed SENOB plant (2009)**

<b>Time</b>	<b>Existing Hourly Flow (l/s)</b>	<b>Projected 2030 Hourly Flow (l/s)</b>
0:00	117	194
1:00	95	158
2:00	73	121
3:00	59	98
4:00	53	88
5:00	47	78
6:00	48	80
7:00	59	98
8:00	104	172
Daily Average	116	192
Option 1 Peak Demand	<b>57</b>	
Option 2 Peak Demand	<b>105</b>	
Option 3 Peak Demand	<b>120</b>	
Option 4 Peak Demand	<b>150</b>	

**Table 3.5 – Storage Volume to Meet Night Time Peak Irrigation Demand (m3)**

	<b>2012 Flows</b>	<b>2030 Flows</b>
Option 1 – UVic and Adjacent Schools	0	0
Option 2 – UVic, Adjacent Schools and one Golf Course	980	340
Option 3 – UVic, Adjacent Schools and Two Golf Courses supplemented by well water	1330	575
Option 4 – UVic, Adjacent Schools and Two Golf Courses with no well water	2400	1160

It may take several years before the reclaimed water system is fully developed and expanded to include golf courses. Equalization storage will not be required until the first golf course starts using reclaimed water. It is proposed to size the equalization on the basis of the projected 2030 sewage flows.

## Section 4 Effluent Reuse System Configuration

### 4.1 General

Following treatment in the MBR treatment plant, the treated filtered effluent would be directed to a flow splitting chamber. The portion of the flow to be used as reclaimed water would be disinfected with ultraviolet light followed by chlorination prior to discharge into the chlorine contact tank with a detention time of 90 minutes. The disinfected effluent would then flow into the equalization storage. High lift pumps would then pump the reclaimed water into a separate “purple pipe” distribution system. The flow splitting at the outlet of the treatment plant would be controlled by automated valves. The valve controlling the flow of reclaimed water would open as the water level in the equalization tank or pumping chamber drops. The disinfection system, the chlorine contact chamber, the equalization storage and the high lift pump station would all be located at the treatment plant.

The irrigation demand for golf courses is between 10:00 am and 6:00 pm. On the campus, it is also proposed to irrigate with reclaimed water at night in order to minimize risks to the public and because the sports fields are used during the day. Equalization storage is required when the irrigation water demand exceeds the sewage flow. Equalization storage is required for Option 2, 3 and 4.

### 4.2 Major Components of Reclaimed Water System

The sizing of the major components of a reclaimed water supply system is shown in Table 4.1. All the components except equalization storage are sized on the basis of the peak demands shown in Table 4.1. It should be noted that the difference in elevation between the plant and the campus of the University of Victoria and nearby golf courses is approximately 27 m. This high static head coupled with a pressure of 275 kPa at the customer’s lot line has resulted in the selection of large high lift pumps. The pumps are also sized for maximum velocity in the distribution system of 1.12 m/s. Equalization storage is not required for Option 1.

The preliminary layout for the reclaimed water distribution system is shown on the attached Figures 4.1 to 4.3. These layouts are based on the assumption that the SENOB plant will be located at the CRD owned site on Arbutus Road. The routing of distribution systems is designed to allow for future expansion. Since the irrigation demand for the University of Victoria is concentrated in the northwest portion of the campus, the reclaimed water pipe for Option 1 stops at the intersection of McKenzie Avenue and Gordon Head Road. The distribution system could be extended southerly on Gordon Head Road and easterly on Cedar Hill Cross Road. This would allow other areas of the campus to be connected as well as Henderson Park and a

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
 Effluent Reuse and Heat Recovery for the  
 University of Victoria and Surrounding Area

---

golf course. To allow for the future expansion of the reclaimed water distribution system, the 2 km long pipe from the plant to the intersection of McKenzie Ave and Gordon Head Road would have to be upsized from 250 mm to 400 mm diameter.

**Table 4.1 – Summary of Reclaimed Water System Components**

	<b>Option 1 – UVic &amp; Adjacent Schools</b>	<b>Option 2 – UVic &amp; One Major Golf Course</b>	<b>Option 3 – UVic &amp; Two Major Golf Courses – One course with wells</b>	<b>Option 4 – UVic &amp; Two Major Golf Courses – No well water</b>
System Capacity (l/s)	57	105	120	160
Chlorine Contact Chamber (m <sup>3</sup> )	310	570	650	865
Equalization Storage (m <sup>3</sup> )	0	340	575	1160
High Lift Pump Motor Size (HP)	120	200	250	250
Distribution System	300 mm; 2.0 km	350 mm; 2.0 km 250 mm; 2.3 km	400 mm; 2.0 km 300 mm; 0.9 km 250 mm; 1.4 km 150 mm; 2.2 km	400 mm; 2.0 km 350 mm; 0.9 km 350 mm; 1.4 km 250 mm; 2.2 km









## Section 5                      Opinion of Probable Costs for Effluent Reuse

### 5.1      Capital Cost

To enable completion of the triple bottom line assessment and to obtain an initial indication of capital cost for each of Options 1, 2, 3 and 4, cost estimates were prepared for each option. The basis of the estimates includes the following:

#### Direct Cost

- Capital construction cost
- Design and construction contingency costs at 25% of construction cost

#### Indirect Cost

- Engineering at 15% of direct cost
- Administration, project management and miscellaneous at 6% of direct cost

#### Financing Cost

- Interim financing at 4% of direct and indirect cost
- Inflation to midpoint of SENOB construction 2% per annum to 2011 (4%)

The capital cost is based on constructing distribution pipelines for reclaimed water in public road up to the property lines of the University and other institutions. The cost of extending the reclaimed water lines into the campus and to disconnect the numerous individual irrigation systems from the internal potable water system and to reconnect these to the reclaimed water system is not included in Table 5.1.

The capital cost estimates are based on locating the SENOB plant at or near a site owned by the CRD on Arbutus Road. The capital cost of the reclaimed water system would be reduced by \$1.5 million if the SENOB plant was built at the University of Victoria Field Site located on the north side of McKenzie Avenue near Gordon Head Road. However the cost of the SENOB plant would be approximately \$15 million higher as a result of the need to build a large pumping station and 1.5 km long forcemain to pump all the sewage from the trunk line on Haro Woods to the UVic Field Site and also to extend the outfall pipe by the same distance.

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

**Table 5.1 – Estimated Capital Cost**

	Option 1	Option 2	Option 3	Option 4
Description	University of Victoria Only	UVic & One Major Golf Course	UVic & Two Major Golf Courses	UVic & Two Major Golf Courses - No Well Water
Design Peak Flow	57 L/s	105 L/s	120 L/s	160 L/s
General Requirement	\$207,200	\$405,600	\$533,600	\$614,100
Chlorine Contact Chamber	\$210,000	\$360,000	\$400,000	\$475,000
High Lift Pumping Station:				
- Equalization Storage Tank	\$0	\$263,000	\$359,000	\$598,000
- Wet Well	\$120,000	Utilize Equalization Storage Tank	Utilize Equalization Storage Tank	Utilize Equalization Storage Tank
- Submersible Pumps	\$162,000	\$216,000	\$252,000	\$255,600
- Piping and Valves	\$200,000	\$250,000	\$300,000	\$320,000
Distribution System	\$980,000	\$2,467,000	\$3,424,900	\$3,882,600
Electrical Control & Instrumentation	\$250,000	\$300,000	\$350,000	\$360,000
Standby Power	\$150,000	\$200,000	\$250,000	\$250,000
<b>Total Construction Costs</b>	<b>\$2,279,200</b>	<b>\$4,461,600</b>	<b>\$5,869,500</b>	<b>\$6,755,300</b>
Design & Construction Contingencies (26% of Construction Costs)	\$569,800	\$1,115,400	\$1,467,400	\$1,688,800
<b>Subtotal - Direct Costs</b>	<b>\$2,849,000</b>	<b>\$5,577,000</b>	<b>\$7,336,900</b>	<b>\$8,444,100</b>
Indirect Costs (Engineering, Administration, Program Management, & Misc.) (20% of Direct Costs)	\$740,700	\$1,282,700	\$1,687,500	\$1,942,100
<b>Subtotal - Direct &amp; Indirect Costs</b>	<b>\$3,589,700</b>	<b>\$6,859,700</b>	<b>\$9,024,400</b>	<b>\$10,386,200</b>
Interim Financing & Inflation Allowance (8% of Above)	\$287,200	\$960,400	\$1,263,400	\$1,454,100
<b>Total Capital Costs</b>	<b>\$3,876,900</b>	<b>\$7,820,100</b>	<b>\$10,287,800</b>	<b>\$11,840,300</b>

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### 5.2 Operating and Maintenance Cost

Table 5.2 provides the operations and maintenance costs for each option.

**Table 5.2 – O&M Costs**

	<b>Option 1 – UVic Only</b>	<b>Option 2 – UVic &amp; One Major Golf Course</b>	<b>Option 3 – UVic &amp; Two Major Golf Courses – One course with wells</b>	<b>Option 4 – UVic &amp; Two Major Golf Courses – No well water</b>
Annual O & M Costs	\$70,500	\$102,400	\$128,400	\$141,500

### 5.3 Projected Revenues

The District of Saanich current water rates are \$1.05/m<sup>3</sup>. This amount does not include the sewer surcharge. The golf courses located in the District of Oak Bay are being charged a bulk rate for water of \$0.55/m<sup>3</sup>. It was suggested in earlier studies that an incentive pricing of \$0.72/m<sup>3</sup> be used for reclaimed water. However, this is higher than the bulk rate in Oak Bay. It appears that the bulk rate in Oak Bay is equivalent to the cost of purchasing water from the Capital Regional District. Table 5.3 shows the projected revenues based on the rates of \$1.05/m<sup>3</sup>, \$0.72/m<sup>3</sup> and \$0.55/m<sup>3</sup>.

**Table 5.3 – Projected Revenues from Reclaimed Water**

	<b>Option 1</b>	<b>Option 2</b>	<b>Option 3</b>	<b>Option 4</b>
Estimated Annual Reclaimed Water Consumption (ML/Y)	143	232	270	315
Estimated Revenues at \$1.05/m <sup>3</sup>	\$150,100	\$243,600	\$283,500	\$330,800
Estimated Revenues at \$0.72/ m <sup>3</sup>	\$103,000	\$167,000	\$194,400	\$226,800
Estimated Revenues at \$0.55/ m <sup>3</sup>	\$76,700	\$127,600	\$158,500	\$173,300

It should be noted that the Cedar Hill golf course presently obtains two-thirds of their irrigation water from wells. The estimated revenues of Option 4 are based on the assumption that the water wells will be discontinued. Since the bulk water rate in the District of Oak Bay is significantly less than the water rates in the District of Saanich and other municipalities, it is proposed to use a water rate of \$0.72 /m<sup>3</sup> when estimating revenues from the sale of reclaimed water.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### 5.4 Business Case and Market Considerations

A summary of capital cost, O&M cost and revenues based on a reclaimed water rate of \$0.72/m<sup>3</sup> is shown in Table 5.4. The use of reclaimed water will cause a corresponding drop in the usage of potable water. The CRD sells potable to the municipalities at a rate of \$0.544/m<sup>3</sup>. The net profit/loss from the sale of reclaimed water is the difference between the sales of reclaimed water and the revenues lost from the sale of potable water. As indicated in Table 5.4, if the reclaimed water is sold at \$0.72/m<sup>3</sup> there would be a net operating loss when taking into account the lost revenues from the sale of treated water. In order to cover the operating expenses and avoid a loss, reclaimed water should be sold at the same rate as potable water.

**Table 5.4 – Summary of Cost and Revenues**

	Capital Cost	Annual O&M Cost	Revenues from the sale of reclaimed water (\$0.72/m <sup>3</sup> )	Lost revenues from sale of treated water CRD (\$0.543/m <sup>3</sup> )	Operating Loss
Option 1	\$3,721,900	\$70,500	\$103,000	\$77,700	- \$45,200
Option 2	\$7,190,300	\$102,400	\$167,000	\$126,000	- \$61,400
Option 3	\$9,777,000	\$128,400	\$194,400	\$146,600	- \$80,600
Option 4	\$11,544,000	\$141,500	\$226,800	\$171,000	- \$85,700

Discussions were held with the three golf courses located within 5 km of the proposed SENOB plant. The golf courses did not express an interest in using reclaimed water for effluent for various reasons including (1) one golf obtains two-third of their irrigation water needs from wells, (2) negative public perception, (3) concerns that sodium in the reclaimed water could affect the quality of the greens, (4) public health danger posed by players walking on wet grass that has been recently irrigated with reclaimed water.

The other significant marker consideration would be to enter into long term agreement with potential customers of reclaimed water. Considering the high capital cost of a reclaimed water system coupled with no net revenues, agreements with a duration of 10 years or more should be negotiated with the customers.

## **Section 6**                      **Triple Bottom Line Analysis for Effluent Reclamation**

### **6.1 Methodology**

CRD has adopted the Triple Bottom Line (TBL) evaluation approach to provide the basis for selection of the preferred alternative. By understanding the economic, environmental and social implications of the alternatives that are reflective of the community values, the most long term sustainable decisions can be made.

Economic impacts are the direct costs to a public agency that are traditionally associated with an economic analysis. Capital costs and reclaimed water revenues are considered as well as ongoing operations and maintenance costs. Environmental costs are the environmental implications of an agency's actions that customers place value on. Examples include reduction in suspended solids discharge to the ocean resulting from the diversion of effluent to irrigation with reclaimed water. Social costs, like environmental costs, are indirect costs to the community. An example of this is the inconvenience of traffic delays caused by construction. The utility does not directly pay for the "cost" of traffic but its customers place a value on avoiding unnecessary traffic delays.

This chapter outlines the triple bottom line analysis that was used to evaluate the four options for a reclaimed water system in the area surrounding the proposed SENOB plant. A complete listing of impacts included in the model sorted by the three categories is provided in Table 6.1.

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

**TABLE 6.1: Impacts Evaluated for Triple Bottom Line Analysis**

Criteria Group	No.	Criteria Categories	Measure Description
<b>Economic</b>	<b>EC-01</b>	Capital Costs	Construction cost and markup for soft costs adjusted to midpoint of construction
	<b>EC-02</b>	Capital Costs Eligible for Grants	Not available at this time
	<b>EC-03</b>	Loss of Water Revenue	Loss of water revenue by local municipality
	<b>EC-04</b>	Present Worth of Net O&M Costs	O&M costs
	<b>EC-05</b>	Flexibility for Future Expansion	Cost to upsize piping to allow for future expansion of reclaimed water piping
	<b>EC-06</b>	Flexibility to Accommodate Future Regulations	Additional space needed versus available to meet potential regulations
<b>Environmental</b>	<b>EN-01</b>	Carbon Footprint	Tons of eCO2 created
	<b>EN-02</b>	Water Reuse Potential	Potential demands in megaliters per year
	<b>EN-03</b>	Power (energy) usage	kilowatt hours per year consumed
	<b>EN-04</b>	Transmission Reliability	Risk cost of pump station and distribution piping failure
	<b>EN-05</b>	Reduction Pollution Discharge	Reduction in pollutants discharged to ocean by reuse of effluent
	<b>EN-06</b>	Non-renewable Resource Use	Gallons of diesel consumed per year
	<b>EN-07</b>	Terrestrial effect	Restoration of forest habitat disturbed by reservoir construction
<b>Social</b>	<b>SO-01</b>	Impact of Property Values	Perception of lost value to current property owners abutting properties to be irrigated with reclaimed water
	<b>SO-02</b>	Construction Disruption	Cost of traffic inconvenience due to construction
	<b>SO-03</b>	Public and Stakeholder Acceptability	Lost time due to public disapproval
	<b>SO-04</b>	Loss of Beneficial Site Uses	Loss of park land due to storage tank construction
	<b>SO-05</b>	Cultural Resource Impacts	Risk cost of a cultural site find



## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

## 6.2 Placing Value on Factors

### 6.2.1 Economic Impacts

#### EC-01 Capital Costs

Capital costs measure the construction cost and soft costs for each option escalated to the midpoint of construction. Data input included the estimated construction cost and a 2011 midpoint of construction. Assumptions included an inflation rate of 3%. The scoring for capital costs was scaled based on the NPV of costs for all three options with an NPV of \$8 million worth three points, higher NPVs worth fewer points, and lower NPVs worth more.

#### EC-02 Capital Costs Eligible for Grants

This impact was intended to measure the value of grants to offset construction costs but at this time, insufficient information is available to adequately account for this impact.

#### EC-03 Utility Revenue Implications

The construction of a reclaimed water distribution system will reduce water consumption resulting in loss of revenues from the sale of water by the municipalities. The annual cost of lost utility revenues was calculated by multiplying the potential annual reclaimed water consumption by the local area municipality water rate. A qualitative 1 to 5 score was scaled based on the cost of lost utility revenue as shown below.

EC-03 Scoring:	
1	Over \$250,000
2	\$200,000 to \$250,000
3	\$150,000 to \$200,000
4	\$100,000 to \$150,000
5	Less than \$100,000

#### EC-04 Present Worth Costs

Present worth included annual expenditures for operations and maintenance (O&M) and for replacement and refurbishment (R&R) projects. Data input included annual O&M and R&R costs. Assumptions included a 3% rate of inflation for each annual cost. The scoring was scaled based on the annual costs, with an annual cost of \$3.9 million worth 3 points, a higher annual cost worth fewer points, and lower annual costs worth more.

#### EC-05 Flexibility for Future Expansion

This impact was intended to measure the flexibility of each option to allow for expanding the reclaimed water distribution system. To measure this, the additional cost of upsizing the distribution piping of each option to the potential maximum demand was calculated. The cost for additional piping cost was scored using the following scale.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

EC-05 Scoring:	
1	More than \$750,000
2	\$500,000 to \$750,000
3	\$250,000 to \$500,000
4	0 to \$250,000
5	No cost

### 6.2.2 Environmental Impacts

#### EN-01 Carbon Footprint

The energy consumption for pumping reclaimed water into the distribution system was calculated and the greenhouse gas produced was estimated on the basis of 0.000072 g CO<sub>2</sub>e/kw-hr. Scoring was based on the cost of carbon dioxide emitted (assuming \$25 per tonne) using the following scale.

EN-01 Scoring:	
1	More than \$4,500
2	3,500 to \$4,500
3	\$2,500 to \$3,500
4	\$1,500 to \$2,500
5	Less than \$1,500

#### EN-02 Water Reuse Potential

Water reuse potential was a measure of potable water that could be replaced by reclaimed water. The potential volume of reclaimed water produced, a \$0.72/cubic meter cost of water, and a 0.38% growth rate were the data inputs. A 3% inflation in water costs was assumed. The NPV for each option was calculated and compared using the following scale.

EN-02 Scoring:	
1	Less than \$2 million
2	\$2 to \$4 million
3	\$4 to \$6 million
4	\$6 to \$8 million
5	More than \$8 million

#### EN-03 Power (Energy) Use

This impact compared the electrical energy usage for each option. Data input included annual power consumption and a \$0.08/kW-hr cost of power. Assumptions included a 3% rate of inflation for power costs. The NPV for electrical costs was calculated for each option and then scaled as follows.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

<b>EN-03 Scoring:</b>	
1	More than \$250,000
2	\$200,000 to \$250,000
3	\$150,000 to \$200,000
4	\$100,000 to \$150,000
5	Less than \$100,000

### EN-04 Transmission Reliability

This impact measure the relative risk carried for each option in terms of a conveyance failure. Data inputted was the volume of reclaimed water pumped and the length of piping. Each option was compared by multiplying the volume pumped by the distance pumped. A \$0.25 risk cost per ML-km/day was assumed and a NPV was calculated. The following 1 to 5 score scale was used.

<b>EN-04 Scoring:</b>	
1	More than \$250,000
2	\$200,000 to \$250,000
3	\$150,000 to \$200,000
4	\$100,000 to \$150,000
5	Less than \$100,000

### EN-05 Pollution Reduction

Pollution reduction measured the mass volume of total suspended solids (TSS) in the effluent that is diverted from the ocean by reusing reclaimed water. TSS concentration and average dry weather design flows were included as data input. A \$1/kg cost for solids discharged was assumed and a NPV was calculated. The following 1 to 5 scale was used to compare the three options.

<b>EN-05 Scoring:</b>	
1	More than \$60,000
2	\$45,000 to \$60,000
3	\$ \$30,000 to \$45,000
4	\$15,000 to \$30,000
5	Less than \$15,000

### EN-06 Non-Renewable Resource Use

This impact measured diesel fuel consumption during construction and operations. Diesel consumption during construction was assumed to be 2% of construction costs and diesel consumption during operations was assumed to be 2% of O&M costs. Therefore, data inputted was construction costs and O&M costs. A 3% inflation rate was assumed and a NPV was calculated for each option. The options were scored using the scale below.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

<b>EN-06 Scoring:</b>	
1	More than \$250,000
2	\$200,000 to \$250,000
3	\$150,000 to \$200,000
4	\$100,000 to \$150,000
5	Less than \$100,000

### EN-07 Terrestrial Habitat Impacts

This measure was intended to measure the impact that the storage reservoir would have on existing terrestrial habitats assuming that the plant is constructed in the forested area of Haro Woods. The area required for the storage tanks was calculated and relative 1 to 5 score was given based on the potential mitigation cost for the area impacted assuming that a 15 m strip around the reservoir would have to be replanted with trees. The following scale was used.

<b>EN-07 Scoring:</b>	
1	More than \$65,000
2	\$50,000 to \$65,000
3	\$35,000 to \$50,000
4	\$20,000 to \$35,000
5	Less than \$20,000

### 6.2.3 Social Impacts

#### SO-01 Impact on Property Values

Lost values for existing private properties are not expected but a perception of lost value constitutes a social cost. This impact was measured by assuming that the parcels that are abutting each site irrigated with reclaimed water would be perceived to lose 1% of an assumed average value of \$500,000. The societal impact was calculated by multiplying the number of parcels that were impacted by \$5,000 and scored as shown below.

<b>SO-01 Scoring:</b>	
1	More than \$1 million
2	\$750,000 to \$1 million
3	\$500,000 to \$750,000
4	\$250,000 to \$500,000
5	Less than \$250,000

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### SO-02 Construction Disruption

Traffic during construction can be particularly noisome to neighboring residents and businesses. To measure this disruption, the volume of traffic potentially impacted by reclaimed water storage construction was estimated by using traffic counts at nearby intersections for each site. These traffic counts came from CRD's 2005 evaluations. The number of construction trips was calculated by estimating one construction trip per day for every \$2,500 of construction budget. The traffic count was multiplied by the daily construction traffic at each site and a plant construction disruption cost was calculated assuming a \$1 cost per trip delayed, a 1% probability of delay due to construction and a 6 month construction period.

For conveyance construction, the number of kilometers of pipe was used to estimate the number of trips delayed. The conveyance construction cost was calculated by multiplying the length of pipe by the traffic count as well as assuming a \$2 cost per trip delayed, a 50% probability of delay, and a 4 month construction schedule. The plant and conveyance construction disruption costs were added together and a qualitative 1 to 5 score was then given as shown below.

<b>SO-02 Scoring:</b>	
1	More than \$500,000
2	\$375,000 to \$500,000
3	\$250,000 to \$375,000
4	\$125,000 to \$250,000
5	Less than \$125,000

### SO-03 Public and Stakeholder Acceptability

Delays caused by public disapproval could be costly during the construction period. A delay was assumed for each site for each option and the construction cost was delayed by that number with a 3% inflation rate. A 25% probability of delay was assumed at each site and thus the risk of delay costs were compared for each option using the following scale.

<b>SO-03 Scoring:</b>	
1	More than \$80,000
2	\$60,000 to \$80,000
3	\$40,000 to \$60,000
4	\$20,000 to \$40,000
5	Less than \$20,000

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### SO-04 Loss of Beneficial Site Use

The construction of storage tanks for reclaimed water may preclude the use of the site as an open space or park land. To measure this impact, the number of hectares of potential park or open space lost due to plant siting was estimated and an assumption of a \$1,000,000 per hectare incremental value for using the site as a park instead of a treatment facility was assumed. The scale used to compare options is presented below.

<b>SO-04 Scoring:</b>	
1	More than \$50,000
2	\$30,000 to \$40,000
3	\$20,000 to \$30,000
4	\$10,000 to \$20,000
5	Less than \$10,000

### SO-05 Cultural Resource Impacts

A cultural resource find would cause additional cost and delay to site construction. The probability of a cultural find for each site and the resulting delay were estimated along with the estimated construction cost. An assumed 3% inflation rate was used to quantify the delay cost of a cultural find. By multiplying the delay cost by the probability of a find, the risk cost of a cultural find was calculated for each option and compared using the following scale.

<b>SO-05 Scoring:</b>	
1	More than \$25,000
2	\$15,000 to \$20,000
3	\$10,000 to \$15,000
4	\$5,000 to \$10,000
5	Less than \$5,000

Table 6.2

Triple Bottom Line Analysis for Reclaimed Water

Criteria Group	No.	Criteria Categories	Measure Description	Weight	Option Results			
					1	2	3	4
Economic	EC-01	Capital Costs	construction cost and markup for soft costs adjusted to midpoint of construction	8	5.0	3.0	2.3	1.9
	EC-02	Capital Costs Eligible for Grants	Not available at this time	-				
	EC-03	Utility Revenue Implications	Loss of water revenue by local municipalities	1.33	4	3	2	1
	EC-04	Present Worth of O&M costs	O&M costs	8	5	3	3	2
	EC-05	Flexibility for Future Expansion	Cost to upsize piping to allow for future expansion of reclaimed water piping	1.33	1	2	3	4
<b>Economic Subtotal (100 pts max)<sup>1</sup>:</b>					<b>83</b>	<b>55</b>	<b>45</b>	<b>40</b>
Environmental	EN-01	Carbon Footprint	Tons of eCO2 created	2.86	4	3	2	2
	EN-02	Water Reuse Potential	Potential demands in megaliters per year	2.86	2	4	4	5
	EN-03	Power (energy) usage	kilowatt hours per year consumed	2.86	4	3	2	2
	EN-04	Transmission Reliability	Risk cost of pump station and distribution piping failure	2.86	5	3	2	2
	EN-05	Reduction in Pollution Discharge	Reduction in pollutants discharged to ocean by reuse of effluent	2.86	2	3	4	5
	EN-06	Non-renewable Resource Use	Gallons of diesel consumed per year	2.86	4	3	2	1
	EN-07	Terrestrial Habitat Effect	Restoration of forest habitat disturbed by reservoir construction	2.86	5	4	2	1
<b>Environmental Subtotal (100 pts max):</b>					<b>74</b>	<b>66</b>	<b>51</b>	<b>51</b>
Social	SO-01	Impact of Property Values	Perception of lost value to current property owners abutting properties to be irrigated with reclaimed water	4	5	4	1	1
	SO-02	Construction Disruption	Cost of traffic inconvenience due to construction	4	4	3	1	1
	SO-03	Public and Stakeholder Acceptability	Lost time due to public disapproval	4	4	3	1	1
	SO-04	Loss of Beneficial Site Uses	Loss of park land due to storage tank construction	4	5	4	2	1
	SO-05	Cultural Resource Impacts	Risk cost of a cultural site find	4	5	4	3	3
<b>Social Subtotal (100 pts max):</b>					<b>92</b>	<b>72</b>	<b>32</b>	<b>28</b>
<b>TOTAL SCORE (300 pts max):</b>					<b>249</b>	<b>193</b>	<b>129</b>	<b>122</b>

## Section 7 Discussions and Recommendations

### 7.1 Summary of Reclaimed Water Options

Four options were investigated for a reclaimed water distribution system in the vicinity of the SENOB plant. Most of the demand for reclaimed water is for irrigation and most of the existing irrigation systems that would use reclaimed water are using spray irrigation. These include parts of the campus of the University of Victoria, adjacent schools and institutions and golf courses. Reclaimed water could also be used for toilet flushing in future institutional buildings on the campus of the University of Victoria.

#### Storage and Disinfection

Because these areas are open to the public, high quality filtered and disinfected reclaimed water would minimize health risks. The proposed SENOB plant will consist of a state-of-the-art ultrafiltration membrane bioreactor (MBR) plant. This process produces the highest effluent quality in terms of suspended solids and BOD of all the treatment processes. Also, the small pore sizes of the ultrafiltration membrane remove a large proportion of micro-organisms. One of the biggest issues facing the use of reclaimed water for spray irrigation is the current requirements of the Municipal Sewage Regulation to provide a minimum of 2 days of storage time. However as indicated in the MSR Policy Intentions Paper, this requirement will be eliminated provided the plant is designed with multiple units such that the effluent requirements can be met with one unit out of service. To ensure that the effluent is properly disinfected, it is proposed to provide a chlorine contact time with a minimum detention time of 90 minutes and to provide two barriers by adding UV disinfection prior to chlorination.

In addition to the chlorine contact chamber, equalization storage will be needed since irrigation takes place at night between 10:00 PM and 6:00 AM. Current nighttime sewage flows are lower than the combined peak irrigation demand for the University of Victoria and golf courses. The equalization storage would follow the chlorine contact chamber.

Also as discussed in Part B of the report, equalization storage is proposed in order to extract heat from effluent during the early morning period when low flows occur at the time of peak heating demand. Equalization storage would provide a benefit in the summer during nighttime peak irrigation demand and in the winter during early morning peak heating demand.

#### System Configuration

Following treatment and storage, high lift pumps would pump the reclaimed water into a separate purple pipe distribution system. There is a difference in elevation of approximately 27 metres between the sewage treatment and the plateau where the University and adjacent golf



## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

course is located. As a result, the high lift pumps motor size exceeds 100 HP. The reclaimed water distribution system is designed to provide a pressure of 275 kPa at the point of use.

Option 1 has the smallest capital cost because it services customers located near the proposed plant, namely the University of Victoria and surrounding institutions, and includes 2 km of piping. Equalization storage is not required with Option 1. Option 2, which includes a golf course adjacent to the University, requires 4.3 km of piping and an equalization tank. Options 3 and 4 both include 6.5 km of piping in order to service the Cedar Hill golf course and require larger pumps and reservoirs.

### Revenues

The reclaimed water system straddles two municipalities with different pricing for large water users. The incentive pricing of \$0.72/m<sup>3</sup> that was proposed earlier is lower than the water rate of \$1.05/m<sup>3</sup> in Saanich but is higher than the bulk water rate of \$0.55/m<sup>3</sup> in Oak Bay. This factor mitigates against extending the reclaimed water system into the Municipality of Oak Bay since it would reduce revenues from reclaimed water by 30%. In order for the revenues to cover the operating and maintenance expenses, reclaimed water should be sold at a roughly the same price as potable water.

### Triple Bottom Line Assessment

A value-based triple bottom line evaluation has been completed. Equal total weighting has provided a value for social, environmental and economic factors. The results of the TBL indicate the following relative scores:

**Table 7.1 – Summary of Triple Bottom Line**

	<b>Option 1</b>	<b>Option 2</b>	<b>Option 3</b>	<b>Option 4</b>
<b>Economic</b>	<b>83</b>	<b>55</b>	<b>45</b>	<b>40</b>
<b>Environmental</b>	<b>74</b>	<b>66</b>	<b>51</b>	<b>51</b>
<b>Social</b>	<b>92</b>	<b>72</b>	<b>32</b>	<b>28</b>
<b>Total</b>	<b>249</b>	<b>193</b>	<b>128</b>	<b>119</b>

Option 1 offers the lowest capital cost and equalization storage is not required. Options 2, 3 and 4 require significantly more piping and larger pumps.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### 7.2 Conclusions – Reclaimed Water Reuse

Reclaimed water has been used in many other jurisdictions including California and Arizona where water resources are limited. In these areas reclaimed water is a viable option to offset irrigation water demands. There is also a long history of using reclaimed water for spray irrigation in the BC Interior in communities such as Kamloops, Vernon and Osoyoos. On Vancouver Island, reclaimed water is used for irrigation at the Morningstar golf course near Parksville. In many instances use of reclaimed water is driven by a shortage of water resources and climatic conditions.

In the Greater Victoria area the irrigation season is short at approximately 4-5 months. In the District of Saanich, where the University of Victoria gets its water, the rate is \$1.05/ m<sup>3</sup>. However the District of Oak Bay bulk water rate to golf courses is \$0.55/m<sup>3</sup>. This bulk water rate does not provide any incentive for current users to consider the use of reclaimed water by potential users. Policy changes and education programs would be required to promote the use of reclaimed water. When the current and proposed MSR regulatory and public health requirements are considered for the situation at UVic grounds, there is limited area that can be irrigated.

All four options provide for varying volume of reuse of reclaimed water mainly by the use of spray irrigation in urban areas. Public acceptability needs to be established and starting with Option 1, which provides for irrigation on the University of Victoria campus and adjacent institutions, would provide the opportunity for a demonstration project and public education.

The capital cost of a reclaimed water supply and distribution system to supply the University of Victoria and adjacent institution is estimated at \$3.9 million. This amount does not include the work on private property to extend the reclaimed water lines to connect with the irrigation system. There are several reasons why the capital costs are high:

- The reclaimed water must be pumped in separate pipelines over a 30 m difference in elevation.
- The length of the transmission mains ranges from 2 km for Option 1 to 6.5 km for Options 3 and 4 adding to the cost;
- The regulation specifies that for all areas, direct public contact with reclaimed water must be minimized. The regulation also spells out there shall be no direct contact between the reclaimed water and any persons on parks, playground and school grounds. As a result of these restrictions, the irrigable area of the campus by approximately by two-thirds so only one third of the campus can be considered for irrigation and this significantly reduces the water demand and potential revenues.

A reclaimed water system would provide social and environmental benefits such as promoting public awareness of water conservation and reducing the effluent discharge into the ocean during the summer months. There are no financial benefits since the annual revenues will only

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

cover the annual O&M and the corresponding loss of revenues from the sale of treated water. This assumes that reclaimed water is sold at the same price as potable water. If reclaimed water is sold at a lower price, there would be an annual operating loss. None of the capital cost of the water reclamation system would be recovered by the revenues.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

## **PART B**


# Section 8            Examples of Heat Recovery Systems

The following are examples of a district energy systems and /or heating system using heat from extracted from treated effluent.

### Okanagan College

There are existing operating systems and projects that utilize treated effluent water as a source for heat pumps. One such example is Okanagan College's Clearwater system, designed by Stantec in 2002.

Okanagan College's KLO Campus is located in Kelowna, BC, and was retrofitted with a heat pump heating system that utilizes treated effluent water from the adjacent City of Kelowna Wastewater Treatment Facility. The "Clearwater" system was first operational in 2003/2004, and is used to provide about 40% of the peak heating demand for the campus.

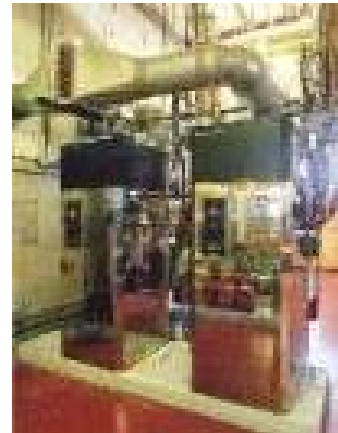

The Clearwater system utilizes a small fraction of the available City of Kelowna wastewater flow. About 600 US Gallons Per Minute (USGPM) of treated effluent water are drawn from a pipeline that flows at approximately 13,000 USGPM, thus lowering the temperature of the discharged effluent by only 0.47°F. The heat pumps in the Clearwater system provide heat to approximately 400,000 ft<sup>2</sup> of campus buildings, and distributes that heated water through existing underground insulated district heating piping.

### Kelowna Wastewater Treatment Maintenance Building

A second example of treated effluent heat recovery utilizing heat pump technology is the City of Kelowna's Wastewater Treatment Facility new Maintenance Building. The new building is targeting LEED™ Silver registration, and one of the main components of the facility's energy reduction system is the heating and cooling systems that utilize heat pumps connected to treated effluent water.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

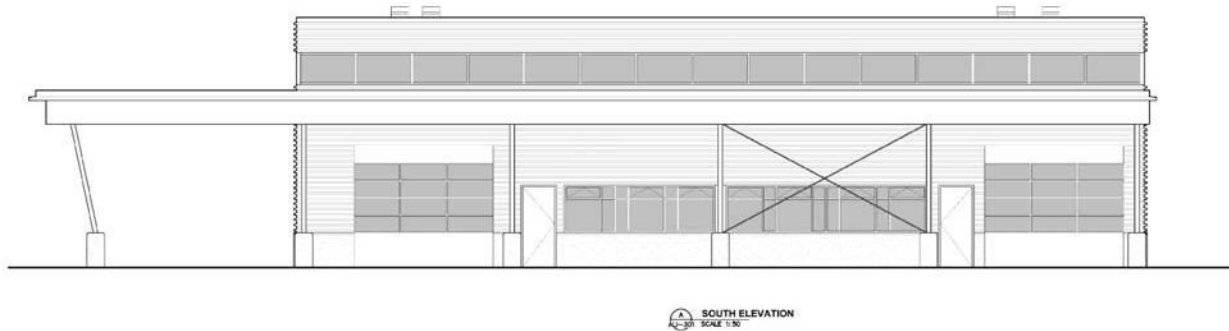


Image: Rendering of the City of Kelowna WWTF Maintenance Building

### Okanagan Centre for Learning

A third example of treated effluent heat recovery is Okanagan College's new Centre for Learning. This new facility is targeting LEED™ Gold registration, and incorporates a heat pump heating and cooling system that is connected to receive treated effluent water from the City of Kelowna's Wastewater Treatment Facility. The Centre for Learning building has been operating since mid 2009.

The Okanagan College Clearwater system is an example of an "ambient" temperature district heating system. The Clearwater system currently has two main usage points or customers. The main usage is through the College's Central Heating Plant Building that houses the heating boilers and heat pumps for the main campus, and the second usage is for the new Centre for Learning Building, where new heat pumps and treated effluent heat exchangers are installed.

The ambient distribution system utilizes purple pigmented non-potable AWWA C900 Class 150 PVC piping with push on bell and spigot joints. C900 piping is commonly utilized in municipal water works distribution piping, although it is coloured bright blue for that application. Piping for distribution of the treated effluent water is pigmented with purple dyes, and is marked "Non-potable" along the spine of the piping, with the spine turned upward in the trench during underground installation to ensure that it cannot be mistaken for potable water piping during later excavation.

The purple PVC piping is installed in the same manner as conventional water works piping, utilizing common excavation, installation and backfilling methods, and is installed below the frost level without external insulation.

The treated effluent water is piped to utility customers using the C900 piping, where a heat exchanger separates the treated effluent water from the customer's closed loop piping systems.

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### Whistler Athlete's Village

The Whistler Athlete's Village district energy system consists of a two pipe closed loop energy system operating at ambient temperature and using heat extracted from the Whistler WWTP as the primary source of energy. The secondary source of energy consists of natural gas boiler. The source of gas would be either the landfill or natural gas. The secondary source is required to maintain the capacity of the DES when the effluent flow and temperature are inadequate.

The district energy system is designed to provide 70% of the peak building load. Electric duct heaters will be installed within the buildings to provide standby heat and will also be sized to meet approximately 70% of the peak building load. As such, the electric duct heaters would more than adequately supplement the DES to meet both peak demand and any upset operating conditions. The supplemental heat provided by the duct heaters will only be required for short periods during the coldest weather. The system also has back up natural gas fired boilers which can be used to provide additional supplemental heat as necessary to the loop.

### Saanich Peninsula STP Thermal Energy Recovery

The proposed district energy sharing system will be a dual pipe closed loop with the supply water temperature into the loop between 11<sup>o</sup>C and 30<sup>o</sup>C. Plate heat exchangers located at the sewage treatment plant will inject heat into the system. The effluent will be pumped through the primary side the heat exchangers and the liquid will be circulated into the system using VFD controlled water pumps.

Each building that is connected to the system will require a heat pump to increase the water temperature. The heat pumps at each point of use will be located either in separate enclosures within the building if the mechanical room is large enough. The heat pumps will be integrated with the existing systems so that, should the heat pump system fail, the existing mechanical systems within the buildings would keep operating effectively.

The main users for the recovery heat will be the Panorama Recreation Centre and the Saanich Peninsula sewage treatment plant. These will have externally located metal enclosures containing heat pumps. Pumping and controls will be arranged such that both heat sources complement each other. If the rink refrigeration system can produce warmer water than the effluent, then part of the DES will be allowed to rise in temperature to improve the efficiency of the nearby heat pumps. The system may be extended into residential areas at a later date.

## Section 9 Heat Analysis

### 9.1 District Heating Using Effluent

District heating using secondary effluent has been practiced at a number of locations in Europe and is now being considered by some municipalities in North America. One of the main drivers of the use of reclaimed heat in Europe has been higher power and energy costs than is the case in North America. The assessment of using reclaimed heat is specific for every situation and must be investigated for the local conditions and circumstances for where it is being considered. If reclaimed heat can be used it has the potential to provide significant carbon offsets in comparison to the use of natural gas.

### 9.2 Available Heat & Heat Demand at University of Victoria

The existing average daily sewage flow at the proposed Saanich East/North Oak Bay SENOB sewage treatment plant is 9.6 ML/d. Based on this flow, the total annual heat available is 146,346 GJ/yr. Heat losses through a transmission system operating at 82°C are estimated at 8% leaving 134,638 GJ of available heat for the entire year. It should be noted however that the majority of the heat demand will be required in the winter heating season and domestic hot water on a year-round basis. The sewage flows are projected to increase substantially to 16.6 ML/day for 2030 and 17.2 ML/day for 2065. This increases the year-round available heat to 253,056 GJ and 262,203 GJ respectively. The amount of saleable heat is estimated at 70% of the available heat since space heating is not required for the summer months though domestic hot water, which sources from the University's district heating system (DHS), is required year-round at UVic.

**Table 9.1 – Estimated Saleable Heat from SENOB STP (GJ/yr)**

Year	Total Annual Heat Available	Estimated Saleable Heat	Demand
2009	146,346	94,250	211,762
2030	253,056	162,970	243,500*
2065	262,203	168,800	280,000*

\* Assuming status quo consumption practices with growth projections

The estimated heat available from treated effluent is based on the following assumptions:

- The minimum temperature of treated effluent of 12 C. This is based on temperature data from the CRD Saanich Peninsula sewage treatment facility.
- Allowable minimum temperature of effluent of 5 C prior to ocean discharge.

The University of Victoria is one the largest potential customers for heat in the Greater Victoria area. In addition, there are several schools and institutions in the vicinity of the University of

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

Victoria, which are potential customers for a district energy system. Based on existing boiler capacity, the heat demand for space heating and domestic hot water at the University of Victoria is 203,360 GJ/yr. This estimation from boiler power is confirmed by gas bill data indicating gas consumption at 211,762 GJ/yr. When this demand is compared with the estimated saleable heat shown in Table 9.1, it can be seen that based on current sewage flows, the saleable heat is less than 50% of the existing annual demand. At the estimated 2030 sewage flow, the available heat is approximately 67% of the demand. Because of the limited supply of heat, long conveyance distances and proportionally small demand, it is proposed not to consider the heat demand of adjacent schools and institutions.

A more critical detailed analysis has been performed on the flow data and “heating power” demand. This was undertaken due to concerns over the significant diurnal variations in the amount of heat that may be available from wastewater throughout the day. The hour to hour variations in sewage flow and therefore the available heat are shown in Figure 9.1. As can be seen, sewage flows from midnight until 8:00 am are low, with the lowest flow occurring around 5 AM. This limits the supply of heat at a critical time in the early morning where major building heating systems begin to ramp up to satisfy the major occupancy demand.


Figure 9.1 also shows the hourly variations in heat demand for the DHS for the entire UVic campus. The heating systems go into set-back mode between the hours of 8pm - 5am. This is when demand is at its lowest. At approximately 5 – 6 am, there is a sharp spike in demand as the boilers ramp-up to heat the buildings for the students and staff arriving between 7 and 9 am. The system reaches a daytime equilibrium and then drops in the evening. Unfortunately, the morning peak heating demand occurs while the sewage flows are still low. This situation is the reverse to what would be optimal, where supply would lead demand.



## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

### Saanich (UVic)

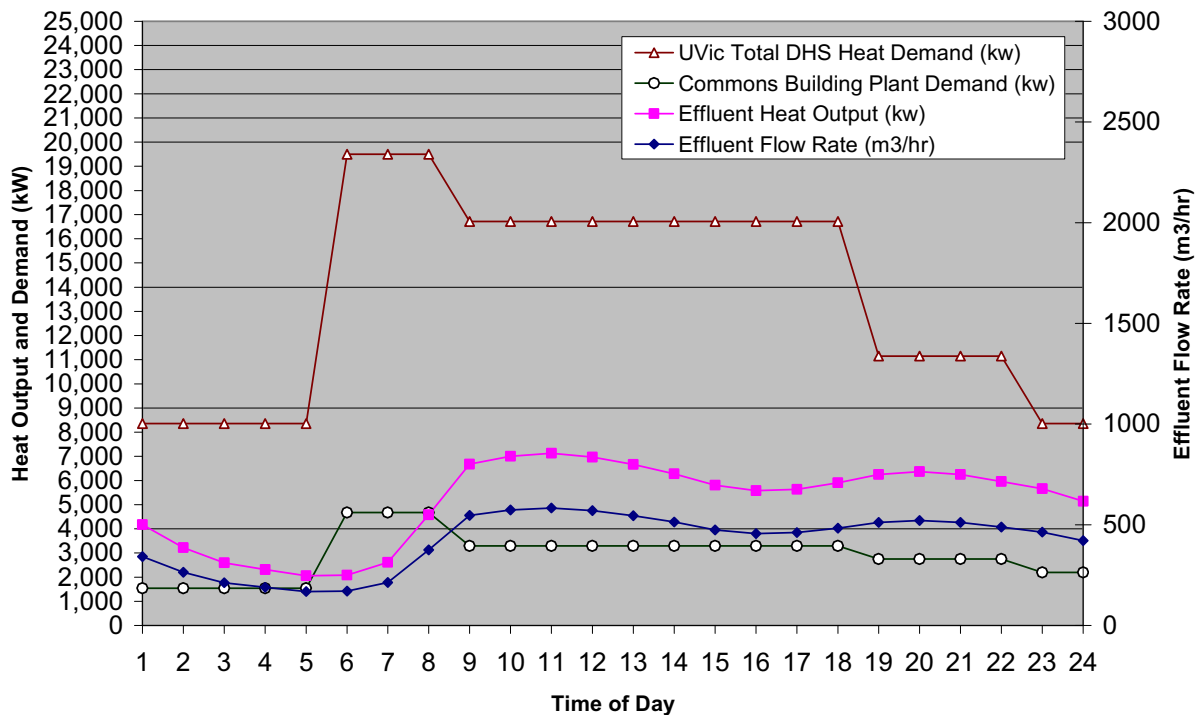

**Figure 9.1 – Hourly Supply / Demand Relationship for the University of Victoria (2009)**

Even at the 2030 average day flow of 16.6 ML/d, the heat output from treated effluent would be approximately 8,000 KW. This is still insufficient to meet the heat demand of the UVic campus and would only be capable of providing about 50% of the base daytime demand.

As discussed in subsequent sections, the proposed approach is to examine options to service a portion of the campus' heat demand. The heat demand for space heating and domestic hot water is normally provided by 4 boilers in a central heating plant located in the Engineering Laboratory building (No. 4 boiler room). All the buildings on campus except smaller residential buildings are connected to a district heating system. There are three older boiler rooms on campus. One of these boiler plants, the Commons Building, is fired during the coldest period of the year to supplement the newer No. 4 boiler room.

The existing UVic main boiler plant for the district heating system operates at a temperature of 230°F. It is our understanding that the system is designed to operate at a temperature of 200°F, but is operated at a higher temperature to prevent premature damage in the boilers. The Campus central heating system schematic is attached as Appendix A. It is noted that most conventional heat pump systems are only able to boost heat to 176°F with a coefficient of performance of 3. As a result, it will not be possible to use the heat from the effluent to serve the

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

main UVic District heating system without consuming an inordinate amount of electricity. UVic does however have some other boilers in some of the older buildings which could consider the use of reclaimed heat from effluent. The system which could be considered is the No.2 Boiler room in the Commons Building. The buildings previously served by this boiler could be disconnected from the central heating system and connected to the heat reclamation system which operates at a lower temperature. This is further described in Section 9.3

### 9.3 Proposed Arrangement for the University of Victoria

As indicated above, an average of approximately 5,000 KW of heating power is available from the sewage at current 2009 flows. However, the heat output drops to 2,000 KW between 6:00 and 7:00 am which is also the time when the heat demand spikes. In order to provide a more consistent and reliable utility, a number of supply options would be available including:

- Heat extraction from sea water
- Gas fired back-up boilers
- Solar thermal collectors
- Building heat reclaim
- Geo-thermal, and
- Effluent storage tanks

It is beyond the scope of this report to examine, in detail, the extraction of heat and the feasibility of other sources than sewage or treated effluent. It is proposed that the additional heat needed to make up for low sewage flows would come from a storage tank. As discussed in Part A of this report, storage of effluent will be required for the reuse of reclaimed water as irrigation demand occurs between 10:00 PM and 6:00 AM when flows are lowest. The equalization storage needed to meet the irrigation demand in the summer could also be used to meet the heat demand in the fall, winter and spring heating and non irrigation months, and for the small demand for domestic hot water in the summer. In order to extract additional heat from storage, the heat equalization storage tank should be sized to make up the deficit in available heat from 5:00 AM to 9:00 AM. A storage tank with a volume of 1.540 m<sup>3</sup> would provide a source of heat for the early morning. This volume could be combined with the storage tank needed for chlorine contact for the irrigation system noted earlier in the report. This arrangement would function well in the winter when there is no demand for irrigation water.


It is proposed to supply heat extracted from effluent to the portion of the central heating system that can be valved off and supplied from the No. 2 boiler room located in the Commons Building. This would include the following buildings: The Commons, Student Union Building,

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

Craigdarroch residences (David Thompson, Emily Carr, Margaret Newton, Arthur Currie) and the Lansdowne residences (See Figure 9.2 and the full schematic included in Appendix A).

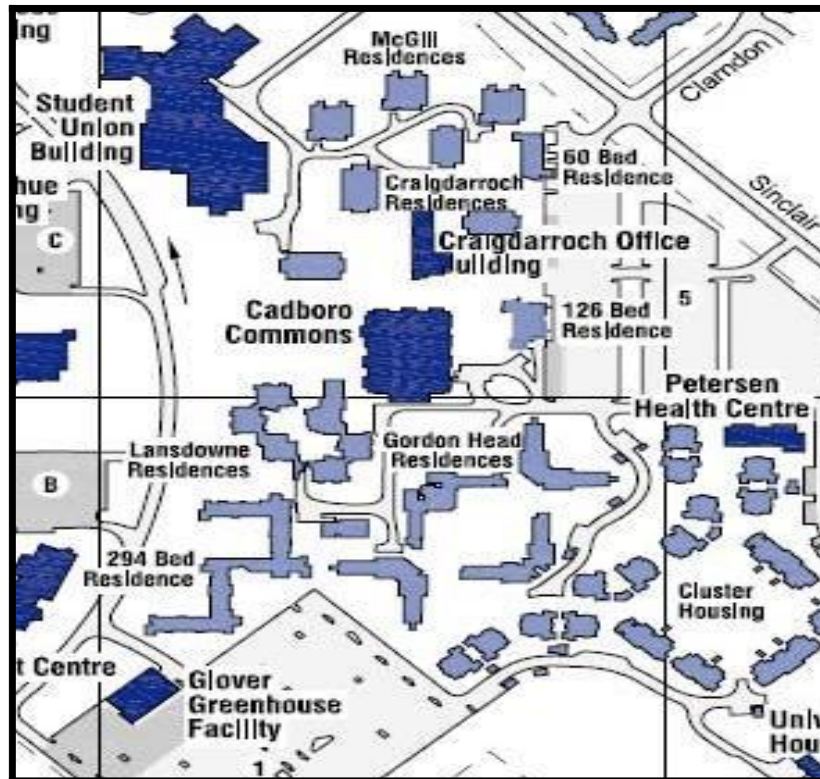

**Figure 9.2 – Proposed portion of UVic DHS supplied from effluent heat**

There is a benefit in connecting at the Commons building plant. The distance from the proposed SENOB wastewater treatment plant is considerably shorter and simpler than to the main plant in the Engineering Lab Wing. There would be less disruption, road works and conveyance costs, less transmission heat loss in the lines, and a better match between supply and demand magnitudes. In other words, the installation would be less expensive and a more consistently reliable heat utility would be provided. The proposed route of the heat supply loop from the treatment plant to the Commons Building is shown on Figure 9.3.



SEAL	BY	DATE	No.	REVISION	ENG. No.	DATE	ISSUE
					1		



Capital Regional District   Environmental Services			CORE AREA WASTEWATER TREATMENT PROJECT		
DESIGNED	G.C.	SURVEYED	-		
DRAWN	S.S.	DATE	12/11/09		
SCALE HORIZONTAL	1:10,000	CHECKED	G.C.		
SCALE VERTICAL	-	APPROVED	S.S.		
CONTRACT NUMBER	149009002	DRAWING NUMBER	Fig 9.3	ISSUE	X
				SHT. No. OF	4 OF 4


## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

There is also an additional benefit to connecting at the Commons Building plant. Besides the reduced conveyance costs, the Commons plant is connected to the remainder of the University's district heating system by an 8 inch diameter pipe loop. In the summer, when space heating demand is low, the available heat from effluent could instead be used to provide domestic hot water heating. Based on preliminary DHW demand calculations and boiler power demand in the McKinnon building, it appears there is enough heat available from wastewater to serve both DHW and heat for the swimming pool in the McKinnon building. This would permit the University to shut down the 4000 KW natural gas fired boiler in the main ELW plant that they currently run all summer to serve the domestic hot water and McKinnon pool demand. This would have a positive impact on their green house gas footprint as well.

The storage tank would be used to store effluent from the previous day. Heat would then be extracted during the night and the early morning to provide heat the peak heating demand. This is shown schematically in Figure 9.4

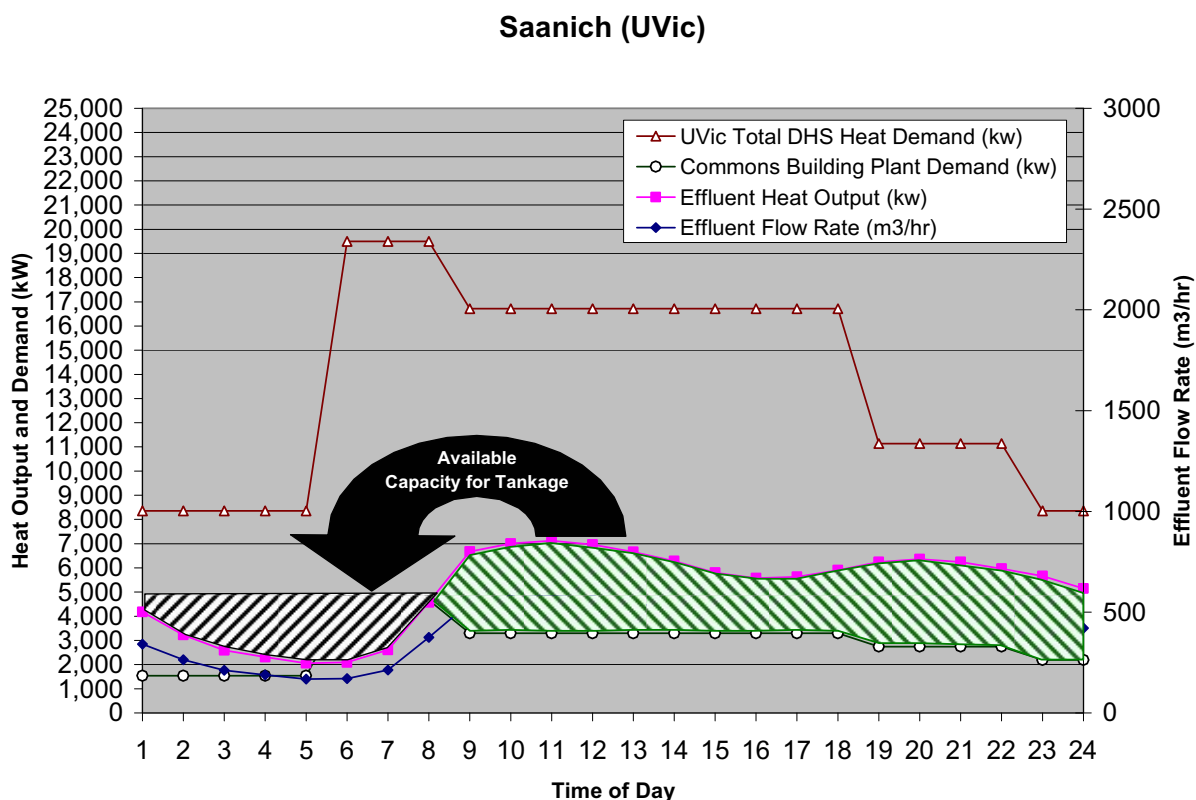

**Figure 9.4 – Consistent Heat Supply vs. Daily Capacity for Tankage**

Based on the boiler power in the Commons Building of approximately 5000 KW, there is a better match between supply and demand if this portion of the campus DHS is only considered for connection only. As can be seen from Figure 9.4, an average of approximately 5000 KW is

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

shown for existing flows. This would be the peak demand that could be satisfied with any consistency including the heat from the storage tank capacity.

The highest hot water temperature that can be supplied from heat pump devices is 80 C (176 F) without major reductions in the coefficient of performance (COP). This will have a major impact on the amount of heat that may be delivered from the existing heating equipment in these older buildings. The Campus boilers serving the main UVic DHS currently run at 230 F so a significant amount of the campus cannot be considered for use of reclaimed heat from effluent except during the shoulder seasons.

Due to the curve-linear heat transfer relationship that exists for heating equipment, any reduction in system temperature impacts the amount of heat delivered significantly. The amount of heat, however, would be sufficient for most of the shoulder season. During the coldest winter days, the boilers may need to be fired to meet the demand from the 7 residence buildings. Further testing of the system will be required to confirm both the effects of the lower temperature water on heat supply to the buildings and to see how much of the shoulder heating season the wastewater heat extraction can cover.

### **9.4 Cooling Demand**

Building cooling can be accomplished by exhausting heat to the effluent. The University of Victoria has a policy against providing any new building cooling systems on campus. Most of the larger older buildings do not have central cooling systems. There are, however, over 210 individual air conditioning units and heat pumps of various capacities on campus. Most of these systems are smaller individual units that are used for various uses such as: space cooling, cryogenic freezers and lab refrigeration. In order to connect all these individual systems together, it would be necessary to create a separate district cooling loop. Also, newer buildings with separate/disconnected cooling systems are at significant distances from each other, which would imply significant capital cost needed for a conveyance system installation.

The domestic hot water tanks in most buildings are connected to the University's district energy system. Therefore in summer, the boiler plants must keep running in order to supply DHW in the buildings. To provide cooling using effluent, there would have to be either a parallel cooling distribution system installed or to remove all the DHW tanks from the district energy system. Either of these options would be costly and could not be justified. Cooling demand in Victoria's mild summer climate is also significantly less than heating; approximately a 70/30 split so this makes it impractical to provide cooling using effluent since it would be necessary to build a separate cooling water distribution system throughout the campus to connect the individual air conditioning units and heat pumps. Such a system would be very expensive to construct and significant modifications would be required within existing buildings to implement this scheme.

## Section 10      Alternative for Heat Extraction Methods

### 10.1 In-pipe Heat Exchanger (Rabtherm Product)

The extraction of heat from raw sewage using heat exchangers built into the conveyance piping was investigated. This included gravity mains, forcemains or treated effluent outfall pipes using the Rabtherm® product. This option could be considered where new pipelines must be built as part of the overall program and where the routing of such pipelines makes use of the recovered heat viable in adjacent buildings. This product consists of a pipeline with the heat exchanger tubing built into the pipe wall. Currently this patented product must be imported from Europe, however, the North American representative has indicated that it could be manufactured in Canada using imported parts. Due to the high cost of this piping system, the use of this in pipe heat exchanger would be limited to newly constructed mains.

There is one significant limiting factor to the cost vs. heat extraction business metric for this product. The heat potential in raw sewage is constrained by the temperature to which it can be dropped. For the wastewater treatment process, the temperature of the raw sewage can only be reduced to 10 °C before biological sewage treatment processes are impacted. Since treated effluent is at the end of the sewage treatment process, its temperature can be reduced to near seawater temperature levels of 5 °C before it is discharged to the outfall. This 5 °C temperature difference has a significant effect on both the size of the Rabtherm heat exchange system and on the amount of heat that can be extracted from the wastewater. The in-pipe heat exchanger is shown on Figure 10.1. The heat exchanger tubing is built into the pipe wall with separate inlet and outlet connections for each 5 m long section of pipe.



## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

**Figure 10.1 – Rabtherm, Forcemain Heat Exchanger**

If a 600 mm diameter heat exchange pipe was installed in the 700 m long land portion of the new outfall for the SENOB plant, the amount of extractable heat would be 4,700 KW. With a 900 mm pipe, the amount of extractable heat would be 7,000 KW. The cost of material alone is estimated at \$3.1 million for the 600 mm pipe and \$4.2 million for the 900 mm pipe. This cost does not include the dual parallel heat conveyance pipes that have to be installed in the same trench as the heat extraction pipe and the installation cost. Because of the high cost of this product, it is recommended to carry out heat exchange using other proven and locally available types of heat exchanger products as discussed in the next section

## 10.2 Direct Heat Exchangers

There are various options available for direct heat exchange to closed loop piping systems from treated effluent, seawater, and groundwater. Potential options include brazed plate, plate & frame, tube in tube coiled helical, and shell and tube heat exchanger technology. Each heat exchanger technology has various characteristics that make them either more or less suitable for duty in various functions of the proposed heat distribution system. Each technology is discussed in the sections below.

### 10.2.1 Brazed Plate Heat Exchangers

Plate and frame heat exchangers are a sandwich of very thin plates of stainless steel that have a thin layer of brazing alloy fitted between each plate during manufacturing. The raw assembly of loose plates are stacked together, and “sintered” or fused together at high temperature in a combination oven/hydraulic press. The resulting assembly is very light in weight for a given output and arguably the most compact of all heat exchangers.



High internal velocities result from the closely spaced thin plates, with a high heat transfer rate. These heat exchangers can be utilized with fluids that contain suspended solids, as their high internal scouring velocities promote continuous cleaning. Brazed plate heat exchangers cannot tolerate coarse suspended solids such as sand or marine organisms, as the plate tolerances are so small that the exchanger will clog quickly.

This product is limited by the quality of the treated effluent including suspended solids. For the SENOB plant, it is proposed to construct an ultra-filtration MBR plant which will produce a high quality effluent with turbidity that approaches drinking water quality. The main drawback of brazed plate heat exchangers using treated effluent systems, however, is that the high pH and high amount of entrained oxygen in the effluent will accelerate the corrosion of the brazing alloy that forms the bond between plates. Life expectancy is about 5-6 years for treated effluent applications. They have excellent usage as a customer’s heat exchanger, due to their suitability



## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

in closed loop systems that are treated with corrosion inhibitors, pH monitored, and with no oxygen present.

The image above has been reprinted from Mueller, [www.muel.com](http://www.muel.com).

### 10.2.2 Plate and Frame Heat Exchangers

Plate and frame heat exchangers are characterized by their multiple plate configuration, gaskets between plates, frame/header assembly, compact size (relative to conventional shell/tube configurations), availability in a wide variety of plate and header metallurgy for different applications, availability in double wall atmospheric vented construction for leak detection, and ability to be disassembled in the field for cleaning and gasket replacement. This use of this product is limited by suspended solids. The ultra-filtration MBR plant, however, would eliminate this problem.



Biofouling from organisms found in effluent can be an issue with plate and frame exchangers, including the supply and return pipelines. Products are available that prevent biofouling. One such product is from Blume Worldwide Services. Their product provides both anti-fouling and anti-corrosion protection through the generation of trace amounts of copper ions and the dissipation of trace aluminum hydroxide into the pipeline system. The Blume system will be discussed in further detail below, in the “Heat Exchanger Cleaning Options” section of this report. The image above has been reprinted from Mueller, showing their Accu-Therm models, [www.muel.com](http://www.muel.com).

### 10.2.3 Tube in Tube Heat Exchangers

Another product available for heat exchange are the helical or coiled “tube-in-tube” models shown in the photos below. Their high scouring velocity could make them usable for heat exchange between the treated effluent and closed loop systems. Provided that large enough models are available, the high scouring velocity is of particular benefit for the treated effluent side of the heat exchangers. The treated effluent will contain micro-organisms that can foul heat exchange surfaces. Also of interest is their availability in a variety of metallurgy options, and thus the ability for construction in corrosion resistant options for treated effluent duty.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---



The images above have been reprinted from Sentry Equipment Corp. [www.sentry-equip.com](http://www.sentry-equip.com)

### 10.2.4 Shell and Tube Heat Exchangers:



Shell and tube heat exchangers are characterized by their outer shell and inner tube bundle construction, complete with headers. They typically require substantially more floor space than other heat exchanger technologies, both because they are long and narrow, but also because the tube bundles are removable from one end of the exchanger. Usually, the space that a shell and tube exchanger requires for tube bundle removal must be incorporated into the building or space in which the exchanger is installed, and the length required for the total installation is twice the operating length of the exchanger. Their main advantage is that they are the easiest of all the heat exchangers to clean and maintain, when the heat exchanger is handling a fluid with suspended solids. Shell and tube heat exchangers are available in a wide variety of metallurgy options, and thus can easily be adapted to treated effluent heat recovery usage.

The preliminary cost estimates are based on shell and tube heat exchanger. The final selection of the heat exchanger should be carried out at the time of detailed design.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

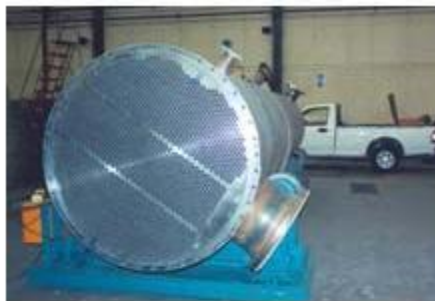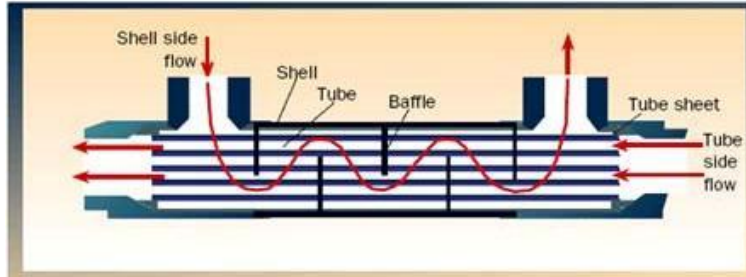

**Figure 10.2 Diagram and Photos of Shell and Tube Heat Exchangers**

Courtesy of Logichem Process Engineering, [www.heatexchangers.co.za](http://www.heatexchangers.co.za).


### 10.2.5 Spiral Heat Exchangers:

Spiral heat exchangers (SHE) are configured using helical (coiled) tubes. In general, the device consists of a pair of flat surfaces that are coiled into two channels in a counter-flow arrangement. Each of the channels has a long curved path which are connected at the outer arms of the spiral to the loop.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

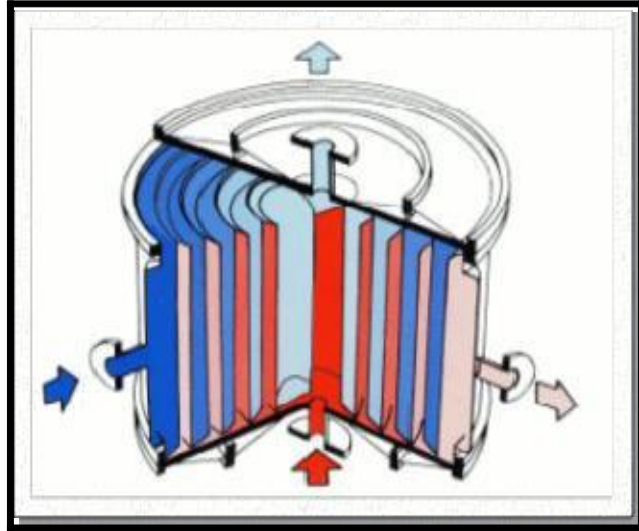

Main advantages of the SHE is its highly efficient use of space and anti fouling characteristics. As well, a notable tradeoff is capital cost vs operating cost. A compact SHE has a smaller footprint and thus lower capital cost to house it. SHE's can therefore be oversized to lower pressure drop, lower required pumping energy and have higher thermal efficiency.

SHEs are often used in heating fluids which contain solids. Other heat exchangers have a tendency to foul in such environments. The SHE uses a "self cleaning" mechanism, whereby fouled surfaces cause a localized increase in fluid velocity, thus increasing the drag friction on the fouled surface. This helps dislodge small blockages and keep the heat exchanger clean. "The internal walls that make up the heat transfer surface are often rather thick, which makes the SHE very robust and durable in demanding environments." They units are also easily cleaned, opened easily so any foulant can be removed with pressure washing.

The SHE is suited for applications such as digester heating, heat recovery and effluent cooling. For most applications SHEs are smaller than other types of heat exchangers.

### 10.2.6 Heat Exchanger Cleaning Options

Heat exchangers can be prone to fouling from suspended solids and bacteria in the treated effluent. Treated effluent heat exchangers will require either manual cleaning, some form of automatic cleaning system or an anti-fouling system to maintain heat transfer efficiency for reduction of manual cleaning by maintenance staff. It is recommended that the treated effluent be piped through the tubes and not the shell side of the exchanger. There are options available for "online timed" interval cleaning of the heat exchanger internal tube surfaces:

- One such cleaning system manufactured by CQM Tech is called "ATCS Ecodenser". The ATCS system works by injecting foam balls into the fluid stream periodically, and automatically collecting and cleaning the balls for repeated automatic usage. A more detailed description of this system follows.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area


---

- Blume Worldwide manufactures an anti-corrosion/anti-fouling system specifically for seawater systems and undersea structures such as offshore oil platforms. It is recommended that an anti-corrosion and anti-fouling system be fitted to the seawater heat exchangers for this project.

It should be noted that both the Blume and ATCS systems will not eliminate maintenance from the treated effluent heat exchangers entirely, however these automatic systems do have the potential to reduce maintenance substantially, and keep internal heat exchanger surfaces clean enough to promote maximum heat transfer efficiency.

### How ATCS Works

The CQM ATCS is installed on the chiller's condenser and keeps tubes clean without human intervention. The system periodically injects into the tubes sponge balls that are slightly larger in diameter than the tubes themselves. The natural pressure head pushes the balls through the tube, which is thus rubbed clean. The balls are then trapped in the outlet of the heat exchanger, where they are prepared for the next cleaning cycle.

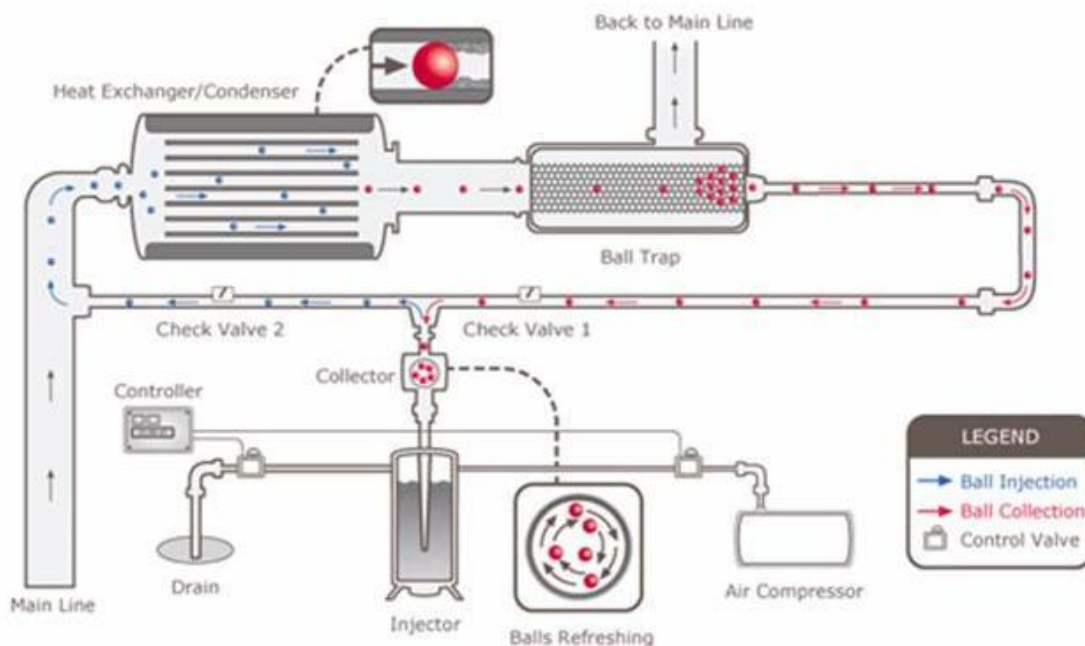

## Section 11 Alternatives for Heat Supply System

### 11.1 General

In this study, 3 principal types of district heat distribution systems are evaluated:

Option 1: Ambient temperature distribution system (up to 20 °C)

Option 2: Moderate temperature distribution system (80 °C)

Option 3: Low temperature distribution system (35 °C)

These district heating systems would generally consist of the following components:

1. Heat exchangers – to transfer heat from the treated effluent to a clean liquid in a district heating loop;
2. Water pumping – a first set of pumps to flow effluent through the heat exchangers and then a second set of pumps to flow the clean fluid through the district heating loop;
3. Heat pumps – the temperature of the clean liquid has to be “lifted” to the requirements of the building heating system in order to be useful for the end customer;
4. Distribution piping – to distribute the clean heating liquid from the wastewater treatment plant to the end users;
5. Various treatment, expansion and buffer tanks, and
6. Direct Digital Control (DDC) System.

The following system component options have been identified and are further discussed in Section 11.2 to 11.4.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

<b>Components</b>	<b>Option 1 – Ambient Temp. Distribution System (up to 20 C)</b>	<b>Option 2 – Moderate Temp. Distribution System (80 C)</b>	<b>Option 3 – Low Temp. Distribution System (35 C)</b>
Heat exchangers	At sewage treatment plant and end user's facility	At sewage treatment plant and end user's facility	At sewage treatment plant and end user's facility
Water pumps	At sewage treatment plant	At sewage treatment plant	At sewage treatment plant
Heat pumps	At end user's facility	At sewage treatment plant	First lift heat pump at STP and second heat pump at point of use
Distribution piping	Non insulated pipe - PVC or HDPE	Insulated welded steel pipe	Insulated PVC or HDPE

### 11.2 Option 1 – Ambient Temperature System (Up to 20°C)

Option 1 is shown schematically in Figure 11.1 and consists of an ambient temperature system that will provide the Owner of the district energy system (DES) with the ability to meter utility customer's usage in both heating and cooling modes or heating only, if a customer chooses this option.

With this option, a closed loop distribution piping consisting of 450 mm diameter non-insulated pipe system would be required. Utility customers could draw water from the DES utility and water would be fed to a heat exchanger(s) in each building. Customers could in turn use heat pumps for both heating and cooling within their facilities, and the customers heat pumps would be connected on the load side of the heat exchanger. The heat exchangers in each customer's building would serve two purposes:

- As a means to separate the DES closed loop treated water from the customer's hydronic heating and cooling systems in order to ensure that any customer issues with maintaining their water chemistry does not impact CRD's systems.
- As a means to separate the DES systems from systems with a higher operating pressure. For example, customers with high buildings might exert a higher than anticipated static pressure on the DES distribution systems if there were no heat exchangers fitted to the piping network. The benefit of separating higher pressure systems from the DES results from being able to utilize pipeline components with lower pressure ratings where possible.

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### System Basics:

This option is termed a “net-metering” solution. Thus, it is expected that customers with differing heating and cooling load profiles would connect to the same network of closed loop piping, and the DES closed loop utility would allow energy sharing between buildings that simultaneously require heating and cooling.

For example, a transit repair shop connected to the utility might have a large makeup air heating requirement, with a heating load from the makeup air that might occur at any ambient temperature below 15 degrees Celsius. Nearby, a large office building may have many interior areas with no interaction to the envelope of the building, and resulting heating/cooling load variations with weather, time of year, and solar effects. The interior spaces of the large office building would normally be filled with people, lighting and computers that would require cooling year round, independent of outside temperature, and would thus be rejecting heat either from heat pump or central chiller operation.

Conventional stand alone HVAC systems for each building would dictate that the transit repair shop systems be designed to utilize natural gas fired equipment for makeup air heating, while the nearby office building would be operating a cooling tower or closed circuit fluid cooler almost year round in order to reject heat from the interior spaces. With an energy sharing utility, energy can be transferred between customers. Each utility customer would require their buildings to be fitted with a heat pump, either water to air or water to water type. It is anticipated that the best candidates for a water source heat pump system are those with existing hydronic (fluid based) heating and cooling systems within their facilities.

Facilities with rooftop packaged, or unitary equipment are not anticipated to be potential customers due to the high costs of system retrofit. However, it should be noted that as CO2 emissions penalties legislated by the BC Provincial Government grow over time, a treated effluent utility coupled with heat pumps fed from renewable hydroelectric power may become more attractive to potential customers, both for reasons of economics and for environmental stewardship. During periods of low cooling load operation, customer bypass valves can be used on the load side of customer heat exchangers to potentially provide chilled water directly from the customer heat exchanger, by operating the seawater exchanger to provide chilled water.

### System Operation:

As mentioned above, the proposed system type is a closed circuit utilizing tap water treated with corrosion inhibitors as a heat transfer fluid. Water would be circulated amongst all buildings connected to the utility, and temperature of the closed loop would be monitored and adjusted by automatic temperature control systems. Common water source heat pumps have the ability to operate within a wide temperature range at their water inlet, of approximately 2 C to 25 C in heating mode, and between 15.5 C and 32 C in cooling mode. Therefore, it is expected that the closed loop utility would operate in a temperature range between 5 C and 25 C during all conditions. Automatic valves, recirculation valves and temperature controls on the utility heat



## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

exchanger and customer connection would ensure that the fluid temperature at the inlet to each customer heat pump would be maintained within an optimum range.

If return water temperature at any point in the system moved near to the limits of either 5 C or 25 C operating range, automatic controls would use a combination of additional flow and the addition or rejection of energy to the loop via the treated effluent to maintain proper closed loop operating temperatures.

The DES would meter water usage with both flow meters and accurate temperature measuring devices in order to bill the customers for usage. The added advantage of a “closed loop net-metering solution” is that separate customers demanding both heating and cooling simultaneously can be charged for their usage, while the DES only energy cost is for circulating the fluid to the customers. Two or more customers “share” energy. The potential impact of eliminating natural gas usage from combustion for heating, while sharing energy with a customer that is simultaneously requiring cooling is significant. The only penalty of this approach is that pumping energy is needed for fluid transfer between customers, and heat pump energy is required for heating.

### System Advantages:

- Can be expanded to an energy management system;
- Heating and cooling capability with a single pipe;
- Conveyance loop does not require welded steel insulated pipe; pipe is cheaper; and
- Essentially no transmission heat loss.

### System Disadvantages:

- More costly for end customer to connect since a heat pump is required at each point of use and may require costly building modifications to expand the mechanical room to accommodate the heat pumps;
- Conveyance is more difficult with larger pipe with cost implications;
- Will need backup boiler for coldest winter months; and
- May need very expensive “single lift” heat pump to achieve required DHS temperatures.
- There will be higher electrical usage at the end user’s plant. This may trigger the need for improved electrical infrastructure such as transformers and improved distribution network.

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### **11.3 Option 2 – Moderate Temperature System (80°C)**

This is the classic type of DHS that runs at higher temperatures incorporating an insulated distribution loop and a simple heat exchanger at the end customer's facility. This system is shown schematically in Figure 11.2.

#### System Basics:

The system consists of heat exchangers and heat pumps at the wastewater treatment plant, which extract heat from the treated effluent. The heated water is then pumped through an insulated closed loop piping system to the University where it can be extracted to the existing DHS. This extraction at the University is accomplished with a simple low maintenance heat exchange system, incorporating pumps and heat exchangers.

#### System Operation:

The closed loop transmission fluid temperature would be increased in 2 stages. The first stage would be through heat pumps or chillers to accomplish the first lift to 35 °C. The second lift would be through modular heat pumps to raise the fluid temperature to 80 °C. This 80 °C water would then be transmitted through an insulated 350 mm diameter closed loop pipe to the Commons Building to charge the residential portion of the University's DHS.

The two temperature lifts would be controlled by a direct digital control system with temperature meters on supply and return lines in order to optimize the coefficient of performance (COP) between heat output and required electrical power. As well, calibrated temperature and flow meters would be employed to measure consumption so that the University could have accurate consumption and billing information.

#### System Advantages:

- Simpler end customer hook up: At the end customer's facility, only heat exchangers, pumps and controls would be installed. Heat pumps would not be required at the end users facility as the district loop water has already been lifted to the required temperature. Less equipment means less initial capital cost for the end customer and therefore greater incentive to connect;
- End customer does not need to find copious amounts of space in existing mechanical rooms to house heat pumps and related equipment.;
- Less maintenance and lower initial capital cost for end customer to get connected;
- Maintenance of heat pump equipment is centralized at the sewage treatment plant – this is an ongoing incentive for the end customer;

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

- Due to the presence of the insulated pipe loop, a fully modulating back-up boiler could be located at the wastewater treatment plant and maintained centrally. The moderate or higher temperature water from the back-up boiler could boost system capacity and be transmitted to the University to accommodate more of the shoulder/winter season demand;
- End customers do not have to pay direct capital costs for heat pumps at their facility or pay hydro costs for extracting heat at their facility with heat pumps, and
- The pipe diameter for the transmission loop is smaller than for the ambient system. This reduces conveyance costs.

### System Disadvantages:

- There will be higher heat losses in the conveyance pipe at this elevated temperature. Heat loss in conduction is proportional to the square of the Temperature (i.e.  $Q_{\text{loss}} \propto T^2$ );
- There will be a lower coefficient of performance (COP) from the heat pumps at higher temperatures, and
- There is no ability to both heat and cool at the same time with this system unless a second insulated loop is installed to solely carry cooling water. Installation of a second loop would have a significant effect on conveyance costs. With the mild summer temperatures in Victoria and UVic's ban on mechanical cooling, this option does not appear financially viable or worthwhile.

## 11.4 Option 3 “Low” Temperature System (35°C)

The 35°C low temperature system is similar to the 80 °C system above, but with minor differences that affect the conveyance cost, transmission losses and end customer operations. See attached system schematic on Figure 11.3.

### System Basics:

This is a lower temperature system than the 80 °C system above, but it carries more heat capacity per fluid volume in the distribution pipe than the ambient system. Since temperatures are lower, a less expensive plastic pipe can be used for the distribution loop instead of welded steel. The distribution pipe still requires insulation; however transmission losses due to the lower fluid temperature are significantly reduced.

The heat extraction and first temperature lift of the distribution loop is conducted at the sewage treatment facility and 35 °C water is then pumped through the loop. The end customer must then conduct the final temperature lift with a heat pump located within their facility. Operating

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

parameters can then be controlled by the end user to satisfy their specific heating system(s) needs of operating temperatures and demand.

### System Operation:

The system operation is similar to the 80 °C loop, however the second temperature lift occurs in a different location; at the end users facility.

The fluid carried in the closed 450 mm diameter transmission loop is increased to 35 °C in a single stage. Then a second lift is conducted at the end customer's facility to 80 °C. Chillers accomplish the first lift, pump convey the 35 °C fluid to the end users facility where the second lift is provided by modular heat pumps to raise the fluid temperature to 80°C.

The temperature lifts, which occur in separate locations, would be controlled by separate direct digital control systems. The system the end users facility, located before the customer's heat pumps, would employ calibrated temperature and flow meters to measure consumption so that the University could have accurate consumption and billing information.

### System Advantages:

- The system would incur less transmission losses than with the 80 °C system;
- There is lower conveyance and pumping costs due to more heat capacity in fluid and smaller diameter pipe;
- The end customer has more control over temperature and COP with control over both the heat exchanger and the heat pump, and
- The insulated plastic transmission pipe should be more economical than the welded steel pipe of the 80 °C system.

### System Disadvantages:

- The cost of the insulated transmission pipe is likely more expensive than the ambient pipe. The conveyance of the larger ambient pipe may have significance however;
- There is more heat loss in the low temperature system transmission pipe than for the ambient system;
- A better COP could be achieved in early shoulder seasons than in the higher temperature system, and


The ability to heat and cool at the same time is reduced as the system would require a second (expensive) insulated distribution loop. Having the end user's DHW system connected to the DHS makes cooling in summer not feasible.

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---


- There will be higher electrical usage at the end user's plant. This may trigger the need for improved electrical infrastructure such as transformers and improved distribution network.
- For this option, significant direct digital control systems with feedback loops would need to be installed in the wastewater plant and in the end users plant. This will nearly double the controls cost and impact operations and maintenance.

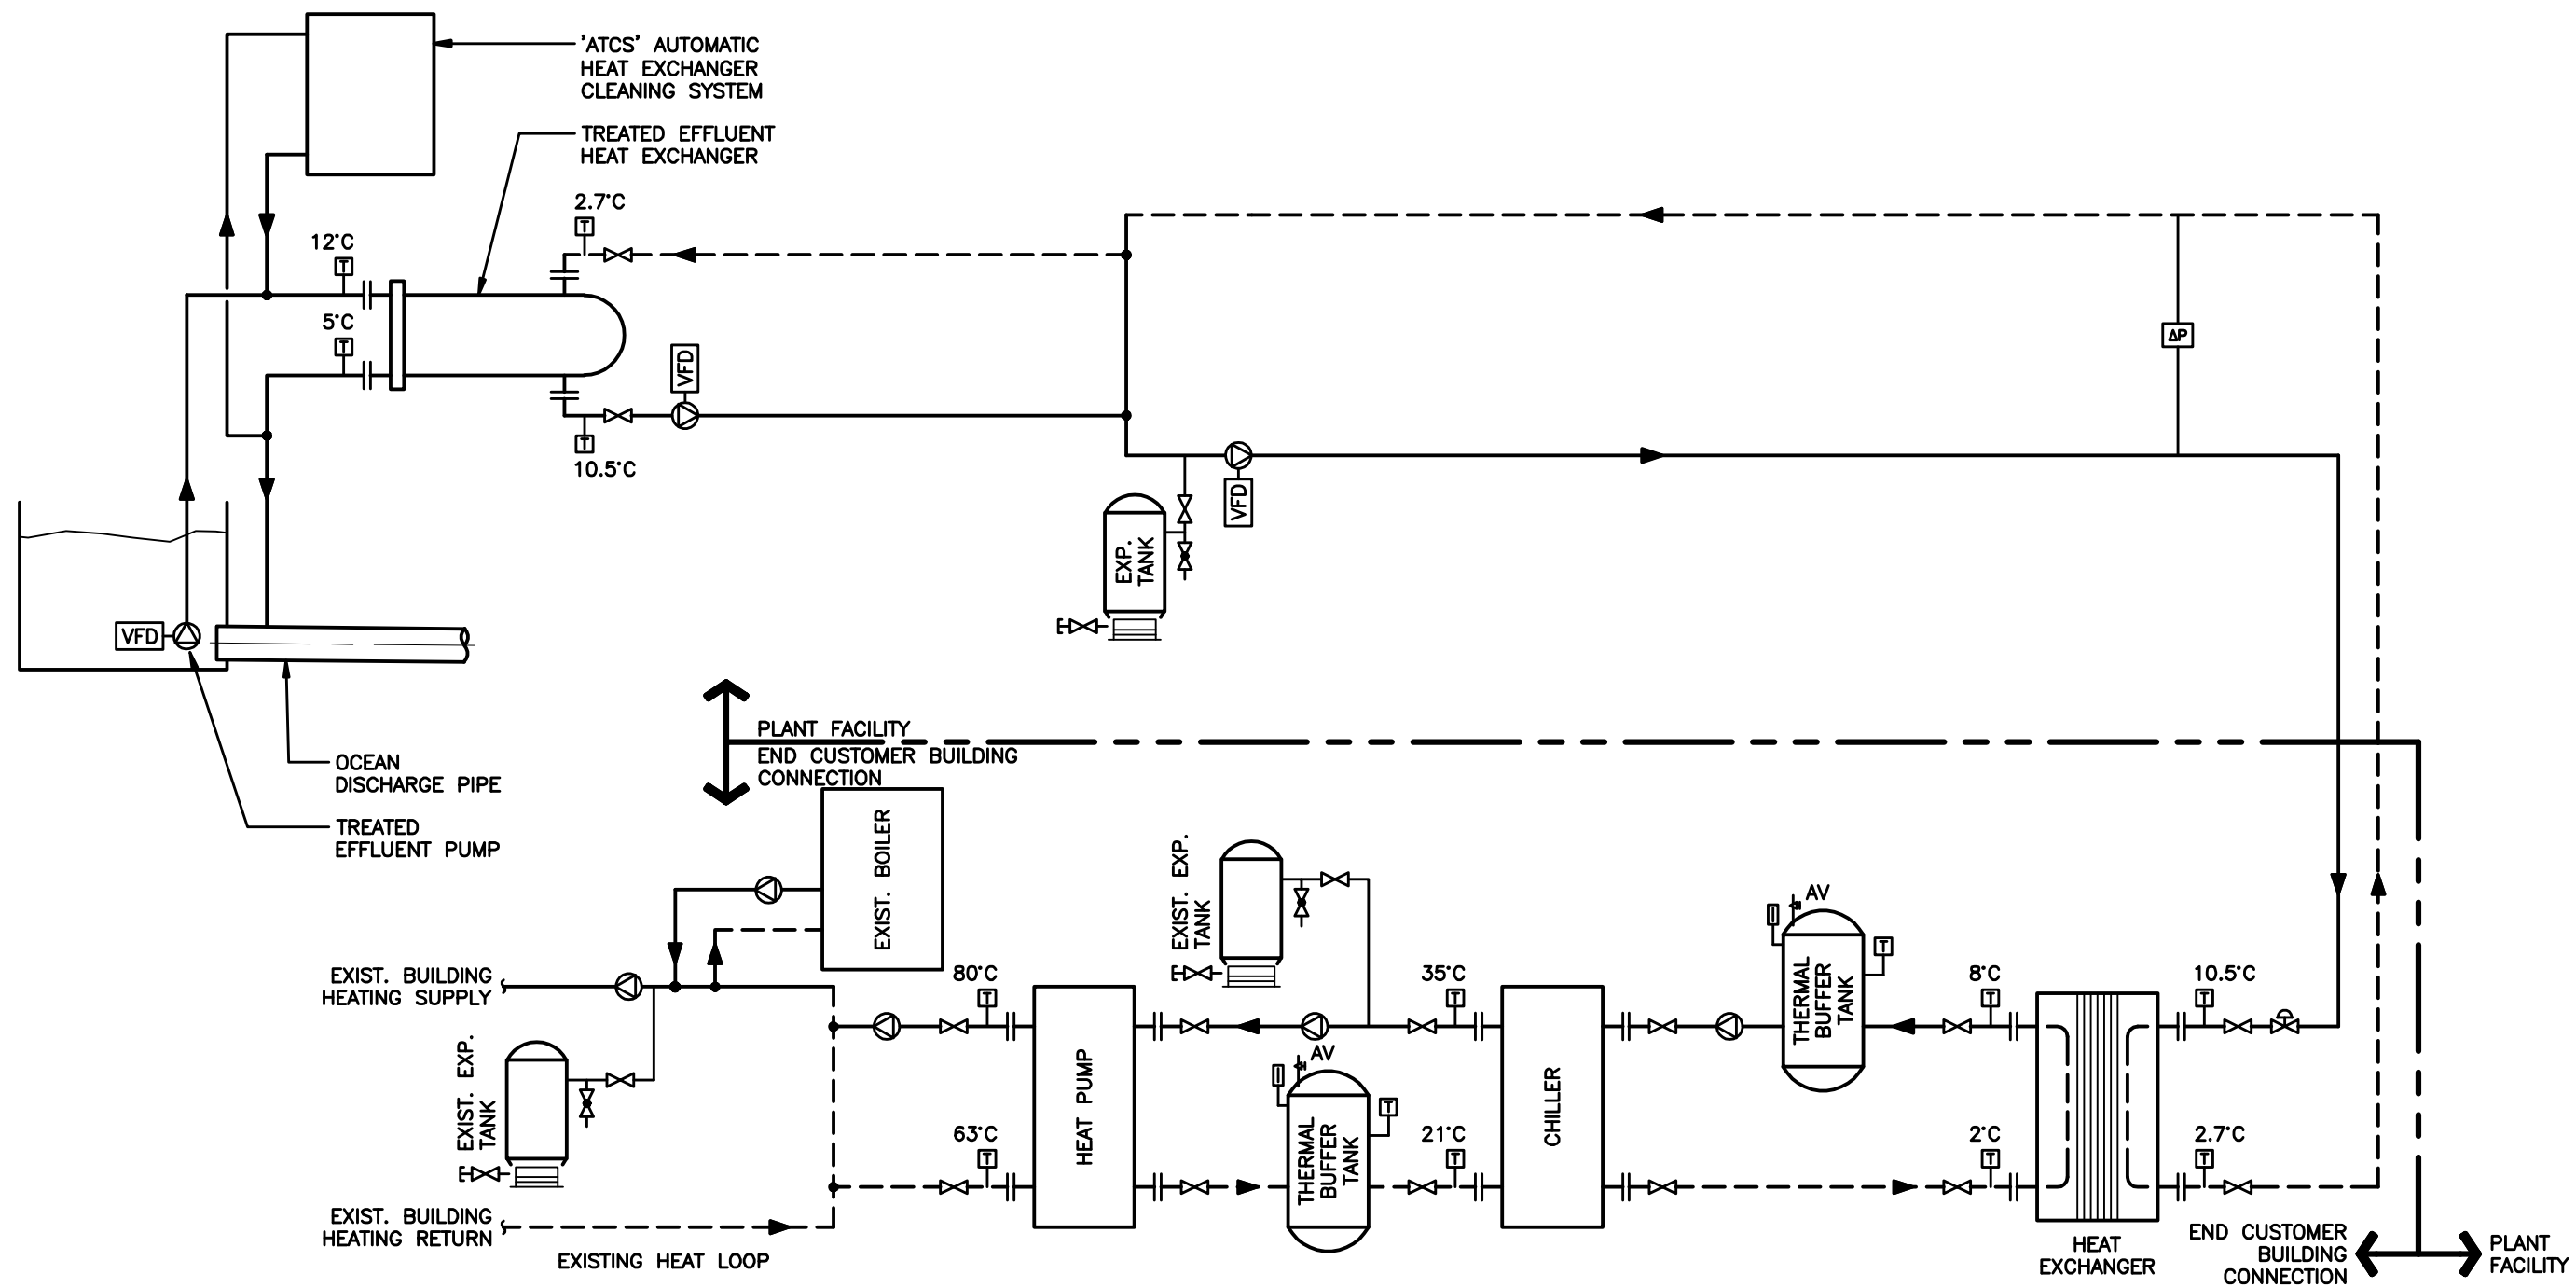

NO.	DATE	BY	REVISION	ENG. No.	DATE	ISSUE




Capital Regional District Environmental Services		CORE AREA WASTEWATER TREATMENT PROJECT	
DESIGNED	MG	SUPERVISED	-
DRAWN	DFC	DATE	16/11/09
SCALE HORIZONTAL	NTS	CHECKED	MG
SCALE VERTICAL	-	APPROVED	CC
CONTRACT NUMBER	149009002	DRAWING NUMBER	Fig 11.1
		TABLE	X
		SHT. No.	1
		OF	3

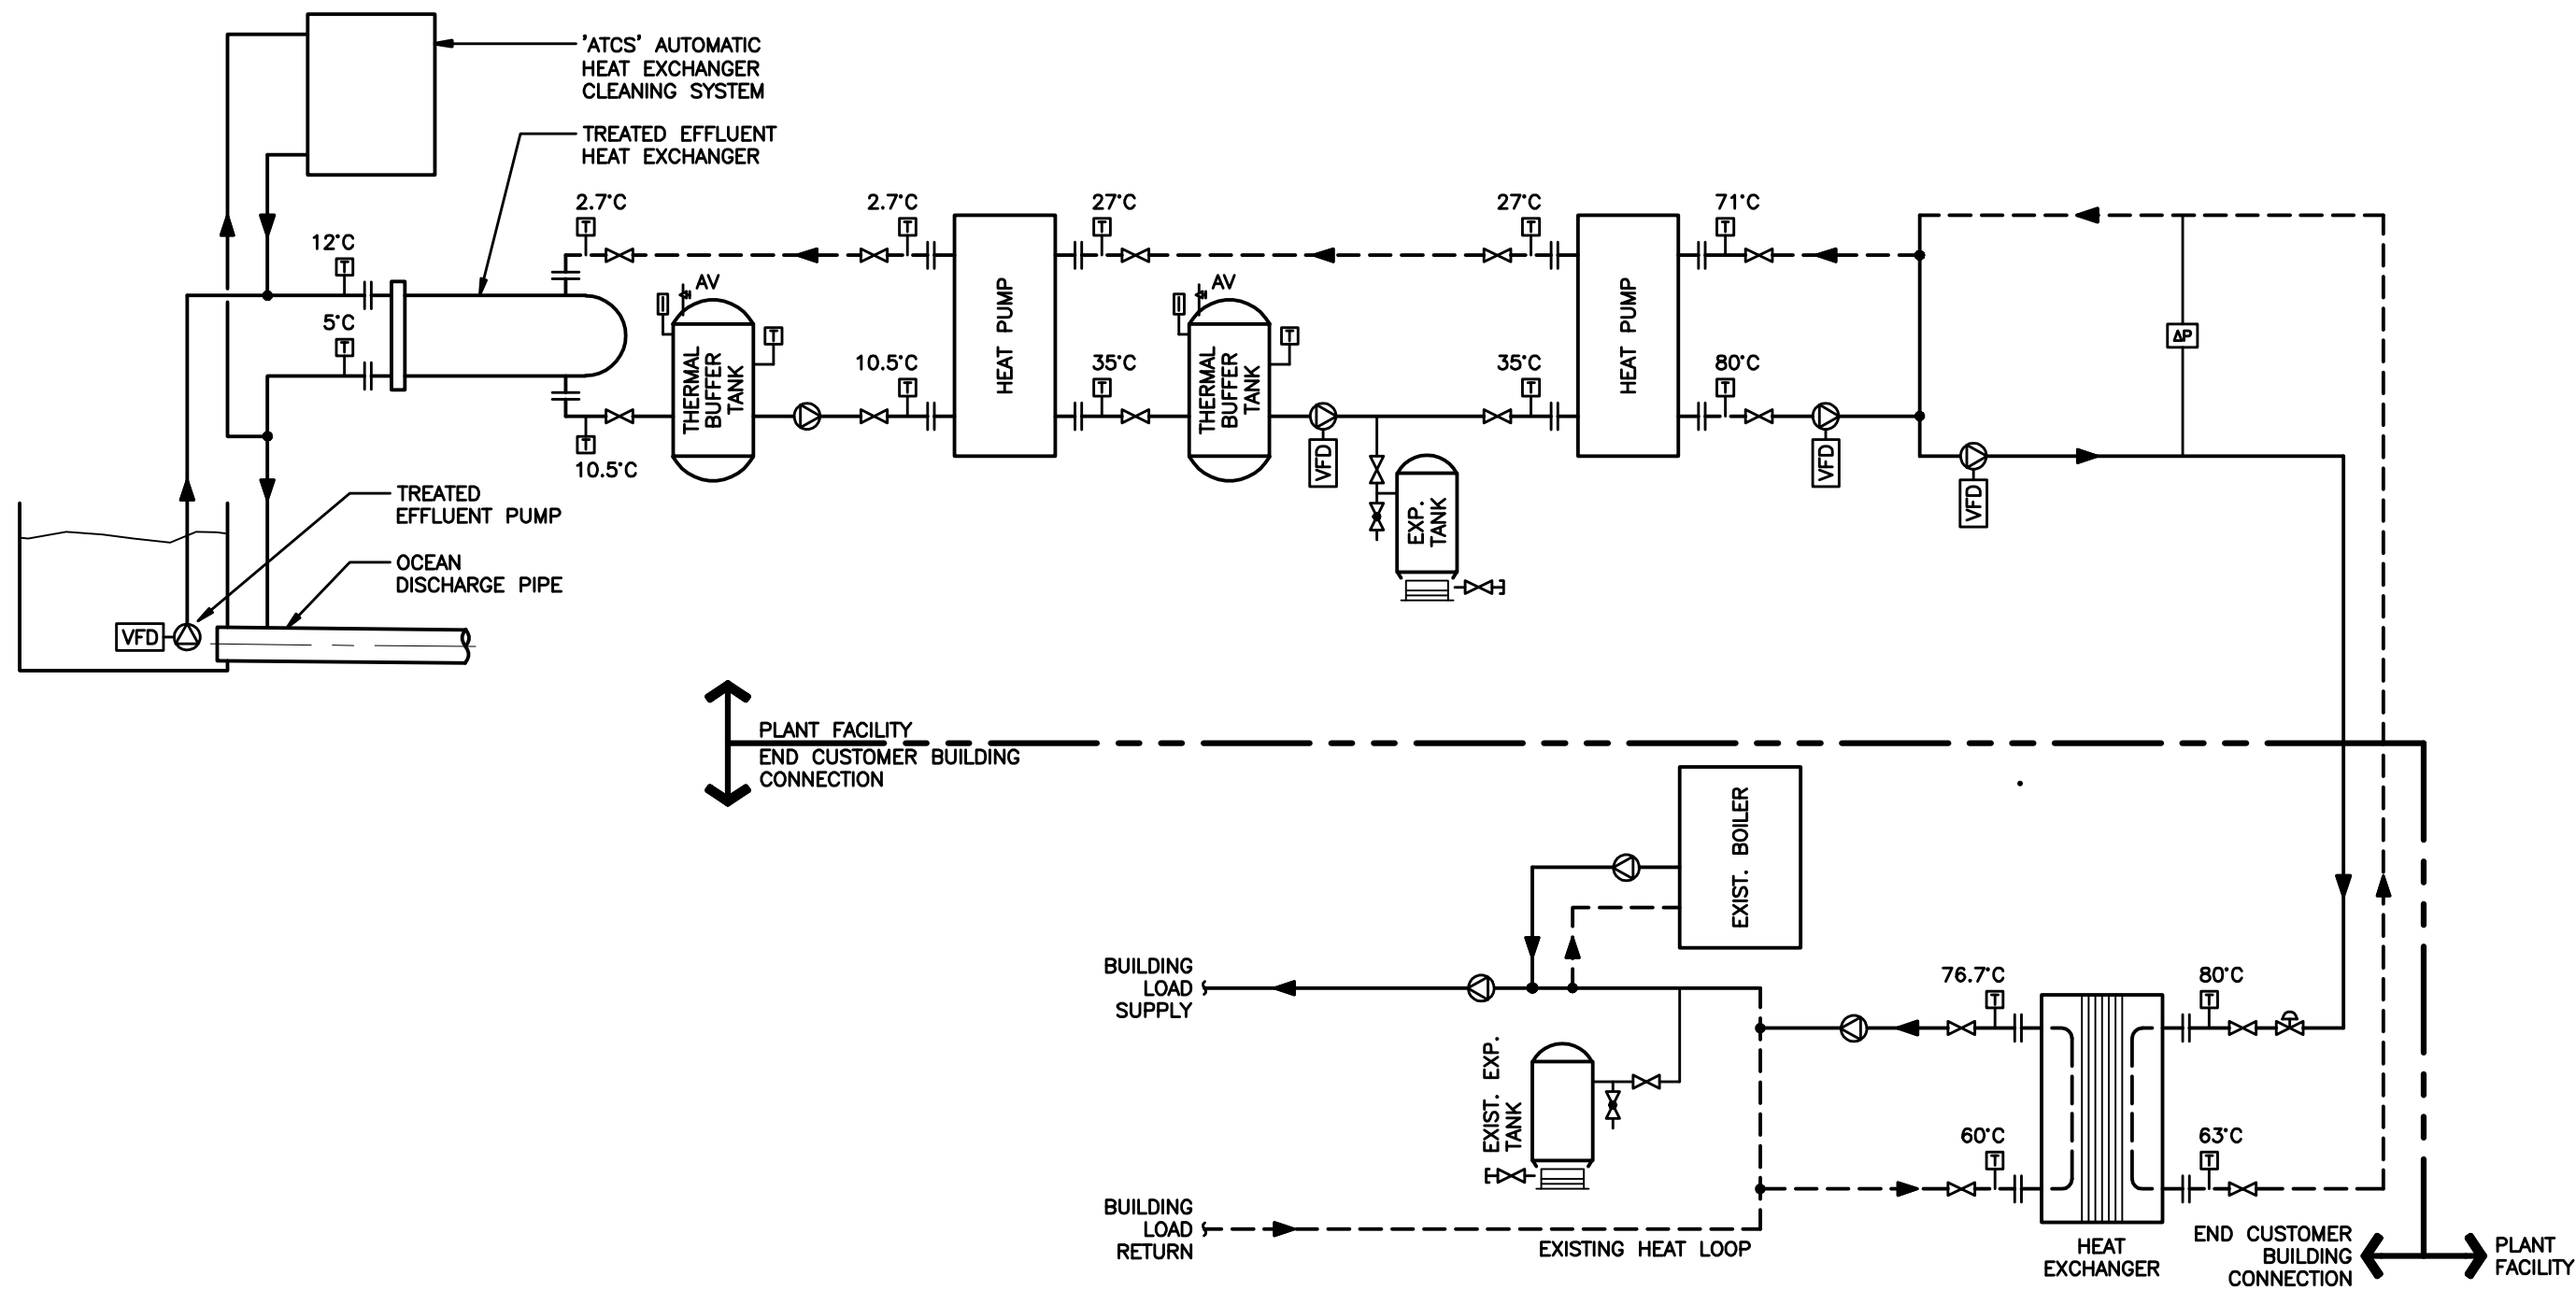

NO.	REVISION	DATE	BY	CHKD.	APP'D.	ISSUE
1						



Capital Regional District Environmental Services		CORE AREA WASTEWATER TREATMENT PROJECT	
DESIGNED	MG	SUPERVISED	-
DRAWN	DFC	DATE	16/11/09
SCALE HORIZONTAL	NTS	CHECKED	MG
SCALE VERTICAL	-	APPROVED	CC
CONTRACT NUMBER	149009002	DRAWING NUMBER	Fig 11.2
TABLE	X	SHT. No.	2
		OF	3

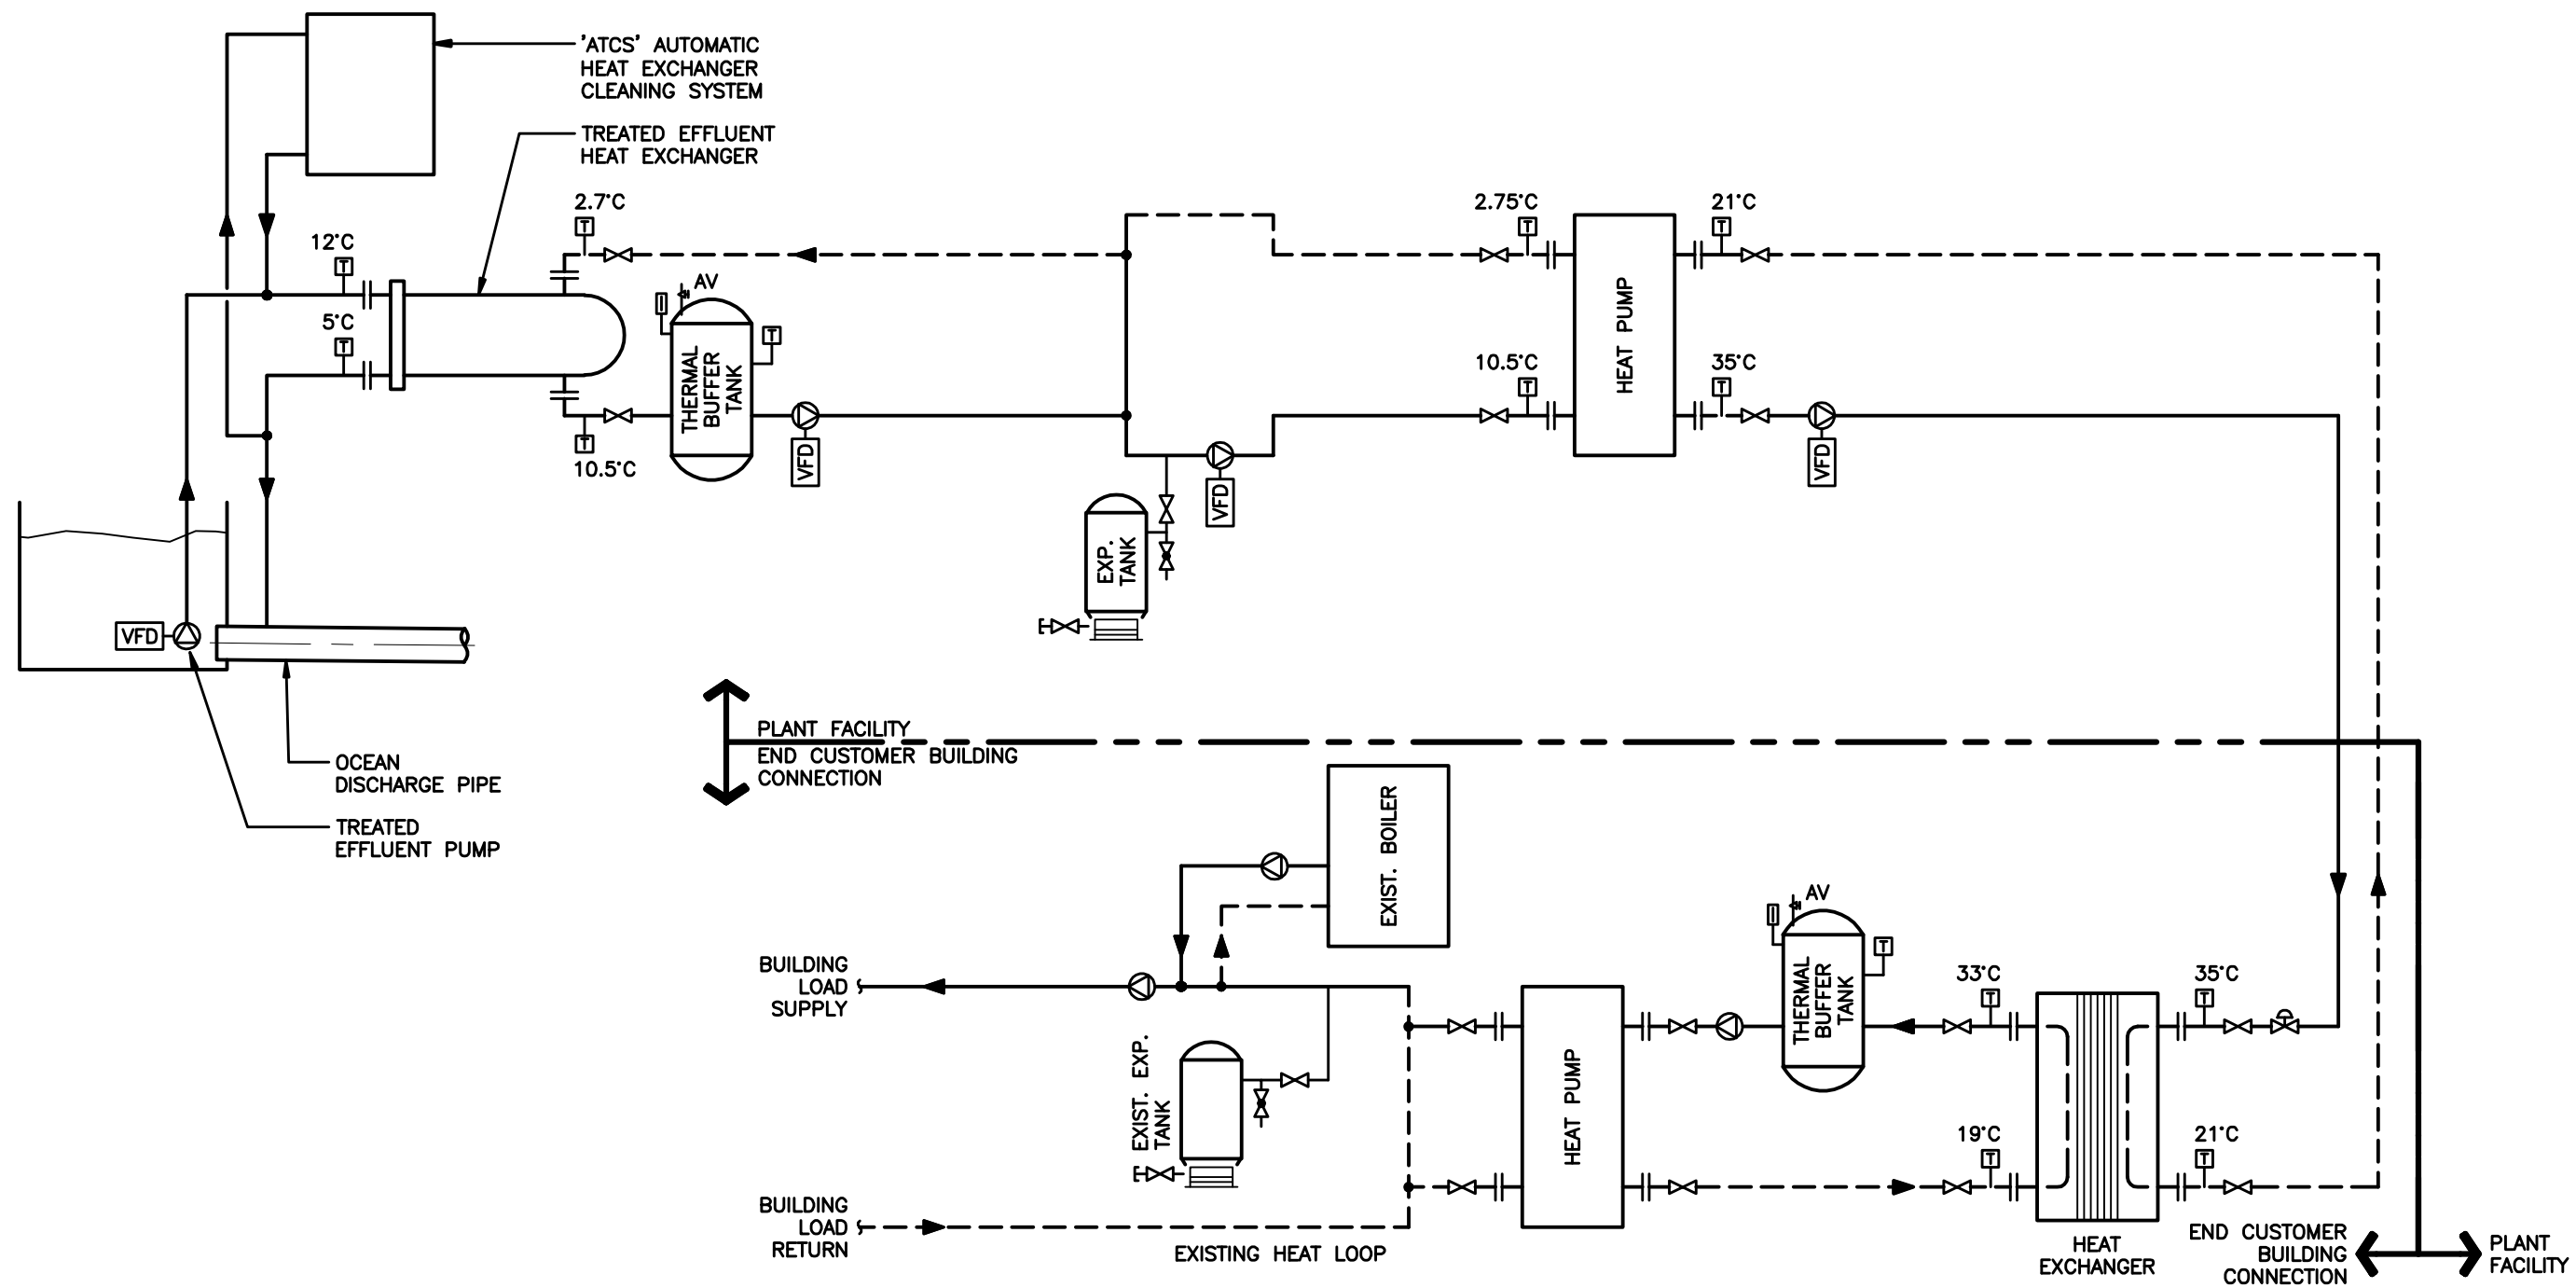

NO.	REVISION	DATE	BY	CHKD.	APP'D.	ISSUE
1						



Capital Regional District Environmental Services		CORE AREA WASTEWATER TREATMENT PROJECT	
DESIGNED	MG	SUPERVISED	-
DRAWN	DFC	DATE	16/11/09
SCALE HORIZONTAL	NTS	CHECKED	MG
SCALE VERTICAL	-	APPROVED	CC
CONTRACT NUMBER 149009002		DRAWING NUMBER Fig 11.3	
		TABLE	X
		SHEET No.	3
		OF	3



## Section 12      Opinion of Probable Cost

### 12.1    Cost Basis

To enable completion of the triple bottom line assessment and to obtain an initial indication of capital cost for each of options 1, 2 and 3, cost estimates were prepared for each option. The basis of the estimates includes the following:

#### Direct Cost

- Capital construction cost
- Design and construction contingency costs at 25% of construction cost

#### Indirect Cost

- Engineering at 15% of direct cost
- Administration and miscellaneous at 6% of direct cost

#### Financing Cost

- Interim financing at 4% of direct and indirect cost
- Inflation to midpoint of SENOB construction 2% per annum to 2011 (4%)

Furthermore the following assumptions have been made in estimating the cost of the major components:

- Heat distribution piping from sewage treatment to the University of Victoria point of use is sized on the heat available at the 2065 average day design flow of 17.2 ML/d. The rationale is that buried pipes should be sized for the 50-year available heat.
- Heat exchangers, heat pumps, water pumps and equalization storage are based on the existing available heat of 5,000 KW which in turn is based on the current sewage flow of 10 ML/d.
- As sewage flows increase to the projected 2030 flow of 16.6 ML/d, additional heat can be extracted from the treated effluent. The additional heat extraction equipment and the expansion of the storage tank would be done in a second phase in order to increase the available heat from 5,000 to 8,000 KW. The cost of the equipment to be installed in a second phase is not included.

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

**12.2 Capital Cost**

	<b>Component</b>	<b>Option 1 – Ambient Temp. (up to 20 C)</b>	<b>Option 2 – Moderate Temp. (80 C)</b>	<b>Option 3 – Low Temp. (35 C)</b>
1	Heat pumps at STP	-	\$1,400,000	\$350,000
2	Heat exchangers and water pumping system at STP	\$880,000	\$1,502,000	\$1,154,000
3	Buildings at STP to house equipment (water pumps, etc, heat pumps, heat exchanger)	\$423,000	\$1,575,000	\$1,170,000
4	Equalization storage	\$665,000	\$665,000	\$665,000
5	Closed Loop Distribution piping L= 3200 m			
	Option 1 - 450 mm dia PVC pipe non-insulated	\$2,354,000	-	-
	Option 2 - 350 mm welded steel insulated pipe c/w 50 mm insulation	-	\$2,130,000	-
	Option 3 - 350 mm HDPE insulated pipe c/w 50 mm insulation	-	-	\$2,032,000
6	Heat pumps at point of use	\$1,400,000	-	\$1,050,000
7	Building addition at point of use to house heat pumps	\$1,386,000	-	\$864,000
8	Pumping system at point of use (UVic)	\$1,030,000	\$220,000	\$650,000
	Sub total - Items 1 to 11	\$8,138,000	\$7,492,000	\$7,935,000
9	Design and construction contingencies (26%)	\$2,115,900	\$1,947,900	\$2,063,000
	Sub total - Items 1 to 13	\$10,253,900	\$9,439,900	\$9,998,000
10	Other cost; engineering, project management, financing, etc (28%)	\$2,871,100	\$2,643,100	\$2,799,000
	<b>TOTAL ESTIMATED COST</b>	<b>\$13,125,000</b>	<b>\$12,083,000</b>	<b>\$12,797,000</b>

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

**12.3 Operations and Maintenance Cost**

	<b>Component</b>	<b>Option 1 – Ambient Temp. (up to 20 C)</b>	<b>Option 2 – Moderate Temp. (80 C)</b>	<b>Option 3 – Low Temp. (35 C)</b>
1	Annual power cost based on \$0.08/kwh	\$892,780	\$848,915	\$880,100
2	Labour cost	\$80,000	\$80,000	\$80,000
3	Equipment and buildings maintenance and repairs	\$56,309	\$51,667	\$50,468
4	Distribution system and storage maintenance and repairs	\$16,605	\$15,373	\$14,834
5	Vehicle allowance and miscellaneous	\$10,000	\$10,000	\$10,000
	<b>TOTAL ESTIMATED COST</b>	<b>\$1,055,694</b>	<b>\$1,005,955</b>	<b>\$1,035,402</b>

**12.4 Projected Revenues**

The following assumptions were made when estimating projected revenues from the sale of heat:

- In order to mitigate the low night time and early morning sewage flows, a storage tank will be provided to ensure the minimum heat supply is 5,000 KW.
- An incentive price of \$10/GJ for the sale of heat generated by effluent.
- The average daily sewage flow will increase from 10 ML/d to 16.6 ML/d by 2030 thus allowing an

The projected annual revenues from the sale of heat are as follows:

	<b>Option 1 – Ambient Temp. (up to 20 C)</b>	<b>Option 2 – Moderate Temp. (80 C)</b>	<b>Option 3 – Low Temp. (35 C)</b>
Annual revenues based on 2009 available heat	\$1,110,000	\$1,021,200	\$1,065,600
Annual revenues based on projected 2030 available heat	\$1,840,000	\$1,692,800	\$1,766,400

## Section 13 Triple Bottom Line Analysis for Heat Recovery

### 13.1 Carbon Footprint Analysis

A carbon footprint analysis was performed as a part of the evaluation of the environmental impacts of the three alternatives, Options 1, 2 and 3. A carbon footprint measures the amount of greenhouse gas (GHG) released or stored as a result of a process or activity. A detailed description of the carbon footprint analysis methodology can be found in the September 16, 2009 report by Stantec Consulting and Brown and Caldwell titled “*Core Area Wastewater Treatment Assessment of Wastewater Treatment Options 1A, 1B and 1C.*”

The emission factors used to calculate the GHG emissions/savings associated with the heat recovery project as follows:

- Heat pumps and water pumps for district heating 0.000072 tonne/kWhr (electricity)
- Saleable heat for district heating offset 0.0503 tonne CO<sub>2</sub>/GJ (based on natural gas)

In addition, there are one-time emissions associated with construction activities as follows:

- Concrete 0.272154 tonne CO<sub>2</sub>/m<sup>3</sup>
- Steel (re-bar, piping, equipment) 0.0032 tonne CO<sub>2</sub>/tonne product
- Excavation 0.000981 tonne CO<sub>2</sub>/m<sup>3</sup>

The estimated annual carbon footprint in tones of CO<sub>2</sub> associated with each heat recovery system option based on current available heat is summarized in Table 13.1. The value of carbon credit based on \$25 and \$50 per tonne of CO<sub>2</sub> is shown in Table 13.2.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

**Table 13.1 – Summary of GHG Emissions for Heat Recovery System Options  
(Tonnes of CO<sub>2</sub>)**

	<b>Option 1 – Ambient Temp. (up to 20 C)</b>	<b>Option 2 – Moderate Temp. (80 C)</b>	<b>Option 3 – Low Temp. (35 C)</b>
Power for heat pumps and conveyance (pumping)	803	792	792
Saleable heat for district heating	- 5584	- 5137	- 5360
Total annual emissions	- 4781	- 4345	- 4568

**Table 13.2 - Value of Carbon Credit**

	<b>Option 1 – Ambient Temp. (up to 20 C)</b>	<b>Option 2 – Moderate Temp. (80 C)</b>	<b>Option 3 – Low Temp. (35 C)</b>
Based on \$25/tonne of CO <sub>2</sub>	\$119,525	\$108,625	\$114,200
Based on \$50/tonne of CO <sub>2</sub>	\$239,050	\$217,250	\$228,400

## 13.2 Triple Bottom Line Methodology

This chapter outlines the triple bottom line analysis that was used to evaluate the four options for a reclaimed water system in the area surrounding the proposed SENOB plant. A complete listing of impacts included in the model sorted by the three categories is provided in Table 13.3.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

**TABLE 13.3: Impacts Evaluated for Triple Bottom Line Analysis**

Criteria Group	No.	Criteria Categories	Measure Description
Economic	EC-01	Capital Costs	Construction cost and markup for soft costs adjusted to midpoint of construction
	EC-02	Capital Costs Eligible for Grants	Not available at this time
	EC-03	Present Worth of Net O&M costs	O&M costs
	EC-04	Flexibility for Future Expansion of District Energy System	Cost of additional equalization storage needed to overcome low available heat at night.
Environmental	EN-01	Carbon Footprint	Tons of CO2 created and/or saved
	EN-02	Power (energy) usage	Cost of KWhr per year consumed by district energy system equipment
	EN-03	Heat losses in distribution system	Cost of energy losses in distribution system in MJ/d
	EN-04	Heat Transmission Reliability	Risk cost of equipment and distribution piping failure
	EN-05	Non-renewable resource use	Amount of diesel consumed per year
	EN-06	Terrestrial habitat impact	Restoration of forest habitat disturbed by storage construction
Social	SO-01	Construction Disruption	Cost of traffic inconvenience due to construction
	SO-02	Disruption on private property and customer acceptability	Construction cost on private properties
	SO-03	Loss of Beneficial Site Uses	Loss of park land due to storage tank construction
	SO-04	Cultural Resource Impacts	Risk cost of a cultural site find

### 13.2.1 Economic Factor

#### EC-01 Capital Costs

Capital costs measure the construction cost and soft costs for each option escalated to the midpoint of construction. Data input included the estimated construction cost and a 2011 midpoint of construction. Assumptions included an inflation rate of 3%. The scoring for capital costs was scaled based on the NPV of costs for all three options with an NPV of \$12 million worth three points, higher NPVs worth fewer points, and lower NPVs worth more.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### EC-02 Capital Costs Eligible for Grants

This impact was intended to measure the value of grants to offset construction costs but at this time, insufficient information is available to adequately account for this impact.

### EC-03 Present Worth O&M Costs

Present worth included annual expenditures for operations and maintenance (O&M), and for replacement and refurbishment (R&R) projects. Data input included annual O&M and R&R costs. Assumptions included a 3% rate of inflation for each annual cost. The scoring was scaled based on the annual costs with an annual cost of \$1 million worth 3 points, a higher annual cost worth fewer points, and lower annual costs worth more.

### EC-04 Flexibility for Future Expansion

This impact was intended to measure the flexibility for each option to allow for expansion of the heat recovery system. To measure this, the cost of providing additional building space and the number of buildings to be expanded in order increase the supply of heat available at the 2030 flow rate of 16.6 ML/d was estimated.

EC-04 Scoring	
1	More than \$2.5 million
2	\$2 to 2.5 million
3	\$1.5 to 2 million
4	\$1 to 1.5 million
5	Less than \$1 million

## 13.2.2 Environmental Factors

### EN-01 Carbon Footprint

The details of the carbon footprint calculation are presented in Section 13.1. Scoring was based on the annual value of offsets for equivalent tonnes of carbon dioxide emitted (assuming \$25 per tonne) using the following scale.

EN-01 Scoring:	
1	Less than -\$3 million
2	-\$3.5 million to -\$4 million
3	-\$3.5 million to -\$4 million
4	-\$4 million to -\$4.5 million
5	More than -\$4.5 million

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### EN-02 Power (energy) Use

This impact compares the electrical energy usage for each option. Data input included annual power consumption and a \$0.08/kW-hr cost of power. Assumptions included a 3% rate of inflation for power costs. The NPV for electrical costs was calculated for each option and then scaled as follows:

<b>EN-02 Scoring:</b>	
1	More than \$1.25 million
2	\$1 to \$1.25 million
3	\$0.75 to \$1 million
4	\$0.5 to \$0.75 million
5	Less than \$0.5 million

### EN-03 Heat Losses in Distribution Piping

Some of the heat extracted from the effluent will be lost in the transmission lines between the heat exchange at the sewage treatment and the point of use. The NPV of the loss in revenues resulting from heat losses was estimated. The following 1 to 5 score was used.

<b>EN-03 Scoring:</b>	
1	More than \$1.5 million
2	\$1 to \$1.5 million
3	\$0.5 to \$1 million
4	Less than \$0.5 million
5	No loss

### EN-04 System Reliability

This impact measures the relative risk carried for each option in terms of system complexity. The number of water pumps and heat pumps required varies for each option. The complexity of each option was compared by multiplying the of number water pumps by the number of heat pumps. A \$15,000 risk cost per unit was assumed. The following 1 to 5 score scaled was used.

<b>EN-04 Scoring:</b>	
1	More than \$100,000
2	\$75,000 to \$100,000
3	\$50,000 to \$75,000
4	\$25,000 to \$50,000
5	Less than \$25,000



## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### EN-05 Non-Renewable Resource Use

This impact measured diesel fuel consumption during construction and operations. Diesel consumption during construction was assumed to be 2% of construction costs and diesel consumption during operations was assumed to be 2% of O&M costs. Therefore, data inputted was construction costs and O&M costs. A 3% inflation rate was assumed and a NPV was calculated for each option. The options were scored using the scale below.

<b>EN-05 Scoring:</b>	
1	More than \$1.75 million
2	\$1.5 to \$1.75 million
3	\$1.25 to \$1.5 million
4	\$1 to \$1.25 million
5	Less than \$1 million

### EN-6 Non-Renewable Resource Generated

Non-renewable resource generated measured the available heat to sell for each option after taking account the heat lost in the transmission. The sale price for heat was assumed at \$10 per GJ. The NPV based on annual revenue for each option was calculated and scores were given based on the following scale.

<b>EN-6 Scoring:</b>	
1	Less than \$5 million
2	\$5 to \$15 million
3	\$15 to \$25 million
4	\$25 to \$35 million
5	More than \$35 million

### EN-07 Terrestrial Habitat Impacts

This measure was intended to measure the impact the equalization reservoir would have on existing terrestrial habitats assuming that the plant is constructed in the forested area of Haro Woods. The area required for the storage tanks was calculated and relative 1 to 5 score was given based on the potential mitigation cost for the area impacted, assuming that a 15 m strip around the reservoir would have to be replanted with trees. The following scale was used.

<b>EN-07 Scoring:</b>	
1	More than \$25,000
2	\$20,000 to \$25,000
3	\$15,000 to \$20,000
4	\$10,000 to \$15,000
5	Less than \$10,000

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### 13.2.3 Social Impacts

#### SO-01 Construction Disruption

Traffic during construction can be particularly noisome to neighboring residents and businesses. To measure this disruption, the volume of traffic potentially impacted by the district energy system construction was estimated by using traffic counts at nearby intersections for each site. These traffic counts came from CRD's 2005 evaluations. The number of construction trips was calculated by estimating one construction trip per day for every \$2,500 of construction budget. The traffic count was multiplied by the daily construction traffic at each site and a plant construction disruption cost was calculated assuming a \$1 cost per trip delayed, a 1% probability of delay due to construction and a 12 month construction period.

<b>SO-01 Scoring:</b>	
1	More than \$500,000
2	\$375,000 to \$500,000
3	\$250,000 to \$375,000
4	\$125,000 to \$250,000
5	Less than \$125,000

#### SO-02 - Disruption on Private Property and Customer Acceptability

In order to connect to the heat recovery system, equipment and piping may be required at the site of each potential customer. Depending on the option for the distribution system, the equipment at each point of use could include heat exchangers and heat pumps. In many cases, the existing mechanical rooms have to be expanded to allow construction of this work adding to the cost of the system. The cost of this one-time expense of work on the property of the University of Victoria was estimated and a qualitative 1 to 5 score was given as shown below.

<b>SO-02 Scoring:</b>	
1	More than \$4 million
2	\$3 to \$4 million
3	\$2 to \$3 million
4	\$1 to \$2 million
5	Less than \$1 million

#### SO-03 Loss of Beneficial Site Use

The construction of buildings on private property to accommodate heat pumps and other equipment may preclude the use of the site for other types of use. To measure this impact, the space lost due to building footprint was estimated and an assumption of a \$1,000,000 per hectare incremental value for using the site for heat recovery instead of a treatment facility was assumed. The scale used to compare options is presented below.

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

<b>SO-03 Scoring:</b>	
1	More than \$200,000
2	\$150,000 to \$200,000
3	\$100,000 to \$150,000
4	\$50,000 to \$100,000
5	Less than \$50,000

### SO-04 Cultural Resource Impacts

A cultural resource find would cause additional cost and delay to site construction. The probability of a cultural find for each site and the resulting delay was estimated along with the estimated construction cost. An assumed 3% inflation rate was used to quantify the delay cost of a cultural find. By multiplying the delay cost by the probability of a find, the risk cost of a cultural find was calculated for each option and compared using the following scale.

<b>SO-04 Scoring:</b>	
1	More than \$60,000
2	\$45,000 to \$60,000
3	\$30,000 to \$45,000
4	\$15,000 to \$30,000
5	Less than \$15,000

## 13.3 Results

The results of the triple bottom line analysis is summarized in Table 13.4 and shown graphically in Figure 13.1. The discussion of the results can be found in Section 14.

**CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

**Figure 13.1 – Triple Bottom Line Analysis for a Heat Recovery System at the University of Victoria**

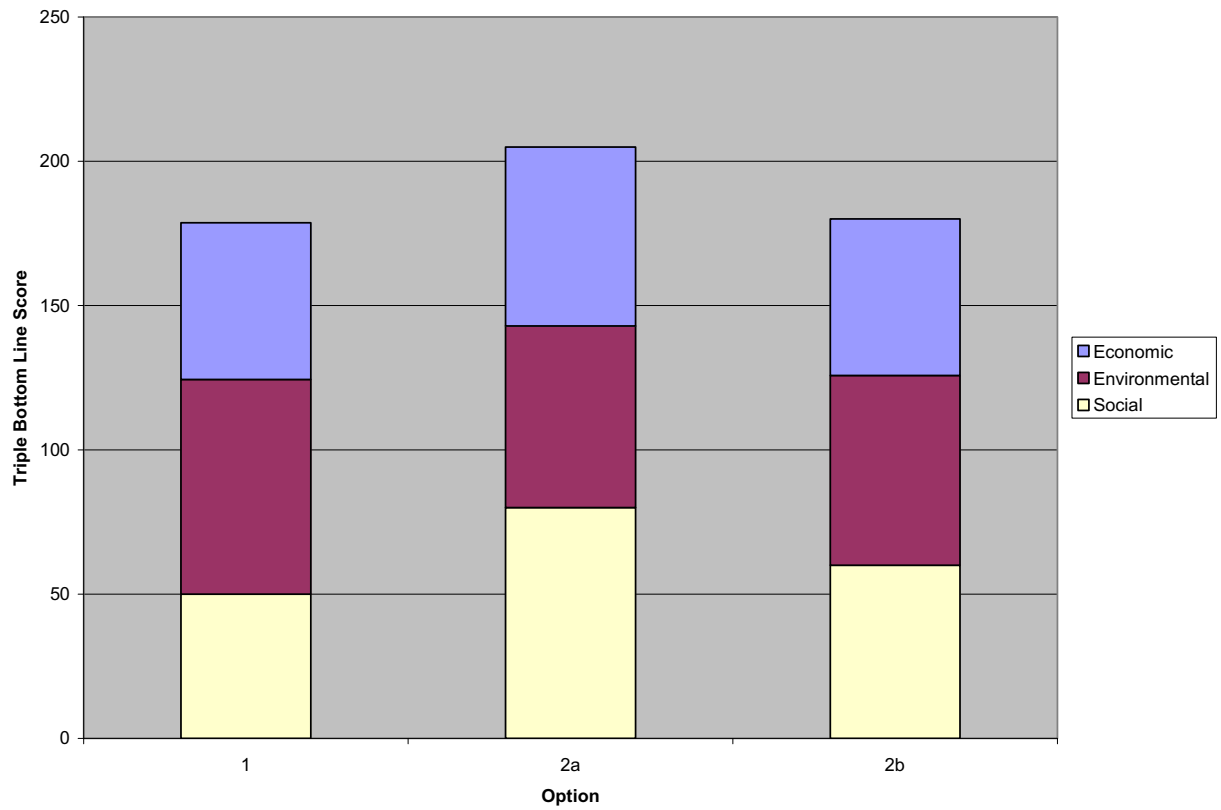


Table 13.1

## Triple Bottom Line Analysis for Heat Extraction

Criteria Group	No.	Criteria Categories	Measure Description	Weight	Option Results		
					1	2a	2b
Economic	EC-01	Capital Costs	Construction cost and markup for soft costs adjusted to midpoint of construction	9	2.8	3.0	2.9
	EC-02	Capital Costs Eligible for Grants	Not available at this time	-			
	EC-03	Present Worth of O&M costs	O&M costs	9	2.8	3.0	2.9
	EC-04	Flexibility for Future Expansion	Cost and number of additional buildings to accommodate future equipment	2	2	4	1
<b>Economic Subtotal (100 pts max)<sup>1</sup>:</b>					<b>54</b>	<b>62</b>	<b>54</b>
Environmental	EN-01	Carbon Footprint	Tons of eCO2 created/saved	2.86	3	2	3
	EN-02	Power (energy) usage	Heat energy replacing natural gas	2.86	3	3	3
	EN-03	Heat loss in distribution piping	Loss of revenues	2.86	5	3	4
	EN-04	System Reliability	Number of water pumps and heat pumps	2.86	4	3	3
	EN-05	Non-renewable Resource Use	Gallons of diesel consumed per year	2.86	4	4	3
	EN-06	Non-renewable Resource Generated	Net sale of heat	2.86	3	3	3
	EN-07	Terrestrial and Inter-tidal Effect	Habitat areas potentially disturbed	2.86	4	4	4
<b>Environmental Subtotal (100 pts max):</b>					<b>74</b>	<b>63</b>	<b>66</b>
Social	SO-01	Operations Traffic in Sensitive Areas	Cost of traffic inconvenience during operations	5	3	3	3
	SO-02	Disruption on Private Property and Customer Acceptability	Construction cost of work on private property	5	1	5	2
	SO-03	Loss of Beneficial Site Uses	Cost of area required on private property for heat pumps and building	5	2	5	4
	SO-04	Cultural Resource Impacts	Risk cost of a cultural site find	5	4	3	3
<b>Social Subtotal (100 pts max):</b>					<b>50</b>	<b>80</b>	<b>60</b>
<b>TOTAL SCORE (300 pts max):</b>					<b>179</b>	<b>205</b>	<b>180</b>

## Section 14 Analysis of Results and Conclusions

### 14.1 Market Considerations

For the Saanich East / North Oak Bay WWTP, there is principally a single customer; the University of Victoria, so technical requirements and the design will be guided by the University's DHS requirements. More than 80% of the demand in this area comes from the 4 boiler plants of the University. The remaining 20% is scattered principally amongst smaller schools and recreation centers that range in distance from the district heat conveyance line from 0.5 km to 4 km away.

Temperature, capacity and reliability are important issues from all customers. The potential customers have stated, with respect to reliability and connect-ability of a district energy system that: "...making the ability to connect to the system as attractive as possible for the end users is of utmost importance".

This is true for the University as our surveys and meetings have indicated they have concerns about compatibility with their DHS which currently operates at a 230 °F supply temperature which is much higher than what can be provided by conventional heat pumps (176F).

The three options that were analyzed for extracting and conveying the heat from the treated effluent to the University of Victoria vary based on the temperature of the water that is conveyed to the point of use:

- Option 1 will provide low grade heat at ambient temperature of 10°C to 20°C. This requires that heat pumps be installed at the University.
- Option 2 will provide heat at moderate temperature of 80°C. This is a readily usable product that does not require heat pumps at the customer's locations.
- Option 3 will provide heat at a lower temperature of 35°C. This will also require heat pumps be installed at the University.

The central boiler system for the University operates at temperatures of 105°C to 115°C (220°F to 240°F) and the suitability of the product to be sold to the customer increases with its heat content. From the customer's point of view, Option 2 would be the preferred option. Since the supply temperature of Option 2 is lower than the current boiler operating temperature and because the supply of heat from effluent will not meet the entire demand, it is proposed to supply heat only to a portion of the campus and to supplement the heat provided from the effluent with the existing boilers.

## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

### **14.2 Triple Bottom Line Assessment**

The difference in capital and in O&M costs between the three options under consideration is not significant. The capital cost Options 2 is lower mainly because of the economies of scale resulting from having all equipment and the heat pumps at one location. Another factor is the lower cost of the transmission line from the sewage treatment plant to the campus since hotter water requires a smaller pipe and the added cost of insulation does not offer the larger pipe size

However, Option 2 has a lower environmental score because of the heat losses in the transmission main. These heat loss estimated at 4% will result is a corresponding reduction in the amount of saleable heat and a higher energy consumption. The main drawback of Options 1 and 3 is the need to construct a new building on campus in order to house the heat pumps and other equipment at the point of use. The need to construct facilities on private property could result in significant disruption as well as the loss of land. This could also affect the marketability of the heat recovery system.

### **14.3 Conclusions**

The design of the existing central heating plant at the University of Victoria limits the amount of heat that can be feasibly extracted for beneficial reuse. Connecting to the main boiler plant (No. 4 boiler room) is not possible because the existing boiler system operates temperatures that are higher that can be provided by a district energy system using heat extracted from treated effluent. As an alternative to connecting to the main boiler plant, the buildings served by the boiler No.2 plant can be considered for effluent heat reclamation. Also is would be possible to meet the domestic hot water demand for the entire campus during the summer months when space heating is not required. There is however considerable cost associated with the implementation of such a system. There are several reasons why the costs are so high:

- The heated water must be pumped in separate pipelines over a 30 m difference in elevation between the site of the proposed WWTP plant on Arbutus Road and the campus.
- The heat extracted from the effluent is low grade heat which has a temperature of 12 C. Following heat exchange between the effluent and clean water, the water temperature has to be boosted twice with heat pumps in order to achiever the minimum useful temperature of 80 C. The power consumption of the heat pumps is significant and this increases operating costs substantially;
- Even at 80 C, this is lower than the operating temperature the campus district heating system which is in the range of 105-115C. As a result, the use of extracted heat is limited to supplying domestic hot water in summer and space heating in the shoulder seasons. During the colder winter months, boilers will have to be fired up in order to meet the demand for space heating;

## CAPITAL REGIONAL DISTRICT

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

- The peak demand for heat occurs early in the morning and this corresponds to the lowest flow rate of the day. In order to supplement the low available heat, equalization storage is proposed since the life expectancy of boilers will be severely reduced by frequent stop and start cycles. (Boilers are designed to stay on for extended periods of times and not daily off-on cycles);
- Even with equalization storage, the amount of available heat from treated effluent represents only 25% of the morning peak demand for the campus based on existing sewage flows of 10 ML/d, and
- The existing sewage flow at the proposed SENOB plant averages 10 ML/d. This is significantly lower than the 2030 design flow of 16.6 ML/d. The amount of available heat is proportionally reduced.

The capital costs for the recovery of heat at the proposed SENOB wastewater treatment plant for reuse on the campus of the University of Victoria are significant and are summarized as follows:

- |  |              |
|--|--------------|
| • Option 1 – Ambient temperature system        | \$13,125,000 |
| • Option 2 – Moderate temperature system (80C) | \$12,083,000 |
| • Option 3 – Low temperature system (35C)      | \$12,797,000 |

Based on the Triple Bottom Line analysis, Option 2 would be the preferred option for a heat extraction and supply system. On the basis of Option 2, the operating and maintenance costs and the revenues generated by the recovery of heat are summarized in a follows:

- |   |             |
|---|-------------|
| • Operating and maintenance cost                                | \$1,006,000 |
| • Revenues  | \$1,021,000 |
| • Net operating revenues  | \$15,000    |
| • Value of carbon credit based on \$25/tonne of CO <sub>2</sub> | \$108,000   |
| • Value of carbon credit based on \$50/tonne of CO <sub>2</sub> | \$217,000   |

The carbon credit associated with the use of heat extracted from sewage has a value of \$108,000 per year based on \$25 per tonne of CO<sub>2</sub> and \$217,000 if the value of carbon doubles to \$50/tonne.

The proposed SENOB plant should be designed in such a manner that the footprint and piping connections required for the infrastructure needed for resource recovery are provided. This would allow the implementation of resource recovery either now or in the future. Heat recovery



## **CAPITAL REGIONAL DISTRICT**

Core Area Wastewater Treatment Program  
Effluent Reuse and Heat Recovery for the  
University of Victoria and Surrounding Area

---

for the new buildings at the SENOB WWTP could be considered as it is likely this system could be implemented economically.

Implementing a heat extraction system for the University of Victoria would be as a result of a policy decision since the economic analysis of heat extraction has indicated the payback period is beyond the life expectancy of the equipment.

The design and drawings prepared by Hirschfeld Williams Timmins Ltd. are instruments for the execution of the work shown and are the property of Hirschfeld Williams Timmins Ltd. who reserves the copyright therein and in the work executed therefrom. The design and drawings are not to be used in any way without written consent.

These design documents are prepared solely for the use by the party with whom Hirschfeld Williams Timmins Ltd. has entered into a contract. There are no representations of any kind made to any party with whom Hirschfeld Williams Timmins Ltd. has no contract.

5	FEB 24/2009	UPDATED
4	FEB 17/2009	UPDATED
3	JAN 19/2009	UPDATED
2	JAN 31/2007	FS CHANGED TO DPS
1	JUN 28/2008	REPORT
0	NOV 2, 2005	REVIEW
NO.	DATE	ISSUED FOR



**Hirschfeld Williams Timmins Ltd.**  
 Mechanical Engineering Services  
 1884.01 project no.  
 302-4400 Oxidation Way, Victoria, B.C. V8X 5J2  
 Tel. (250) 995-3111 fax. (250) 995-3133


PROJECT: UNIVERSITY OF VICTORIA  
 CAMPUS HEATING  
 REPORT  
 Victoria  
 British Columbia

TITLE: CAMPUS CENTRAL  
 HEATING SYSTEM  
 SCHEMATIC

PROJECT NO: 1884.01  
 DATE: JUNE 28, 2006  
 SCALE: N.T.S.  
 CHECKED BY: RKH  
 DRAWN BY: SPH, JCP

ISSUED FOR: DRAWING NO.  
 PRELIMINARY  
 50% REVIEW  
 FINAL REVIEW  
 TENDER  
 BUILDING PERMIT  
 CONSTRUCTION

**M5**

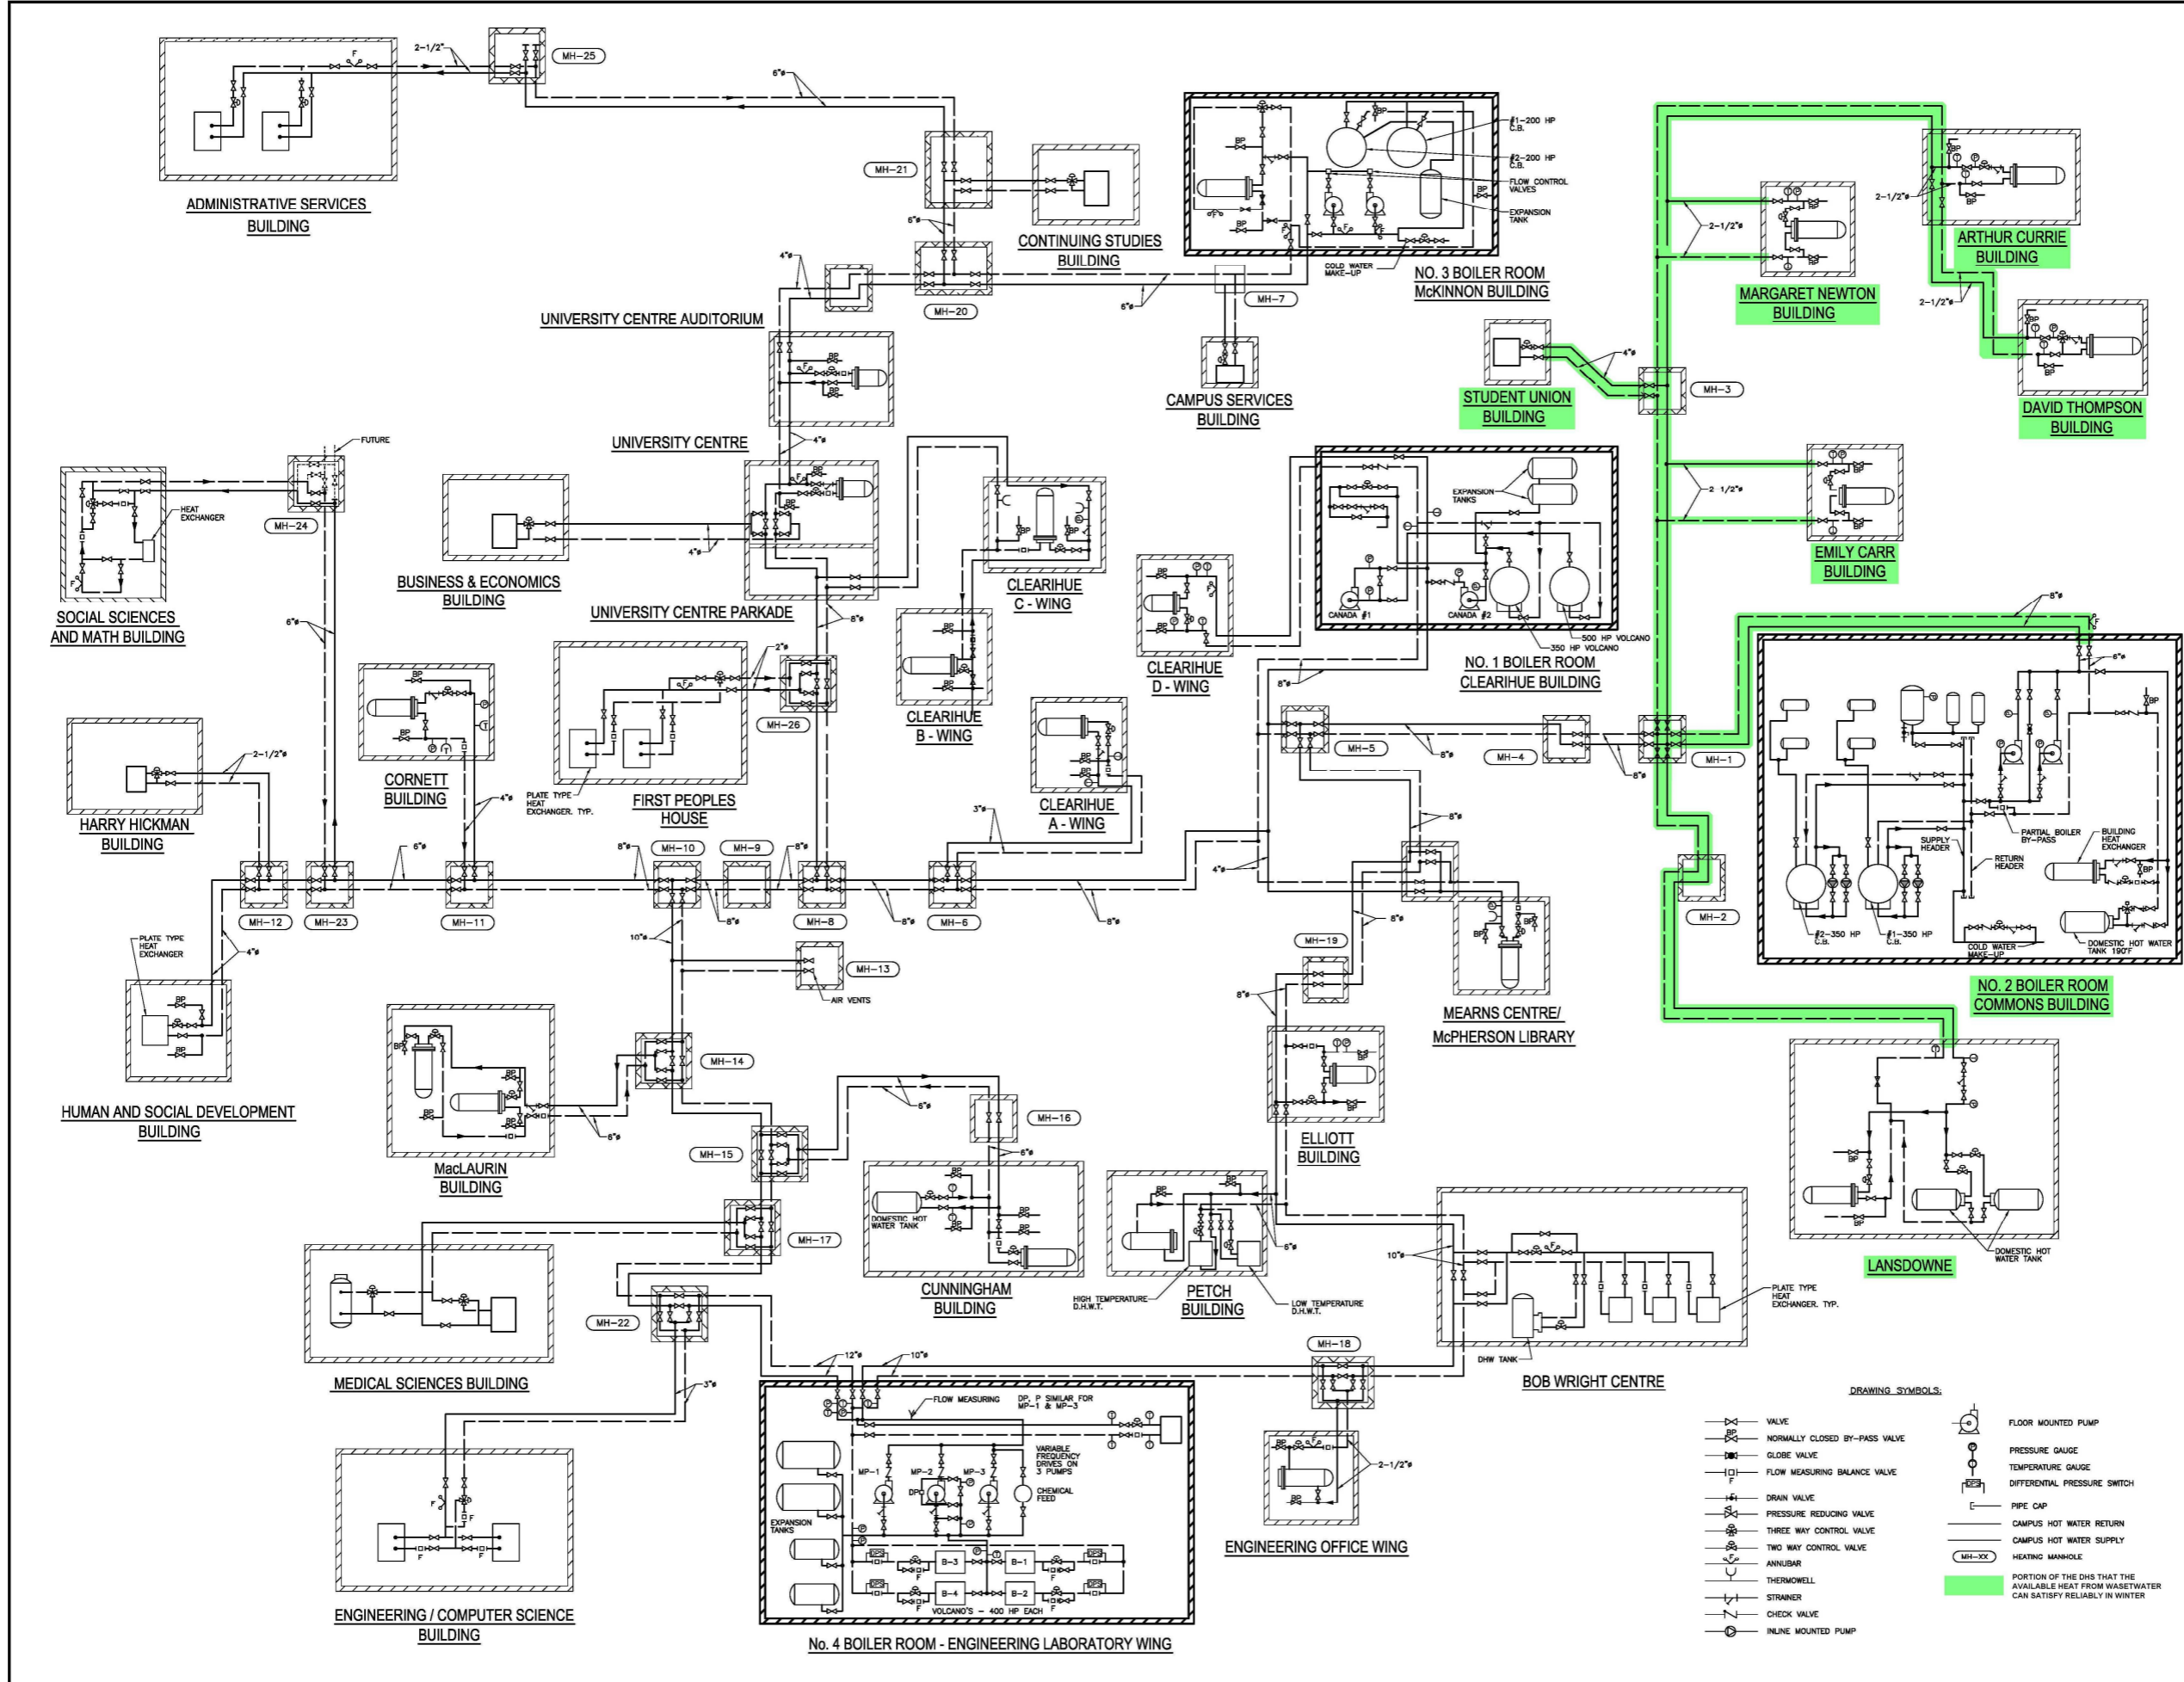

- DRAWING SYMBOLS:
- VALVE
  - NORMALLY CLOSED BY-PASS VALVE
  - GLOBE VALVE
  - FLOW MEASURING BALANCE VALVE
  - DRAIN VALVE
  - PRESSURE REDUCING VALVE
  - THREE WAY CONTROL VALVE
  - TWO WAY CONTROL VALVE
  - ANNUBAR
  - THERMOWELL
  - STRAINER
  - CHECK VALVE
  - INLINE MOUNTED PUMP
  - FLOOR MOUNTED PUMP
  - PRESSURE GAUGE
  - TEMPERATURE GAUGE
  - DIFFERENTIAL PRESSURE SWITCH
  - PIPE CAP
  - CAMPUS HOT WATER SUPPLY
  - CAMPUS HOT WATER RETURN
  - HEATING MANHOLE
  - PORTION OF THE DHS THAT THE AVAILABLE HEAT FROM WASTEWATER CAN SATISFY RELIABLY IN WINTER