



PIPE SHALL BE STEEL SPOOL COATED
INSIDE AND OUT w/ FUSION BONDED EPOXY
TO AWWA C213 (INTERIOR COATING TO NSF61).
ALTERNATE: P.C. 350 DI TO AWWA C151 c/w UNIFLANGE
ALTERNATE: SS TO AWWA/ANSI C220-92

VALVES TO BE RIGHT HAND (CW) OPENING

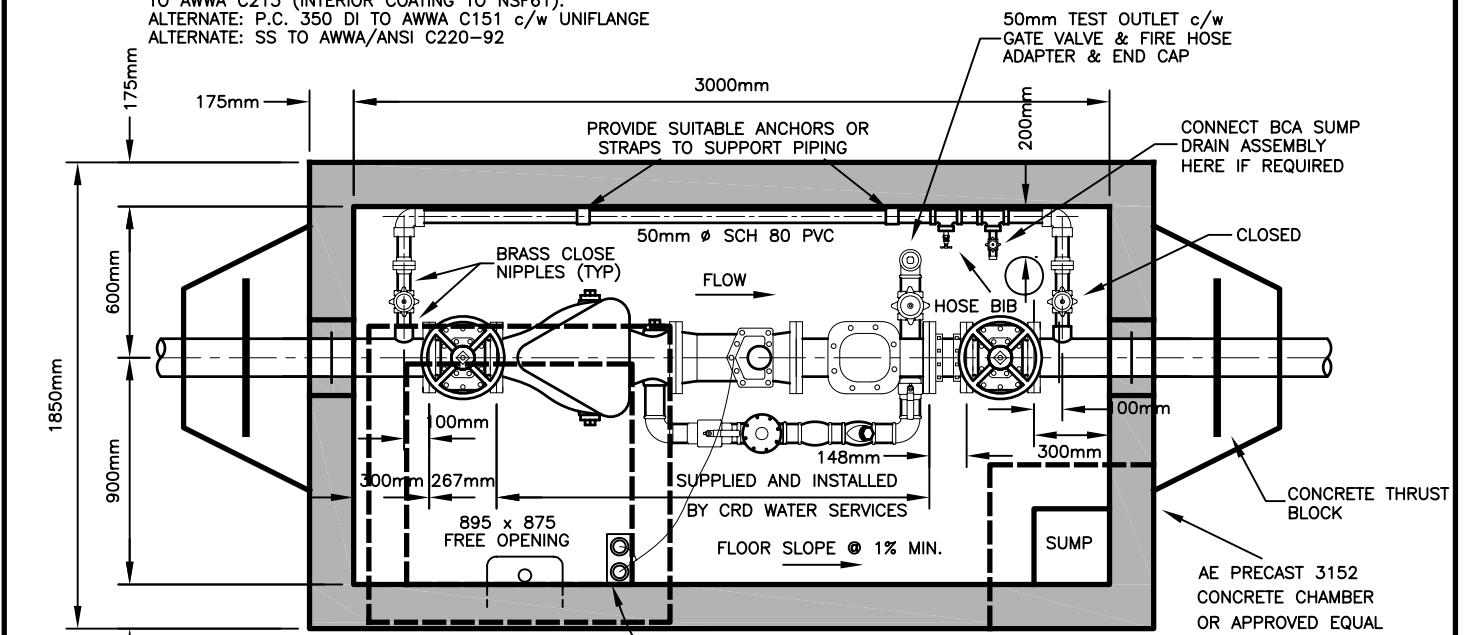

PLAN

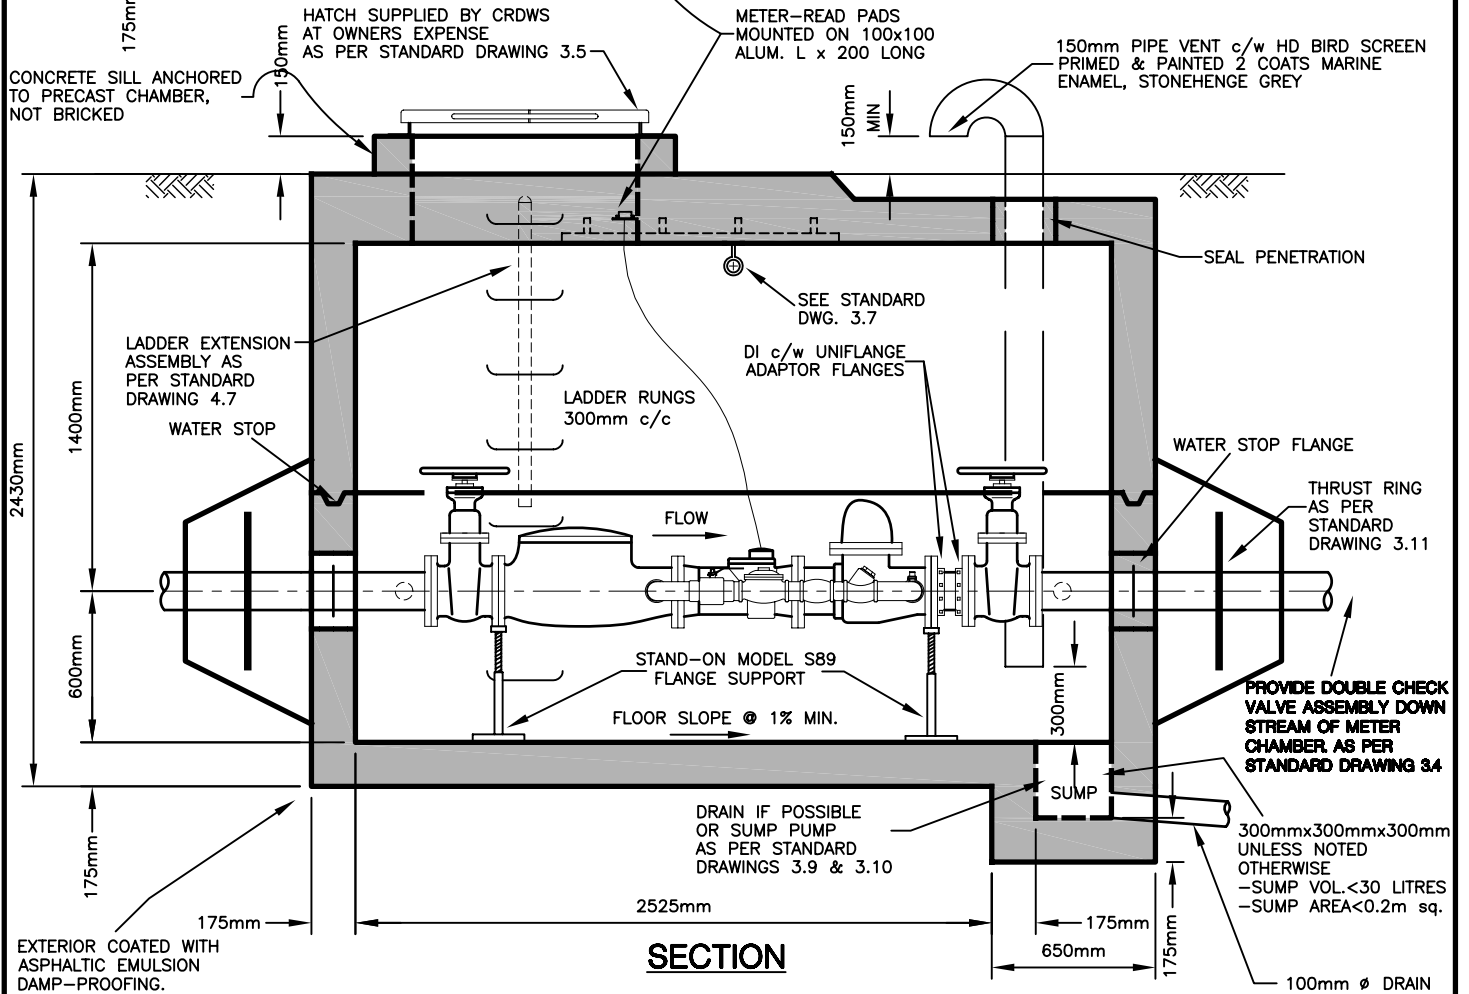

SECTION



Making a difference...together

**PRECAST 150mm
SENSUS FIRELINE
METER VAULT**

revision date:	scale:
APRIL 2007	N.T.S.
drawn:	checked:
S.R.	C. GOTTFRED

standard drawing no.:

3.2