


STANDARD METER BOX AS PER APPROVED MATERIALS
 VALVE BOX AND SLEEVE INSTALLED AS PER STANDARD DRAWINGS 1.5 & 1.10

POLYMER FLUSH BOX
 100mm ϕ THREADED FLANGE c/w
 100mm ϕ RESTRAINED MJ FLANGE
 ADAPTER, 100mm ϕ MALE
 CAMLOCK & CAP WITH GASKET
 REMOVED & 8mm HOLE DRILLED
 IN TOP OF CAP.

FINISHED GRADE

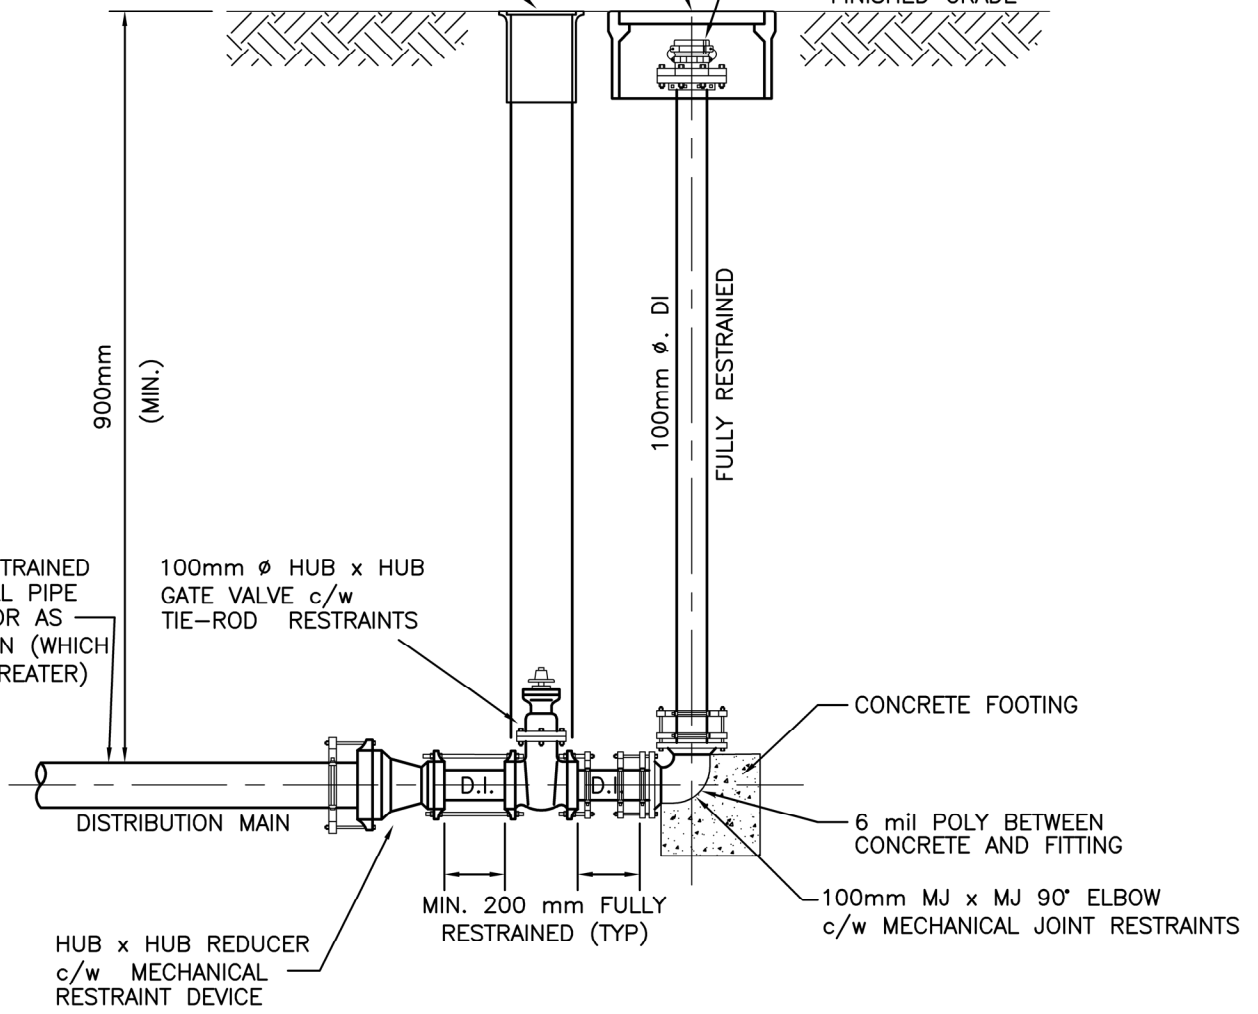

**100mm FLUSH ASSEMBLY
 FOR DISTRIBUTION MAINS
 (OUTSIDE PAVED AREA)**

revision date: June 2019	scale: N.T.S.
standard drawing no.:	
1.6	