


IN ISOLATED LOCATIONS USE 1.8m
x 100mm ϕ SCH 40 PAINTED
STEEL PIPE MARKER POST
EMBEDDED 0.6m IN CONCRETE.



NOTES:

- 1.) FOR REDUCED CLEARANCE, A LOW PROFILE AIR RELEASE VALVE MAY BE SUBSTITUTED UPON APPROVAL.

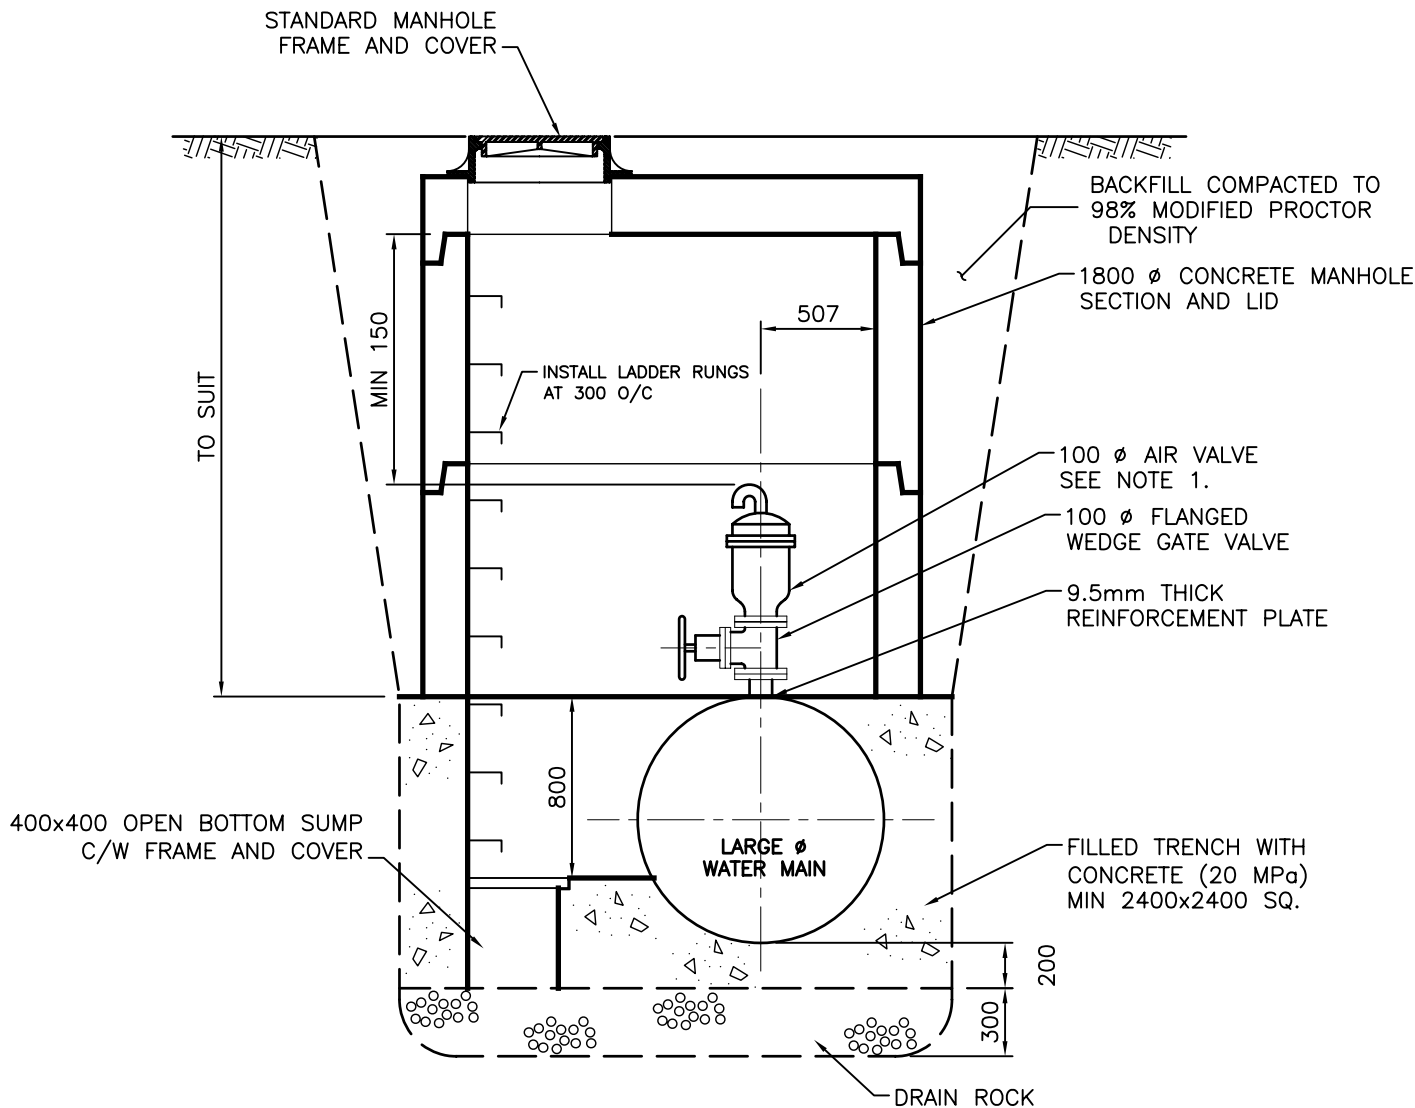

**STANDARD AIR VALVE
INSTALLATION
FOR > 300mm ϕ PIPE**

revision date: APRIL 2007	scale: N.T.S.
drawn: PJ/DR	checked: C. GOTTFRED
standard drawing no.:	
1.1	